

Projekt Kv Kölen					
Uppdragsnummer		Uppdragsgivare		Granskad	
30039781		Sweco Sverige AB, Nyköping		37006	
Provtagningsdatum		Provtagningsredskap / Analysmetod		Utskriftsdatum	
2022-03-21 - 2022-03-24		Skr		2022-04-28	
Lab.tekn.				Undersökningsdatum	
				2022-04-26 - 2022-04-27	

Borrhål/ Sektion	Djup [m]	Benämning (okulär jordartsklassning SS-EN ISO 14688-1+2) Jordartsförkortning (enl. SGF 2016)	Vatten kvot w [%]	Kon- flyt- gräns w _L [%]	Mtrl typ/ tjälf. klass ¹⁾
22S001	0.7-1.0	Gråbrun något finsandig gyttig LERA torrskorpekaraktär, (f _{sa})gyCl(dc)	28	50	5B/4
	1.0-2.0	Grå finsandig siltig LERA med tjocka siltiga finsandsskikt, fsasiCl)sifsa(24	28	5A/4
	2.0-3.0	Grå sulfidhaltig siltig LERA med tunna finsandsskikt samt enstaka gruskorn, susiCl (f _{sa})	36	38	5A/4
	3.0-4.0	Grå sulfidhaltig siltig LERA med tunna finsandsskikt samt enstaka gruskorn, susiCl (f _{sa})	43	48	5A/4
	4.0-5.0	Grå sulfidhaltig siltig LERA med sand- och gruskorn, susiCl	49	53	5A/4
22S005	2.0-2.5	Grå något sulfidhaltig LERA med siltiga finsandsskikt samt enstaka skalrester, (su)Cl)sifsa (sh)	27	37	4B/3
	2.5-3.0	Grå sulfidhaltig LERA med sandkorn, suCl	63	70	4B/3
	3.0-4.0	Grå sulfidhaltig LERA med sandkorn, suCl	60	67	4B/3
	4.0-5.0	Grå sulfidhaltig LERA med sand- och gruskorn, suCl	59	67	4B/3
22S009	2.2-3.2	Grå något rostfläckig sulfidhaltig LERA med sandkorn, suCl	73	84	4B/3
	3.2-4.0	Grå sulfidhaltig LERA, suCl	77	82	4B/3
	4.0-5.0	Svartgrå sulfidhaltig LERA med sandkorn, suCl	79	82	4B/3

1) Klassning enl. AMA Anläggning 20



P:\Uppdrag 2022\37006\[Skr 220428.xlsx]

Rutinundersökning ostört prov

Projekt Kv Kölen				Löp-nr 37006		Granskad <i>Potn</i> Per Östensson	
Uppdragsnummer 30039781		Uppdragsgivare Sweco Sverige AB, Nyköping		Provtagningsdatum 2022-03-24		Provtagningsredskap Kv St II ø 50mm	
Referensnivå				Vattennivå / Datum /		Utskriftsdatum 2022-04-05	
						Datum för analys 2022-04-05 <i>Emilie Lagrosen</i>	


Sektion		Borrhål			Skrymdensitet			Konprov			Skjuvhållfasthet		Sensi-	Kon-	w-våt	Vatten	Jordartsförkortning
22S005		Dia-	Vikt/	ρ^2	Ostört			Medel	Omrört	Ostört	Omrört	tivitet	flyt-	w-torr	kvot		(enl. SGF Beteck-
Djup	Okulär jordartsklassificering ¹⁾	meter	Längd	[t/m ³]	[mm]	[mm/g]	[mm/g]	τ_{fu}	[kPa] ³⁾	[kPa]	S_i	gräns	[g]	w [%]		ningssystem 2016)	
[m]		[cm]	[g/cm]					[kPa]				w _L [%]					
3.0	Grå sulfidhaltig LERA	5,00	546.0 / 17.0	1,64	11.7 11.7 11.1 11.6 11.8 11.4	11.6 / 400	6.2 / 60	29	3.8	8	76	73.9 44.5	66			suCl	
							7.9 / 60					69.8 41.3					
4.0	Svartgrå sulfidhaltig LERA	5,00	531.0 / 17.0	1,59	13.1 12.9 13.0 13.2 13.0 13.0	13.0 / 400	7.5 / 60	23	2.6	9	74	73.2 43.7	68			suCl	
5.0	Svartgrå sulfidhaltig LERA	5,00	534.0 / 17.0	1,60	13.1 13.0 13.1 13.0 12.9 13.3	13.1 / 400	7.7 / 60	23	2.5	9	76	70.5 41.6	69			suCl	

1) Okulär jordartsklassificering enl. SS-EN ISO 1488 1+2

2) Densiteten beräknad på medelvärde av fylld över-, mellan- och undebyl:

\\eutaabs010\geolab\$\PI\Uppdrag 2022\37006\Kon 22S005 220405.xlsx

3) Okorrigerat värde. Korrigeringen rekommenderas enl. SGF-INFO nr 3. Avvikelse från SS027125. Om konintrycket är mindre än 7.0mm med 100g konen, används 400g konen, enligt SGF:s laboratoriekommitté.





Projekt Kv Kölen		Granskad	Christer Åkerman
Uppdragsnummer	Uppdragsgivare	Löp-nr	37006
30039781	Sweco Sverige AB, Nyköping	Datum	2022-04-28
Provtagningsdatum	Provtagningsredskap / Analysmetod	Analys utförd	Per Östensson
2022-03-24	Skr, Kv St II ø 50mm	2022-04-05 - 2022-04-27	

Borrhål/ Sektion	Djup [m]	Benämning / (okulär jordartskl. SS-EN ISO 14688-1+2) Jordartsförkortning (enl. SGF 2016)	Den- sitet ρ [t/m ³]	Vatten- kvot w_n [%]	Kon- flyt- gräns w_L [%]	Sensi- tivitet S_t	Skjuv- hållf.h. τ_{fu} [kPa] ¹⁾	Mtrl. typ/ tjälf. klass ²⁾	Anm
22S005	2.0-2.5	Grå något sulfidhaltig LERA med siltiga finsandsskikt samt enstaka skalrester, (su)Clisifsa (sh)		27	37			4B/3	
	2.5-3.0	Grå sulfidhaltig LERA m sandkorn, suCl		63	70			4B/3	
	3.0	Grå sulfidhaltig LERA, suCl	1.64	66	76	8	29	4B/3	
	3.0-4.0	Grå sulfidhaltig LERA m sandkorn, suCl		60	67			4B/3	
	4.0	Svartgrå sulfidhaltig LERA, suCl	1.59	68	74	9	23	4B/3	
	4.0-5.0	Grå sulfidhaltig LERA med sand- och gruskorn, suCl		59	67			4B/3	
	5.0	Svartgrå sulfidhaltig LERA, suCl	1.60	69	76	9	23	4B/3	

1) Okorrigerat värde. Korrigeringen rekommenderas enl. SGF-INFO nr 3. Avvikelse från SS027125: Om konintrycket är mindre än 7,0 mm med 100g konen, används 400g konen, enligt rekommendation från SGF:s laboratoriekommitté.


2) Klassificering enl. AMA Anläggning 20

P:\Uppdrag 2022\37006\Kv 220428.xlsx

CPT-test performed according to EN ISO 22476-1

Predrilling depth	2.00 m	Reference	my	Fluid in filter	Olja&fett
Start depth	2.00 m	Level at reference	4.30 m	Coordinates	X=6636970.090,Y=130526.744
Stop depth	25.69 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	2.70 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S001
Date	20220321

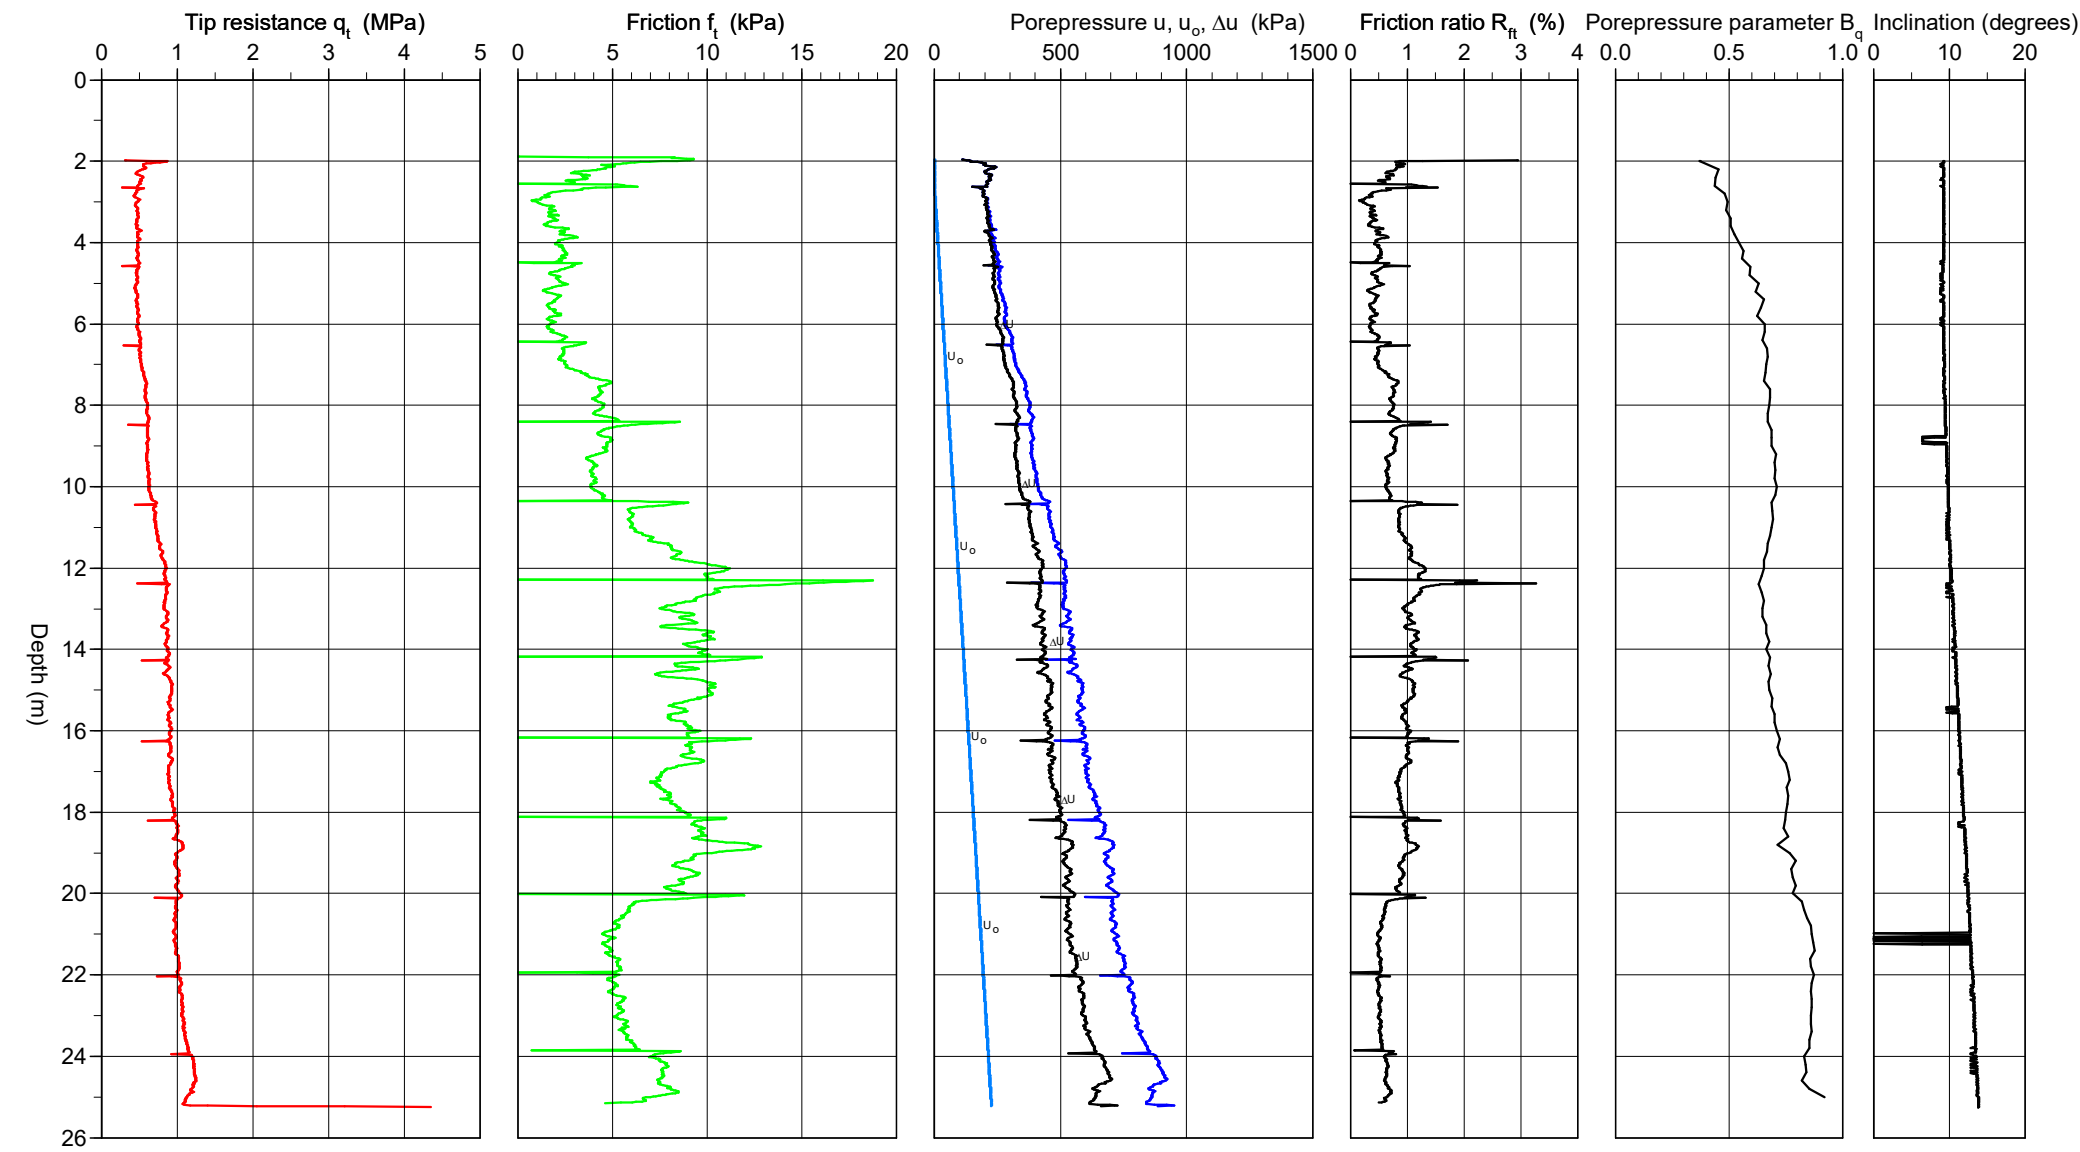

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S001
 Date 20220321


Reference my Predrilling depth 2.00 m Evaluator INPRAG
 Level at reference 4.30 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 2.70 m Equipment Envi Memocone
 Start depth 2.00 m Geometry Normal

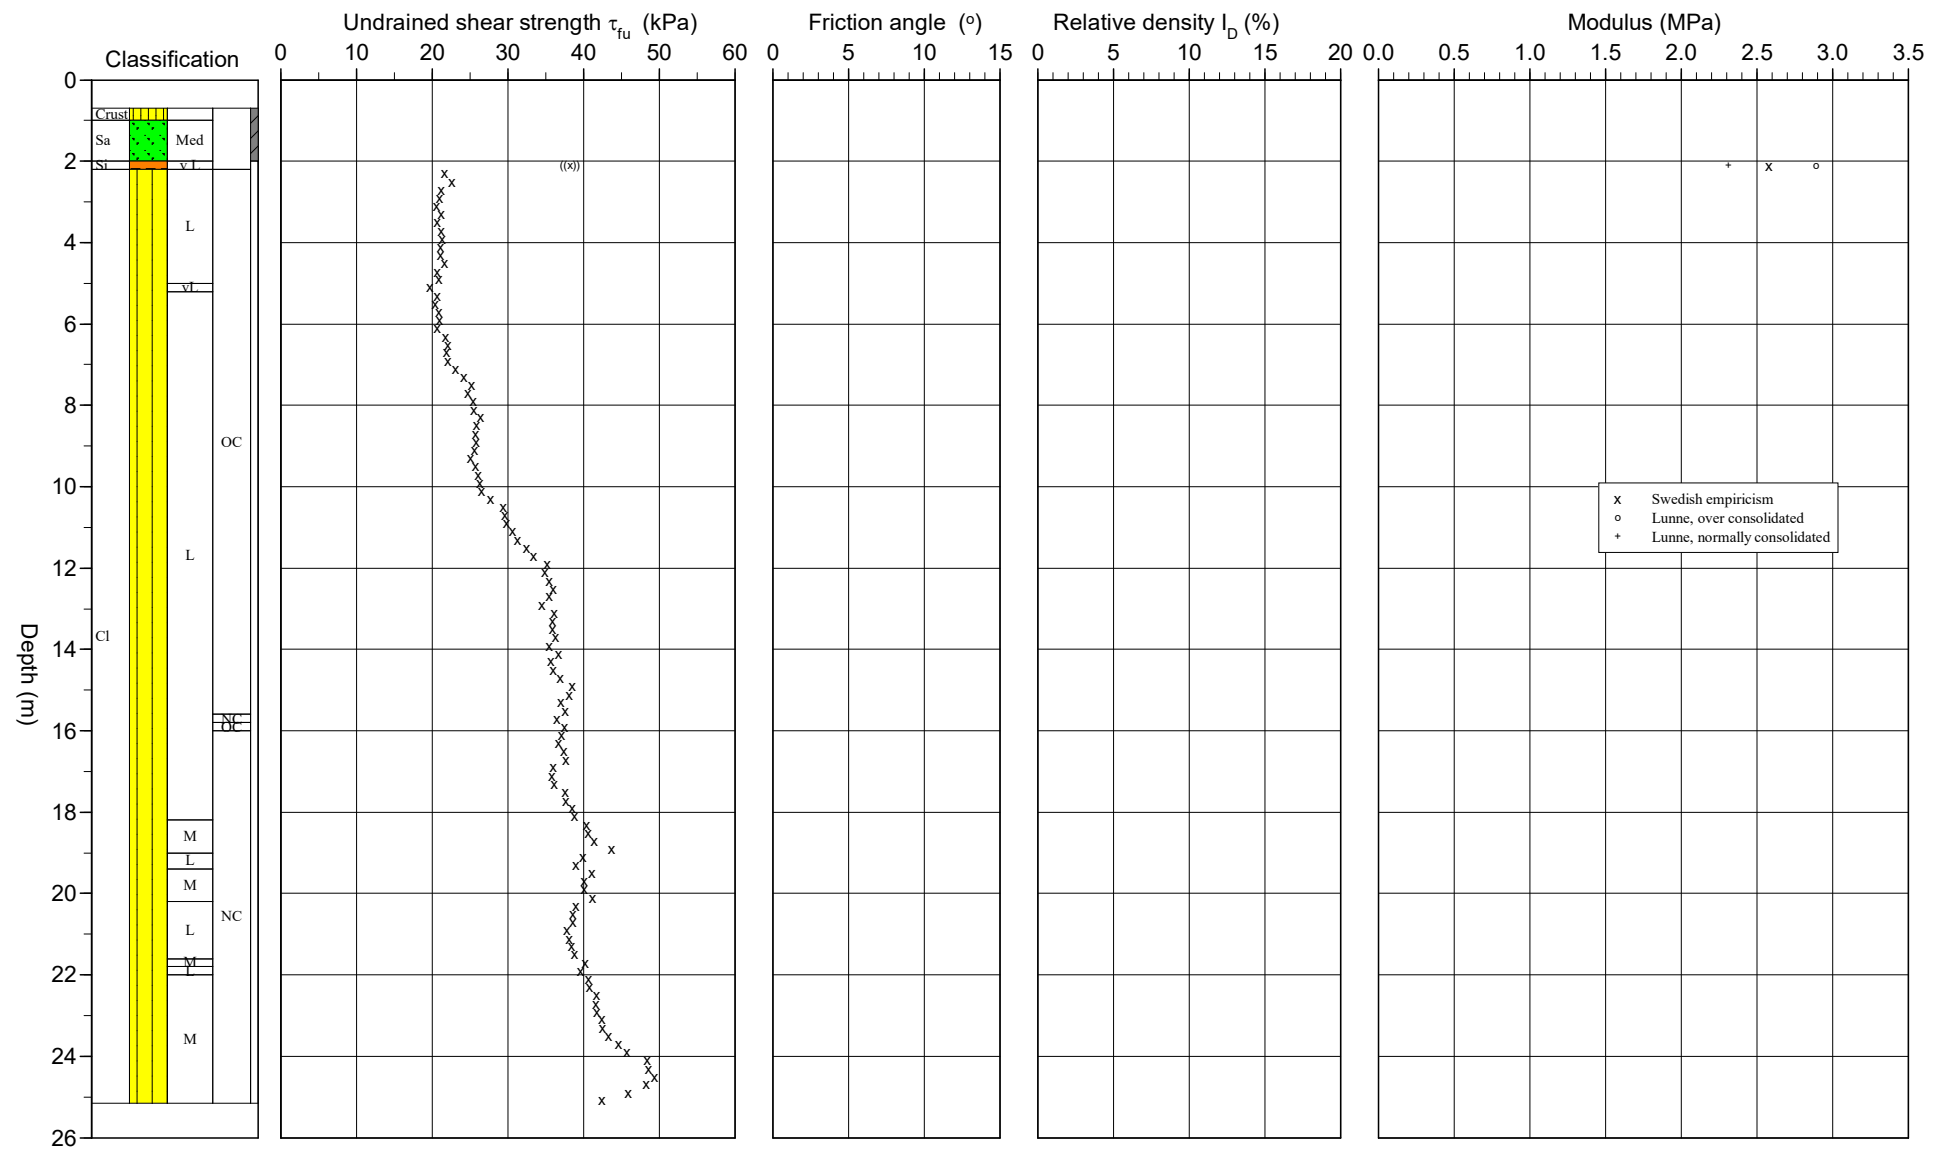

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	my	Predrilling depth	2.00 m	Evaluator	INPRAG
Ground water level	4.30 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	2.70 m	Equipment	Envi Memocone		
Start depth	2.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S001
Date	20220321

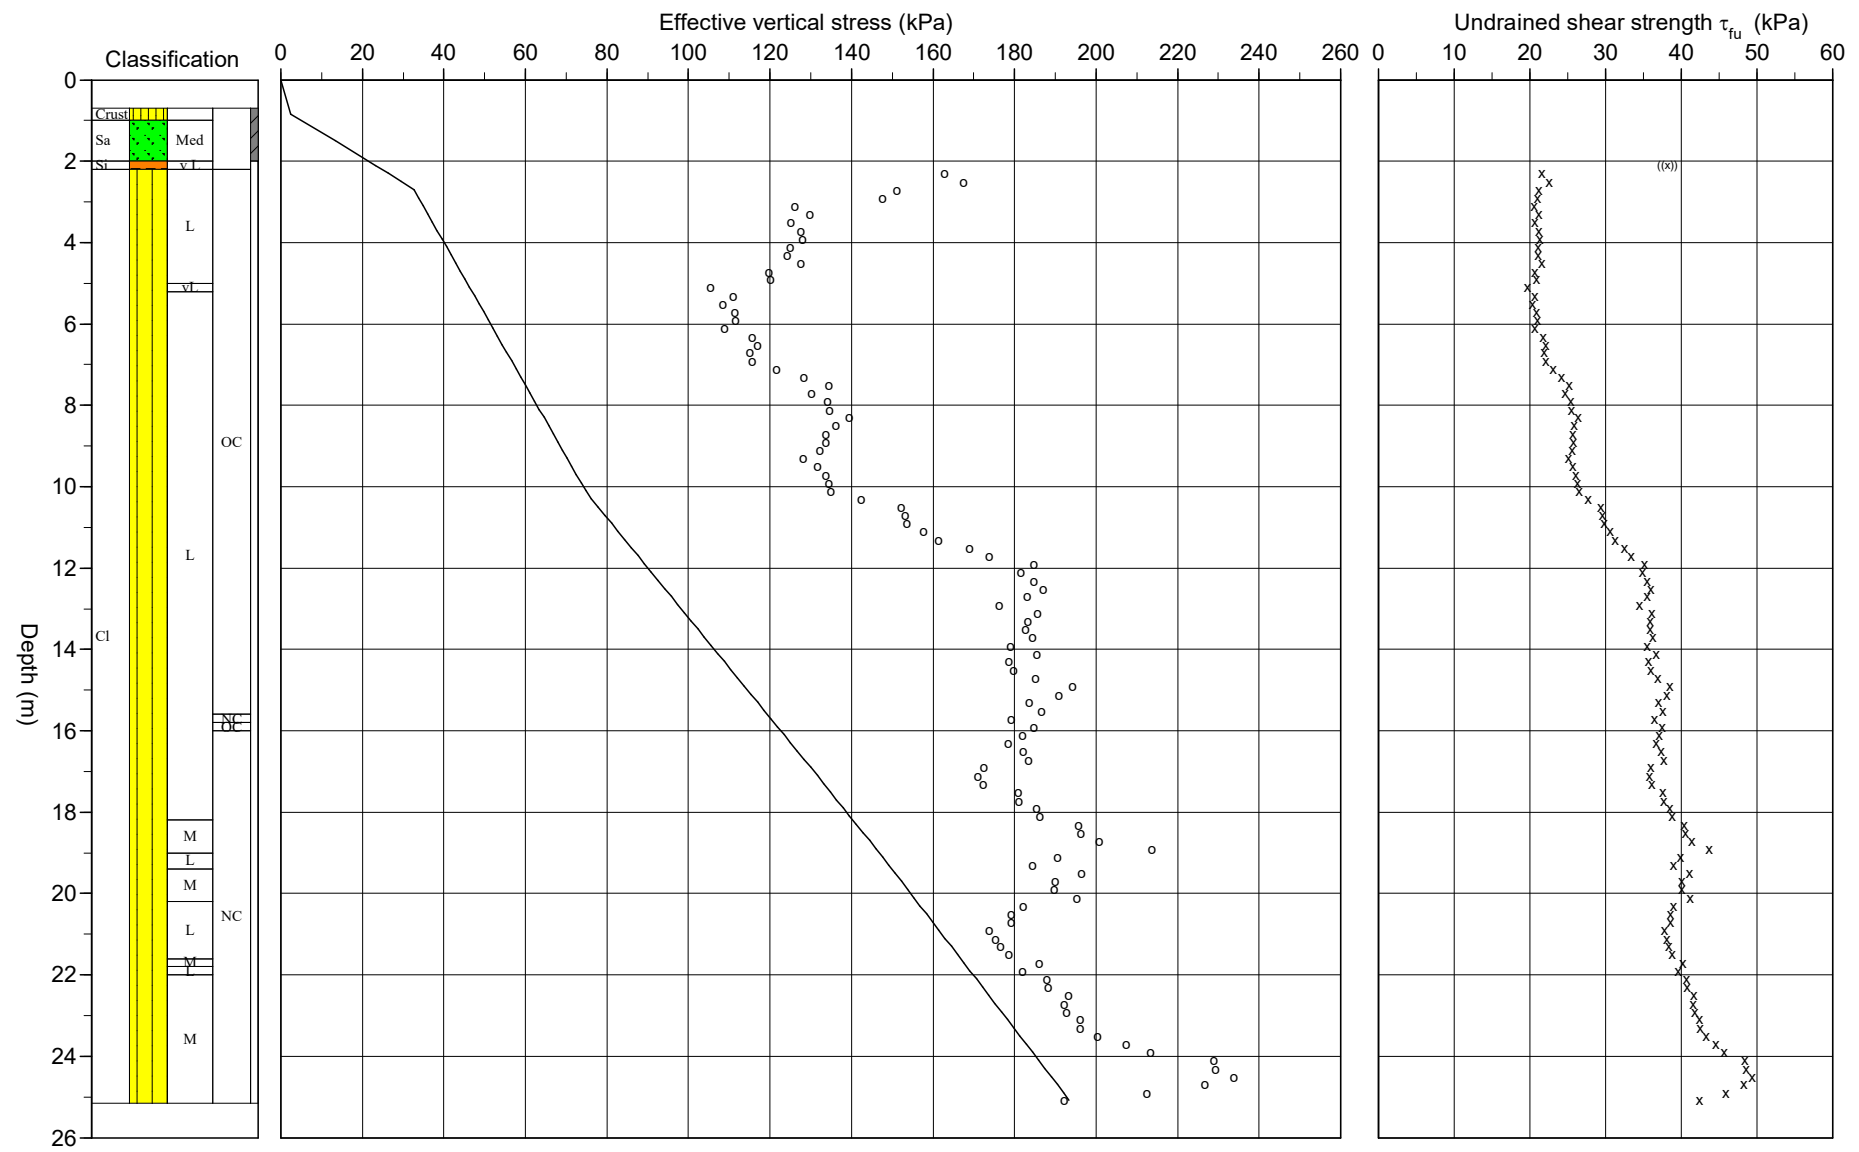

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S001 Date 20220321																																												
Predrilling depth 2.00 m Start depth 2.00 m Stop depth 25.69 m Ground water level 2.70 m Reference my Level at reference 4.30 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																													
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>2.10</td> <td>0.10</td> <td>-0.01</td> </tr> <tr> <td>Diff</td> <td>2.10</td> <td>0.10</td> <td>-0.01</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	2.10	0.10	-0.01	Diff	2.10	0.10	-0.01																											
	Porepressure	Friction	Tip resistance																																											
Before	0.00	0.00	0.00																																											
After	2.10	0.10	-0.01																																											
Diff	2.10	0.10	-0.01																																											
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																										
Porepressure		Friction		Tip resistance																																										
Range	Code	Range	Code	Range	Code																																									
<input type="checkbox"/> Use scale factors																																														
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>2.70</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	2.70	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.70</td> <td>1.00</td> <td>1.70</td> <td>0.50</td> <td>Crust</td> </tr> <tr> <td>1.00</td> <td>2.00</td> <td>1.70</td> <td>0.28</td> <td>Sa Med</td> </tr> <tr> <td>2.00</td> <td>3.00</td> <td></td> <td>0.38</td> <td></td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td></td> <td>0.48</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.48</td> <td></td> </tr> <tr> <td>5.00</td> <td>25.15</td> <td></td> <td>0.53</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.70	1.00	1.70	0.50	Crust	1.00	2.00	1.70	0.28	Sa Med	2.00	3.00		0.38		3.00	4.00		0.48		4.00	5.00		0.48		5.00	25.15		0.53	
Depth (m)	Porepressure (kPa)																																													
2.70	0.00																																													
Depth (m)																																														
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																										
From	To																																													
0.70	1.00	1.70	0.50	Crust																																										
1.00	2.00	1.70	0.28	Sa Med																																										
2.00	3.00		0.38																																											
3.00	4.00		0.48																																											
4.00	5.00		0.48																																											
5.00	25.15		0.53																																											
Notes 																																														


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S001										
				Date 20220321										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.70	1.00	Crust	1.70	0.50			2.5	2.5						
1.00	2.00	Sa Med	1.70	0.28			13.3	13.3						
2.00	2.20	Si v L	1.60	0.38	((38.2))		23.2	23.2			2.6	2.9	2.3	
2.20	2.40	CIL	OC	1.60	0.38	21.6	26.4	26.4	162.9	6.17				
2.40	2.60	CIL	OC	1.60	0.38	22.6	29.5	29.5	167.4	5.67				
2.60	2.80	CIL	OC	1.60	0.38	21.2	32.7	32.6	151.2	4.63				
2.80	3.00	CIL	OC	1.60	0.38	21.0	35.8	33.8	147.7	4.37				
3.00	3.20	CIL	OC	1.60	0.48	20.6	38.9	34.9	126.1	3.61				
3.20	3.40	CIL	OC	1.60	0.48	21.2	42.1	36.1	129.9	3.60				
3.40	3.60	CIL	OC	1.60	0.48	20.7	45.2	37.2	125.2	3.37				
3.60	3.80	CIL	OC	1.60	0.48	21.2	48.4	38.3	127.6	3.33				
3.80	4.00	CIL	OC	1.60	0.48	21.3	51.5	39.5	128.0	3.24				
4.00	4.20	CIL	OC	1.60	0.48	21.1	54.6	40.6	124.9	3.08				
4.20	4.40	CIL	OC	1.60	0.48	21.1	57.8	41.8	124.2	2.97				
4.40	4.60	CIL	OC	1.60	0.48	21.6	60.9	42.9	127.5	2.97				
4.60	4.80	CIL	OC	1.60	0.48	20.7	64.1	44.0	119.8	2.72				
4.80	5.00	CIL	OC	1.60	0.48	20.9	67.2	45.2	120.2	2.66				
5.00	5.20	Ci v L	OC	1.60	0.53	19.7	70.3	46.3	105.4	2.28				
5.20	5.40	CIL	OC	1.60	0.53	20.7	73.5	47.5	111.1	2.34				
5.40	5.60	CIL	OC	1.60	0.53	20.4	76.6	48.6	108.4	2.23				
5.60	5.80	CIL	OC	1.60	0.53	20.9	79.8	49.7	111.5	2.24				
5.80	6.00	CIL	OC	1.60	0.53	21.0	82.9	50.9	111.6	2.19				
6.00	6.20	CIL	OC	1.60	0.53	20.7	86.0	52.0	108.8	2.09				
6.20	6.40	CIL	OC	1.60	0.53	21.8	89.2	53.2	115.6	2.18				
6.40	6.60	CIL	OC	1.60	0.53	22.1	92.3	54.3	117.0	2.15				
6.60	6.80	CIL	OC	1.60	0.53	21.9	95.5	55.4	115.2	2.08				
6.80	7.00	CIL	OC	1.60	0.53	22.1	98.6	56.6	115.8	2.05				
7.00	7.20	CIL	OC	1.60	0.53	23.1	101.7	57.7	121.6	2.11				
7.20	7.40	CIL	OC	1.60	0.53	24.2	104.9	58.8	128.4	2.18				
7.40	7.60	CIL	OC	1.60	0.53	25.2	108.0	60.0	134.4	2.24				
7.60	7.80	CIL	OC	1.60	0.53	24.7	111.1	61.1	130.2	2.13				
7.80	8.00	CIL	OC	1.60	0.53	25.4	114.3	62.3	134.1	2.15				
8.00	8.20	CIL	OC	1.60	0.53	25.5	117.4	63.4	134.6	2.12				
8.20	8.40	CIL	OC	1.60	0.53	26.4	120.6	64.5	139.4	2.16				
8.40	8.60	CIL	OC	1.60	0.53	25.9	123.7	65.7	136.1	2.07				
8.60	8.80	CIL	OC	1.60	0.53	25.7	126.8	66.8	133.7	2.00				
8.80	9.00	CIL	OC	1.60	0.53	25.8	130.0	68.0	133.7	1.97				
9.00	9.20	CIL	OC	1.60	0.53	25.6	133.1	69.1	132.1	1.91				
9.20	9.40	CIL	OC	1.60	0.53	25.1	136.3	70.2	128.1	1.82				
9.40	9.60	CIL	OC	1.60	0.53	25.7	139.4	71.4	131.7	1.85				
9.60	9.80	CIL	OC	1.60	0.53	26.1	142.5	72.5	133.7	1.84				
9.80	10.00	CIL	OC	1.60	0.53	26.3	145.7	73.7	134.5	1.83				
10.00	10.20	CIL	OC	1.60	0.53	26.5	148.8	74.8	135.1	1.81				
10.20	10.40	CIL	OC	1.85	0.53	27.7	152.2	76.2	142.5	1.87				
10.40	10.60	CIL	OC	1.85	0.53	29.4	155.8	77.8	152.3	1.96				
10.60	10.80	CIL	OC	1.85	0.53	29.6	159.5	79.4	153.2	1.93				
10.80	11.00	CIL	OC	1.85	0.53	29.8	163.1	81.1	153.7	1.90				
11.00	11.20	CIL	OC	1.85	0.53	30.6	166.7	82.7	157.6	1.91				
11.20	11.40	CIL	OC	1.85	0.53	31.3	170.4	84.3	161.3	1.91				
11.40	11.60	CIL	OC	1.85	0.53	32.5	174.0	86.0	168.9	1.96				
11.60	11.80	CIL	OC	1.85	0.53	33.4	177.6	87.6	173.8	1.98				
11.80	12.00	CIL	OC	1.85	0.53	35.2	181.2	89.2	184.8	2.07				
12.00	12.20	CIL	OC	1.85	0.53	34.9	184.9	90.8	181.7	2.00				
12.20	12.40	CIL	OC	1.85	0.53	35.5	188.5	92.5	184.8	2.00				
12.40	12.60	CIL	OC	1.85	0.53	36.0	192.1	94.1	187.1	1.99				
12.60	12.80	CIL	OC	1.85	0.53	35.5	195.8	95.7	183.1	1.91				
12.80	13.00	CIL	OC	1.85	0.53	34.5	199.4	97.4	176.2	1.81				
13.00	13.20	CIL	OC	1.85	0.53	36.1	203.0	99.0	185.7	1.88				
13.20	13.40	CIL	OC	1.85	0.53	35.9	206.6	100.6	183.3	1.82				
13.40	13.60	CIL	OC	1.85	0.53	35.9	210.3	102.3	182.7	1.79				
13.60	13.80	CIL	OC	1.85	0.53	36.3	213.9	103.9	184.4	1.77				
13.80	14.00	CIL	OC	1.85	0.53	35.5	217.5	105.5	179.1	1.70				
14.00	14.20	CIL	OC	1.85	0.53	36.7	221.2	107.1	185.5	1.73				
14.20	14.40	CIL	OC	1.85	0.53	35.7	224.8	108.8	178.6	1.64				
14.40	14.60	CIL	OC	1.85	0.53	36.0	228.4	110.4	179.8	1.63				
14.60	14.80	CIL	OC	1.85	0.53	36.9	232.1	112.0	185.2	1.65				
14.80	15.00	CIL	OC	1.85	0.53	38.5	235.7	113.7	194.2	1.71				
15.00	15.20	CIL	OC	1.85	0.53	38.1	239.3	115.3	190.9	1.66				
15.20	15.40	CIL	OC	1.85	0.53	37.0	242.9	116.9	183.6	1.57				
15.40	15.60	CIL	OC	1.85	0.53	37.6	246.6	118.6	186.7	1.57				
15.60	15.80	CIL	OC	1.85	0.53	36.5	250.2	120.2	179.2	1.49				
15.80	16.00	CIL	OC	1.85	0.53	37.5	253.8	121.8	184.8	1.52				
16.00	16.20	CIL	NC	1.85	0.53	37.1	257.5	123.4	181.9	1.47				
16.20	16.40	CIL	NC	1.85	0.53	36.7	261.1	125.1	178.5	1.43				
16.40	16.60	CIL	NC	1.85	0.53	37.4	264.7	126.7	182.1	1.44				
16.60	16.80	CIL	NC	1.85	0.53	37.7	268.4	128.3	183.6	1.43				
16.80	17.00	CIL	NC	1.85	0.53	36.0	272.0	130.0	172.6	1.33				

C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S001										
				Date 20220321										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.00	17.20	CI L	NC	1.85	0.53	35.8		275.6	131.6	171.1	1.30			
17.20	17.40	CI L	NC	1.80	0.53	36.1		279.2	133.2	172.4	1.29			
17.40	17.60	CI L	NC	1.85	0.53	37.6		282.8	134.8	180.9	1.34			
17.60	17.80	CI L	NC	1.80	0.53	37.7		286.4	136.3	181.1	1.33			
17.80	18.00	CI L	NC	1.85	0.53	38.5		289.9	137.9	185.4	1.34			
18.00	18.20	CI L	NC	1.85	0.53	38.8		293.6	139.5	186.3	1.33			
18.20	18.40	CI M	NC	1.85	0.53	40.4		297.2	141.2	195.7	1.39			
18.40	18.60	CI M	NC	1.85	0.53	40.6		300.8	142.8	196.4	1.38			
18.60	18.80	CI M	NC	1.85	0.53	41.4		304.5	144.4	200.7	1.39			
18.80	19.00	CI M	NC	1.85	0.53	43.7		308.1	146.1	213.7	1.46			
19.00	19.20	CI L	NC	1.80	0.53	39.9		311.7	147.6	190.5	1.29			
19.20	19.40	CI L	NC	1.80	0.53	39.0		315.2	149.2	184.5	1.24			
19.40	19.60	CI M	NC	1.80	0.53	41.1		318.7	150.7	196.5	1.30			
19.60	19.80	CI M	NC	1.80	0.53	40.1		322.3	152.2	189.9	1.25			
19.80	20.00	CI M	NC	1.80	0.53	40.1		325.8	153.8	189.8	1.23			
20.00	20.20	CI M	NC	1.80	0.53	41.2		329.3	155.3	195.4	1.26			
20.20	20.40	CI L	NC	1.80	0.53	39.0		332.9	156.8	182.3	1.16			
20.40	20.60	CI L	NC	1.80	0.53	38.6		336.4	158.4	179.3	1.13			
20.60	20.80	CI L	NC	1.80	0.53	38.6		339.9	159.9	179.3	1.12			
20.80	21.00	CI L	NC	1.80	0.53	37.8		343.4	161.4	173.8	1.08			
21.00	21.20	CI L	NC	1.80	0.53	38.1		347.0	163.0	175.4	1.08			
21.20	21.40	CI L	NC	1.80	0.53	38.4		350.5	164.5	176.6	1.07			
21.40	21.60	CI L	NC	1.80	0.53	38.8		354.0	166.0	178.7	1.08			
21.60	21.80	CI M	NC	1.80	0.53	40.2		357.6	167.6	186.0	1.11			
21.80	22.00	CI L	NC	1.80	0.53	39.6		361.1	169.1	182.0	1.08			
22.00	22.20	CI M	NC	1.80	0.53	40.7		364.6	170.6	188.0	1.10			
22.20	22.40	CI M	NC	1.80	0.53	40.8		368.2	172.1	188.4	1.09			
22.40	22.60	CI M	NC	1.80	0.53	41.7		371.7	173.7	193.4	1.11			
22.60	22.80	CI M	NC	1.80	0.53	41.6		375.2	175.2	192.2	1.10			
22.80	23.00	CI M	NC	1.80	0.53	41.8		378.8	176.7	192.7	1.09			
23.00	23.20	CI M	NC	1.80	0.53	42.4		382.3	178.3	196.1	1.10			
23.20	23.40	CI M	NC	1.80	0.53	42.5		385.8	179.8	196.0	1.09			
23.40	23.60	CI M	NC	1.80	0.53	43.3		389.4	181.3	200.3	1.10			
23.60	23.80	CI M	NC	1.80	0.53	44.6		392.9	182.9	207.4	1.13			
23.80	24.00	CI M	NC	1.80	0.53	45.7		396.4	184.4	213.5	1.16			
24.00	24.20	CI M	NC	1.80	0.53	48.4		400.0	185.9	228.9	1.23			
24.20	24.40	CI M	NC	1.80	0.53	48.6		403.5	187.5	229.4	1.22			
24.40	24.60	CI M	NC	1.80	0.53	49.4		407.0	189.0	233.8	1.24			
24.60	24.80	CI M	NC	1.80	0.53	48.3		410.5	190.5	226.7	1.19			
24.80	25.00	CI M	NC	1.80	0.53	45.9		414.1	192.1	212.5	1.11			
25.00	25.15	CI M	NC	1.80	0.53	42.4		417.2	193.4	192.2	1.00			


CPT-test performed according to EN ISO 22476-1

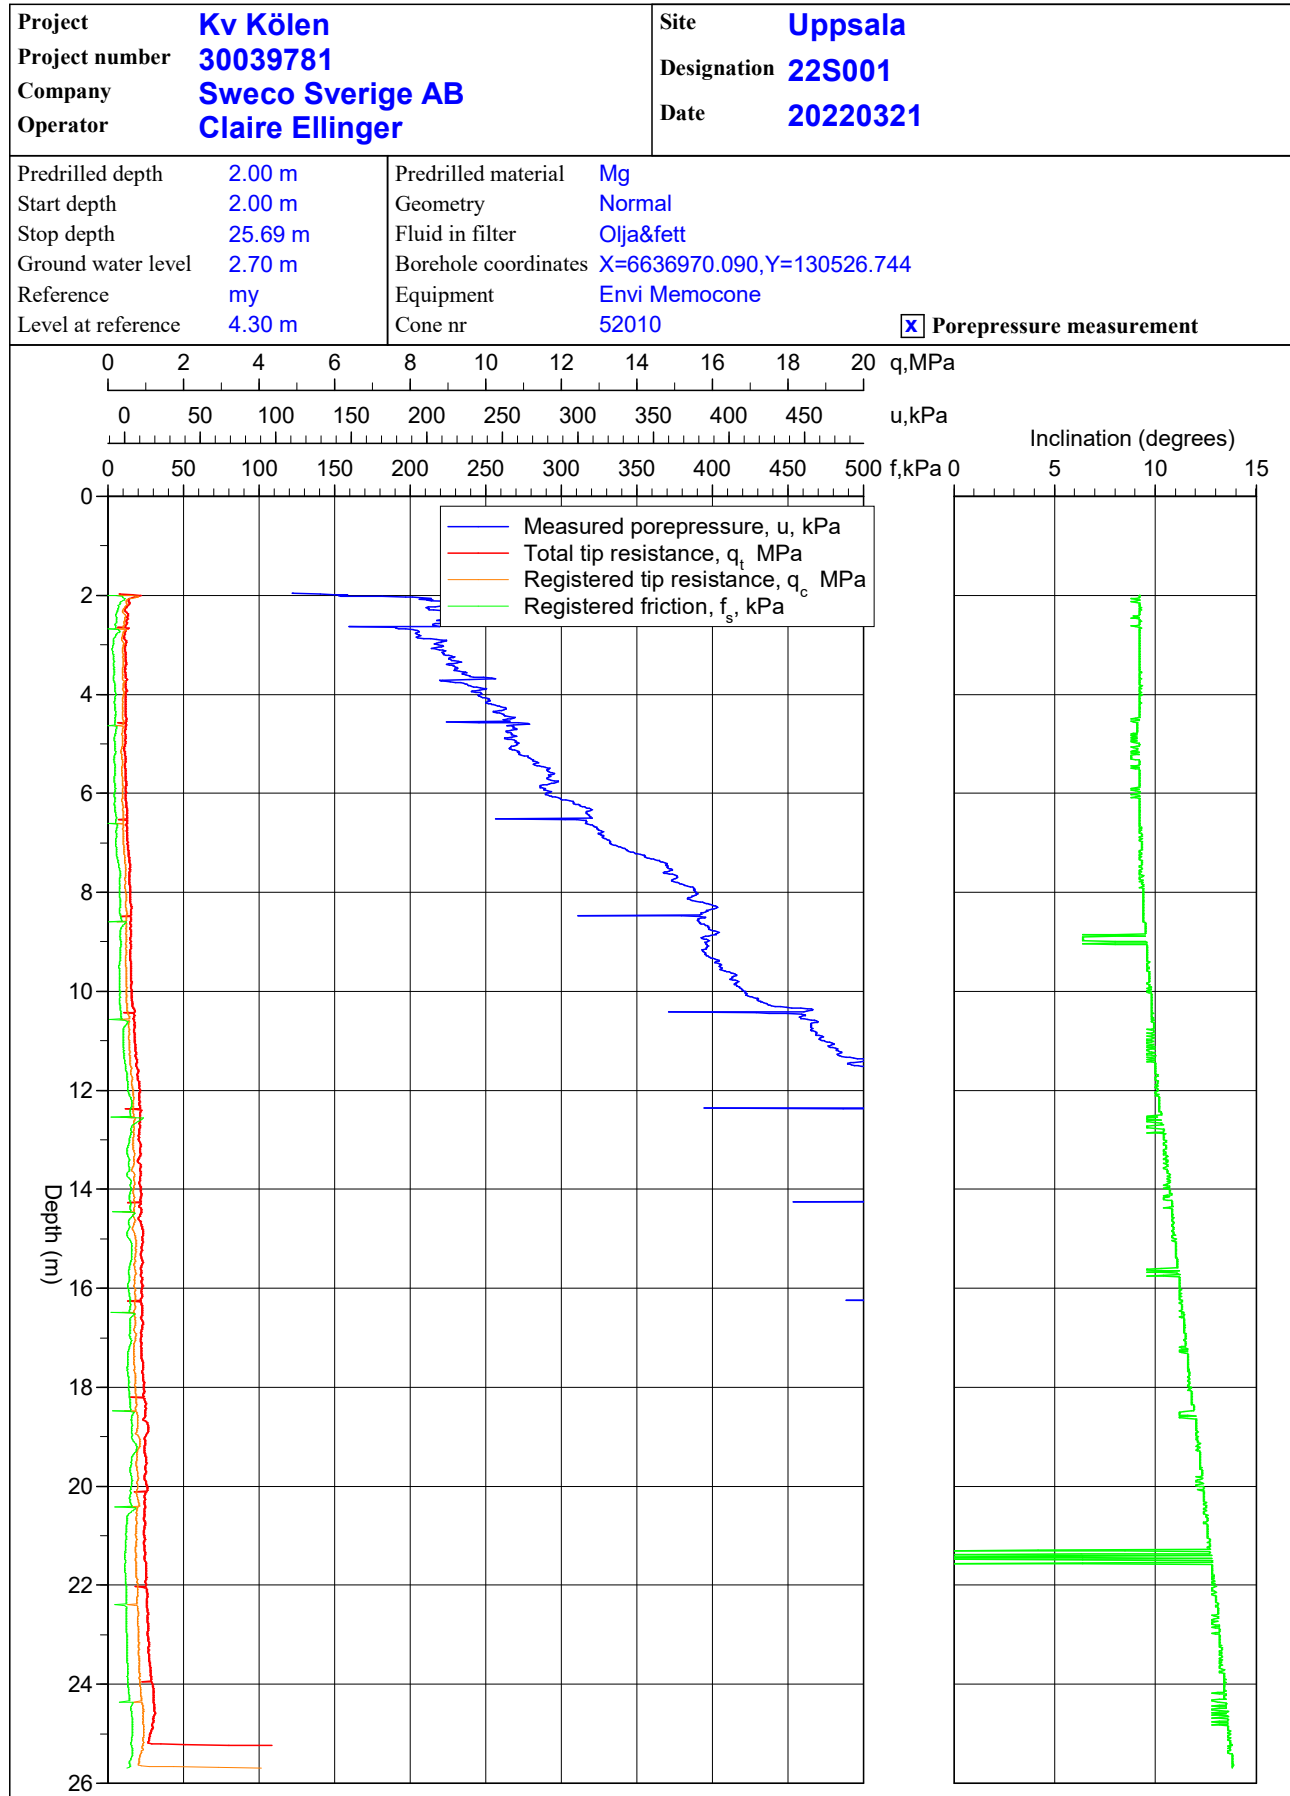

CPT-test performed according to EN ISO 22476-1

Predrilling depth	3.00 m	Reference	MY	Fluid in filter	Olja&fett
Start depth	3.00 m	Level at reference	3.81 m	Coordinates	X=6637033.978,Y=1305933.450
Stop depth	28.59 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	2.21 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S002
Date	20220323

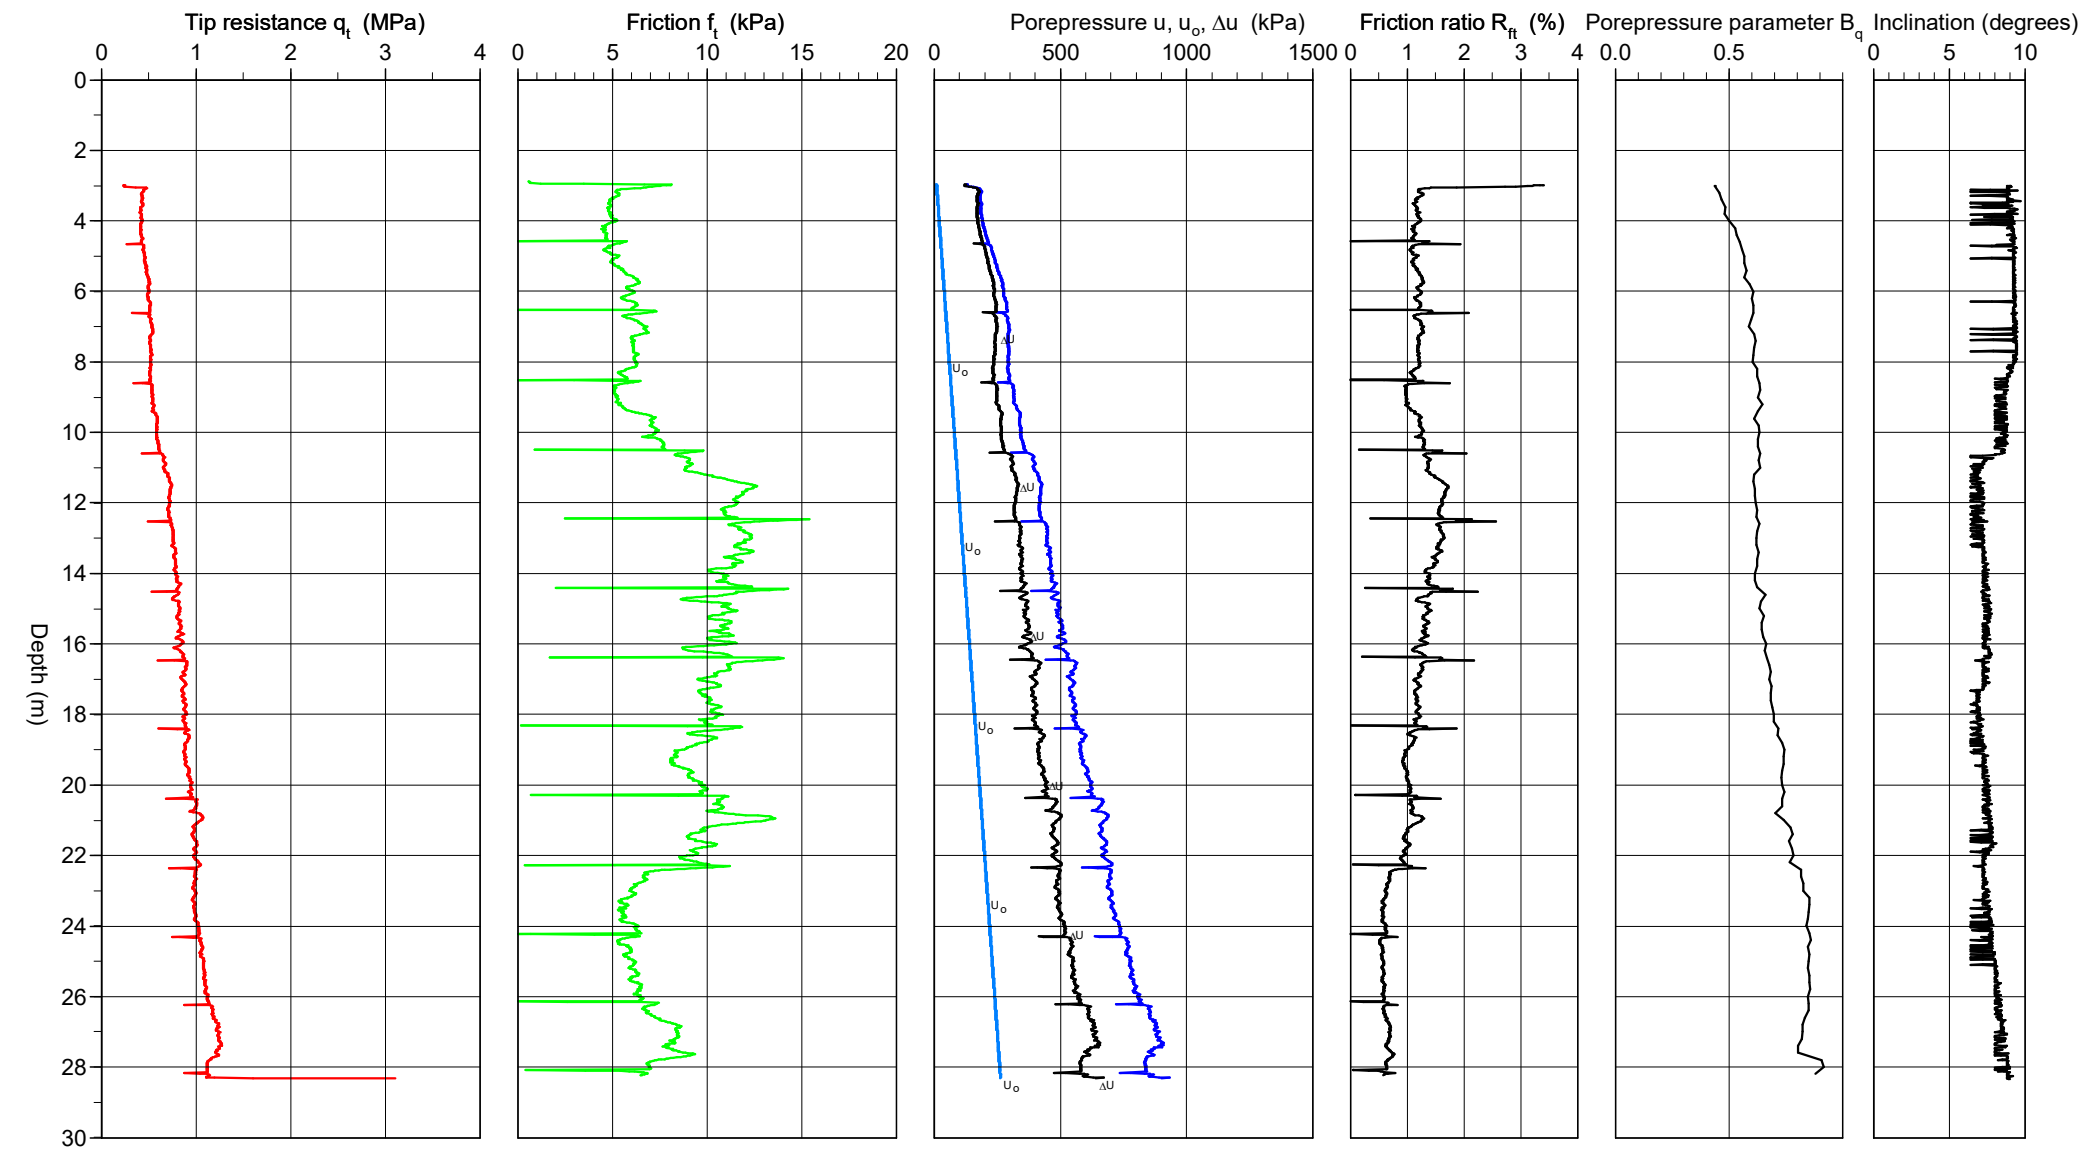

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S002
 Date 20220323


Reference MY Predrilling depth 3.00 m Evaluator INPRAG
 Level at reference 3.81 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 2.21 m Equipment Envi Memocone
 Start depth 3.00 m Geometry Normal

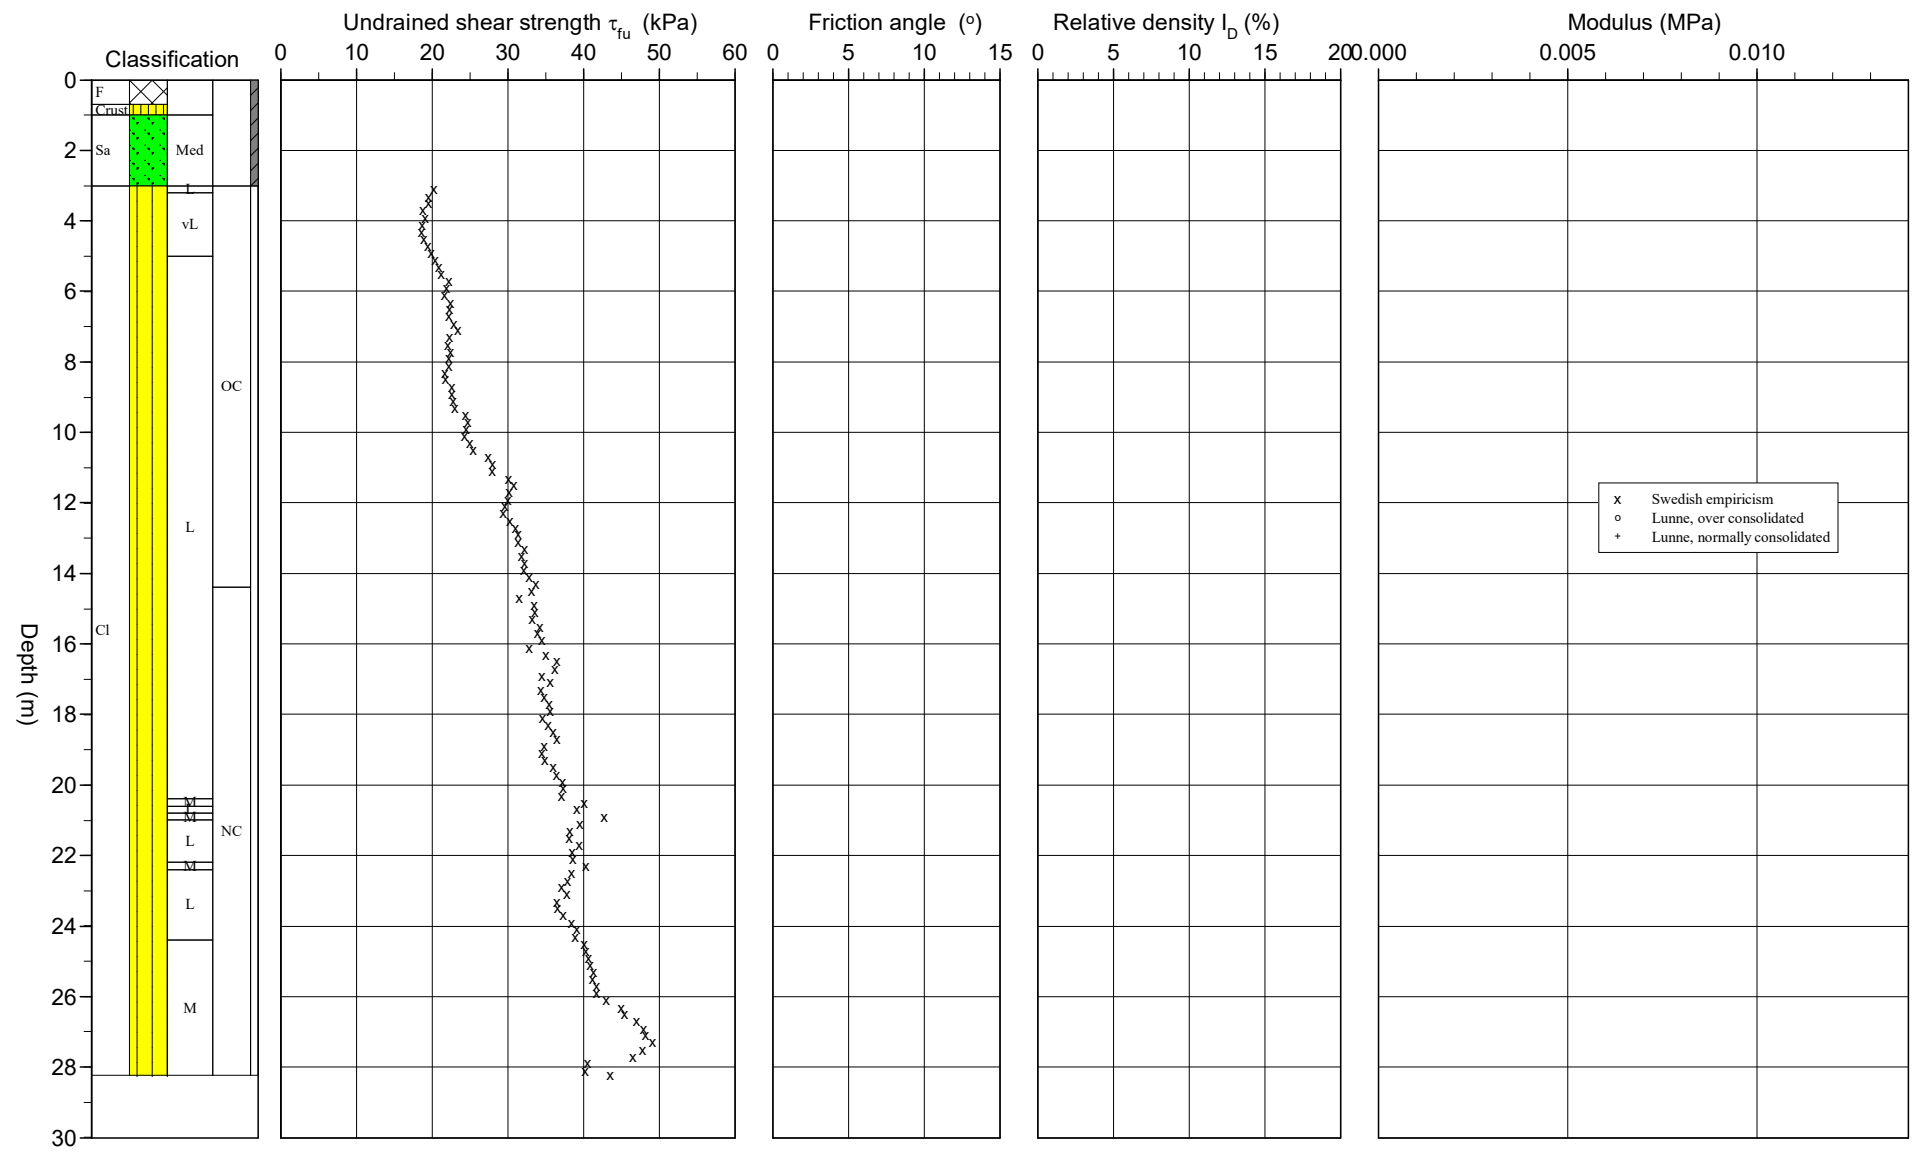

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	MY	Predrilling depth	3.00 m	Evaluator	INPRAG
Ground water level	3.81 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	2.21 m	Equipment	Envi Memocone		
Start depth	3.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S002
Date	20220323

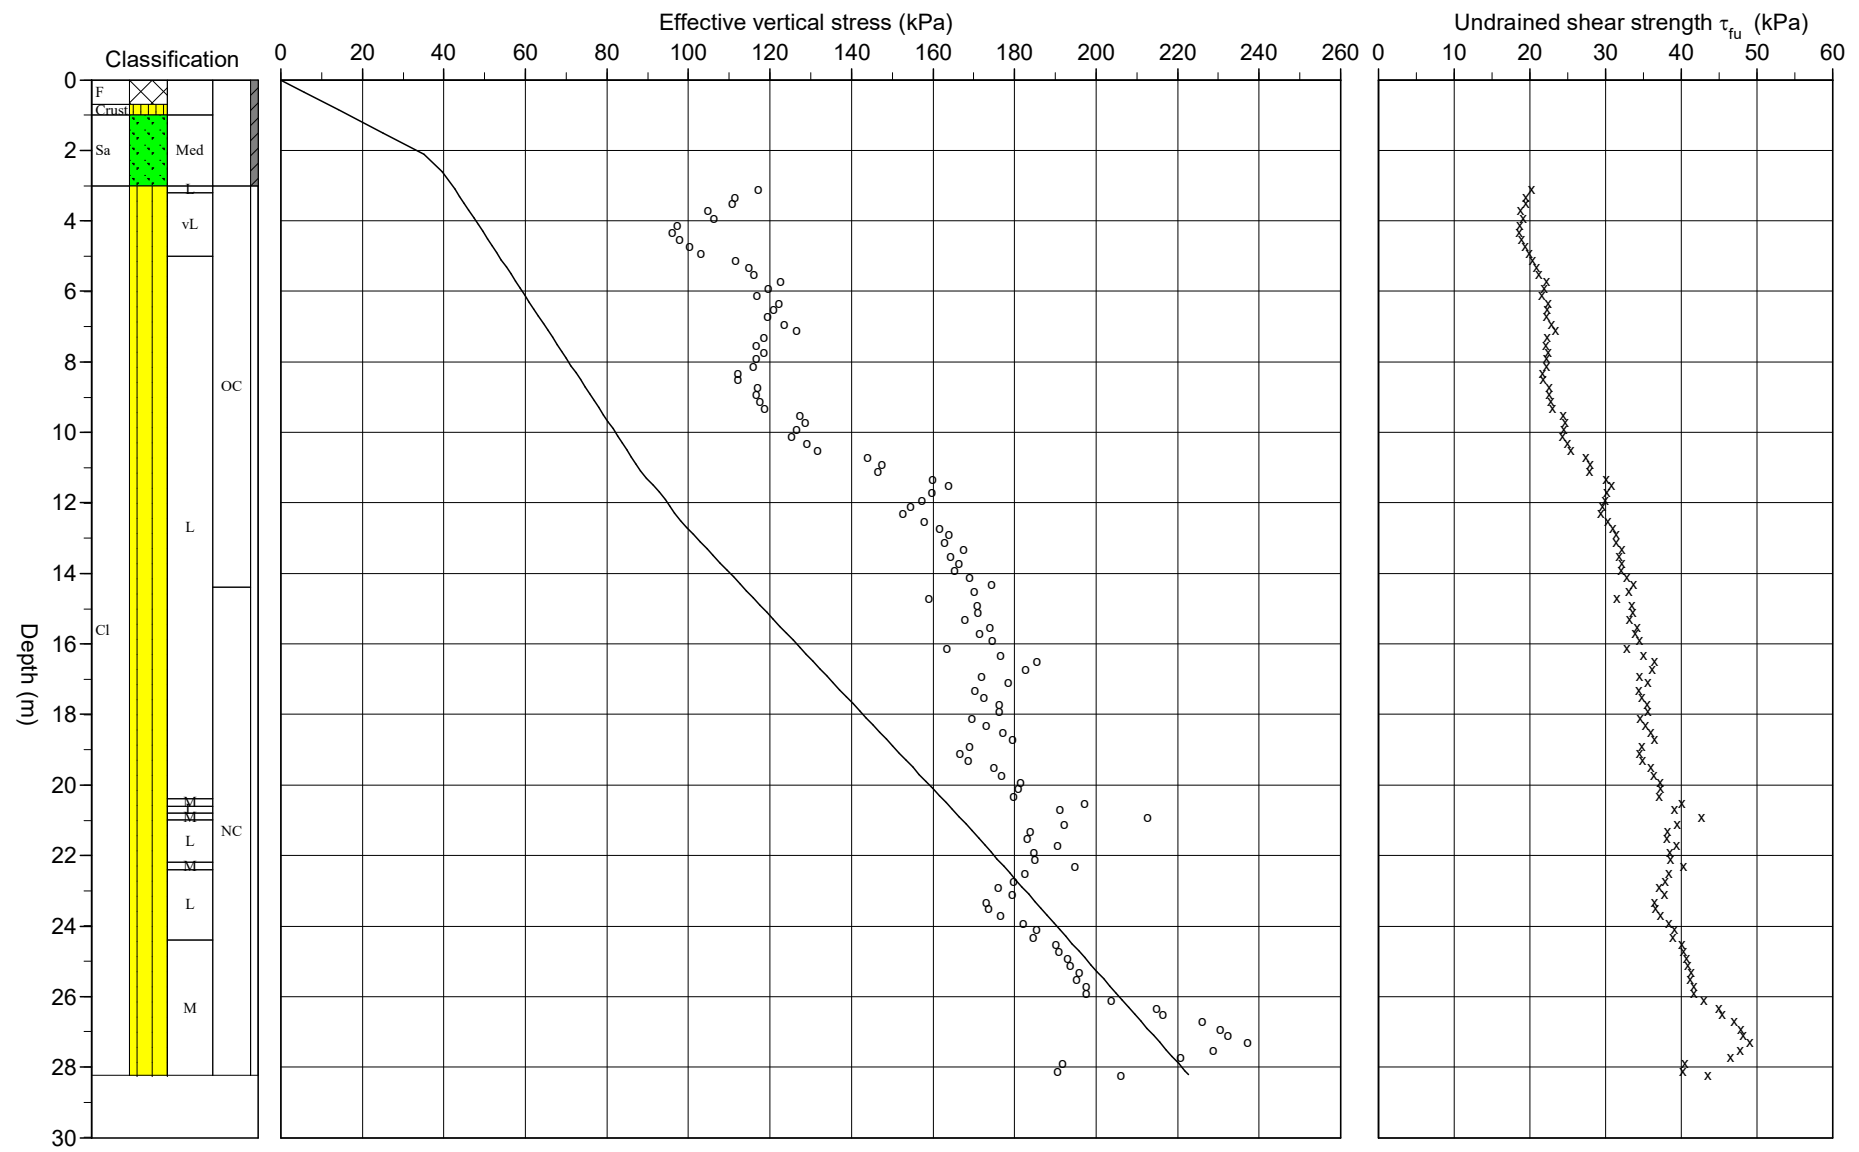

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S002 Date 20220323																																																	
Predrilling depth 3.00 m Start depth 3.00 m Stop depth 28.59 m Ground water level 2.21 m Reference MY Level at reference 3.81 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																																		
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>0.10</td> <td>0.10</td> <td>-0.16</td> </tr> <tr> <td>Diff</td> <td>0.10</td> <td>0.10</td> <td>-0.16</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	0.10	0.10	-0.16	Diff	0.10	0.10	-0.16																																
	Porepressure	Friction	Tip resistance																																																
Before	0.00	0.00	0.00																																																
After	0.10	0.10	-0.16																																																
Diff	0.10	0.10	-0.16																																																
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																															
Porepressure		Friction		Tip resistance																																															
Range	Code	Range	Code	Range	Code																																														
<input type="checkbox"/> Use scale factors																																																			
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>2.21</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	2.21	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td></td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>1.00</td> <td>1.70</td> <td>0.50</td> <td>Crust</td> </tr> <tr> <td>1.00</td> <td>2.00</td> <td>1.70</td> <td>0.28</td> <td>Sa Med</td> </tr> <tr> <td>2.00</td> <td>3.00</td> <td>1.70</td> <td>0.38</td> <td>Sa Med</td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td></td> <td>0.48</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.53</td> <td></td> </tr> <tr> <td>5.00</td> <td>28.24</td> <td></td> <td>0.48</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.00	0.70	1.70		F	0.70	1.00	1.70	0.50	Crust	1.00	2.00	1.70	0.28	Sa Med	2.00	3.00	1.70	0.38	Sa Med	3.00	4.00		0.48		4.00	5.00		0.53		5.00	28.24		0.48	
Depth (m)	Porepressure (kPa)																																																		
2.21	0.00																																																		
Depth (m)																																																			
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																															
From	To																																																		
0.00	0.70	1.70		F																																															
0.70	1.00	1.70	0.50	Crust																																															
1.00	2.00	1.70	0.28	Sa Med																																															
2.00	3.00	1.70	0.38	Sa Med																																															
3.00	4.00		0.48																																																
4.00	5.00		0.53																																																
5.00	28.24		0.48																																																
Notes 																																																			


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S002										
				Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.00	Crust	1.70	0.50			14.2	14.2						
1.00	2.00	Sa Med	1.70	0.28			25.0	25.0						
2.00	2.21	Sa Med	1.70	0.38			35.1	35.1						
2.21	3.00	Sa Med	1.70	0.38			43.5	39.5						
3.00	3.20	CI L	OC	1.60	0.48	20.2	51.6	42.7	117.2	2.74				
3.20	3.40	CI vL	OC	1.60	0.48	19.5	54.7	43.9	111.4	2.54				
3.40	3.60	CI vL	OC	1.60	0.48	19.5	57.9	45.0	110.7	2.46				
3.60	3.80	CI vL	OC	1.60	0.48	18.8	61.0	46.1	104.8	2.27				
3.80	4.00	CI vL	OC	1.60	0.48	19.1	64.2	47.3	106.3	2.25				
4.00	4.20	CI vL	OC	1.60	0.53	18.7	67.3	48.4	97.2	2.01				
4.20	4.40	CI vL	OC	1.60	0.53	18.6	70.4	49.6	96.1	1.94				
4.40	4.60	CI vL	OC	1.60	0.53	18.9	73.6	50.7	97.8	1.93				
4.60	4.80	CI vL	OC	1.60	0.53	19.4	76.7	51.8	100.3	1.93				
4.80	5.00	CI vL	OC	1.60	0.53	19.9	79.9	53.0	103.0	1.95				
5.00	5.20	CI L	OC	1.60	0.48	20.4	83.0	54.1	111.6	2.06				
5.20	5.40	CI L	OC	1.60	0.48	20.9	86.1	55.3	114.7	2.08				
5.40	5.60	CI L	OC	1.60	0.48	21.2	89.3	56.4	116.1	2.06				
5.60	5.80	CI L	OC	1.60	0.48	22.2	92.4	57.5	122.6	2.13				
5.80	6.00	CI L	OC	1.60	0.48	21.9	95.5	58.7	119.6	2.04				
6.00	6.20	CI L	OC	1.60	0.48	21.6	98.7	59.8	116.7	1.95				
6.20	6.40	CI L	OC	1.60	0.48	22.4	101.8	60.9	122.3	2.01				
6.40	6.60	CI L	OC	1.60	0.48	22.3	105.0	62.1	120.9	1.95				
6.60	6.80	CI L	OC	1.60	0.48	22.2	108.1	63.2	119.4	1.89				
6.80	7.00	CI L	OC	1.60	0.48	22.9	111.2	64.4	123.5	1.92				
7.00	7.20	CI L	OC	1.60	0.48	23.4	114.4	65.5	126.4	1.93				
7.20	7.40	CI L	OC	1.60	0.48	22.3	117.5	66.6	118.5	1.78				
7.40	7.60	CI L	OC	1.60	0.48	22.1	120.7	67.8	116.7	1.72				
7.60	7.80	CI L	OC	1.60	0.48	22.4	123.8	68.9	118.5	1.72				
7.80	8.00	CI L	OC	1.60	0.48	22.2	126.9	70.1	116.6	1.66				
8.00	8.20	CI L	OC	1.60	0.48	22.2	130.1	71.2	115.9	1.63				
8.20	8.40	CI L	OC	1.60	0.48	21.7	133.2	72.3	112.1	1.55				
8.40	8.60	CI L	OC	1.60	0.48	21.8	136.4	73.5	112.2	1.53				
8.60	8.80	CI L	OC	1.60	0.48	22.6	139.5	74.6	117.0	1.57				
8.80	9.00	CI L	OC	1.60	0.48	22.6	142.6	75.8	116.6	1.54				
9.00	9.20	CI L	OC	1.60	0.48	22.8	145.8	76.9	117.6	1.53				
9.20	9.40	CI L	OC	1.60	0.48	23.0	148.9	78.0	118.8	1.52				
9.40	9.60	CI L	OC	1.60	0.48	24.4	152.1	79.2	127.4	1.61				
9.60	9.80	CI L	OC	1.60	0.48	24.7	155.2	80.3	128.8	1.60				
9.80	10.00	CI L	OC	1.60	0.48	24.5	158.3	81.5	126.6	1.55				
10.00	10.20	CI L	OC	1.60	0.48	24.3	161.5	82.6	125.4	1.52				
10.20	10.40	CI L	OC	1.60	0.48	25.0	164.6	83.7	129.1	1.54				
10.40	10.60	CI L	OC	1.60	0.48	25.4	167.8	84.9	131.7	1.55				
10.60	10.80	CI L	OC	1.60	0.48	27.4	170.9	86.0	144.0	1.67				
10.80	11.00	CI L	OC	1.60	0.48	28.0	174.0	87.1	147.4	1.69				
11.00	11.20	CI L	OC	1.60	0.48	27.9	177.2	88.3	146.5	1.66				
11.20	11.40	CI L	OC	1.85	0.48	30.1	180.6	89.7	160.0	1.78				
11.40	11.60	CI L	OC	1.85	0.48	30.8	184.2	91.3	163.8	1.79				
11.60	11.80	CI L	OC	1.85	0.48	30.2	187.8	92.9	159.7	1.72				
11.80	12.00	CI L	OC	1.60	0.48	30.0	191.2	94.3	157.3	1.67				
12.00	12.20	CI L	OC	1.60	0.48	29.6	194.3	95.5	154.4	1.62				
12.20	12.40	CI L	OC	1.60	0.48	29.4	197.5	96.6	152.6	1.58				
12.40	12.60	CI L	OC	1.85	0.48	30.3	200.9	98.0	157.8	1.61				
12.60	12.80	CI L	OC	1.85	0.48	31.0	204.5	99.6	161.6	1.62				
12.80	13.00	CI L	OC	1.85	0.48	31.4	208.1	101.2	164.1	1.62				
13.00	13.20	CI L	OC	1.85	0.48	31.4	211.7	102.9	162.9	1.58				
13.20	13.40	CI L	OC	1.85	0.48	32.2	215.4	104.5	167.5	1.60				
13.40	13.60	CI L	OC	1.85	0.48	31.8	219.0	106.1	164.3	1.55				
13.60	13.80	CI L	OC	1.85	0.48	32.2	222.6	107.8	166.4	1.54				
13.80	14.00	CI L	OC	1.85	0.48	32.1	226.3	109.4	165.3	1.51				
14.00	14.20	CI L	OC	1.85	0.48	32.8	229.9	111.0	169.0	1.52				
14.20	14.40	CI L	OC	1.85	0.48	33.7	233.5	112.6	174.4	1.55				
14.40	14.60	CI L	NC	1.85	0.48	33.1	237.2	114.3	170.0	1.49				
14.60	14.80	CI L	NC	1.85	0.48	31.5	240.8	115.9	159.0	1.37				
14.80	15.00	CI L	NC	1.85	0.48	33.5	244.4	117.5	170.9	1.45				
15.00	15.20	CI L	NC	1.85	0.48	33.6	248.0	119.2	171.1	1.44				
15.20	15.40	CI L	NC	1.85	0.48	33.2	251.7	120.8	167.9	1.39				
15.40	15.60	CI L	NC	1.85	0.48	34.2	255.3	122.4	174.0	1.42				
15.60	15.80	CI L	NC	1.85	0.48	33.9	258.9	124.1	171.5	1.38				
15.80	16.00	CI L	NC	1.85	0.48	34.5	262.6	125.7	174.5	1.39				
16.00	16.20	CI L	NC	1.85	0.48	32.8	266.2	127.3	163.4	1.28				
16.20	16.40	CI L	NC	1.85	0.48	35.0	269.8	128.9	176.7	1.37				
16.40	16.60	CI L	NC	1.85	0.48	36.5	273.5	130.6	185.6	1.42				
16.60	16.80	CI L	NC	1.85	0.48	36.2	277.1	132.2	182.8	1.38				
16.80	17.00	CI L	NC	1.85	0.48	34.5	280.7	133.8	172.0	1.29				
17.00	17.20	CI L	NC	1.85	0.48	35.6	284.3	135.5	178.4	1.32				
17.20	17.40	CI L	NC	1.85	0.48	34.4	288.0	137.1	170.3	1.24				

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S002 Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.40	17.60	CIL	NC	1.85	0.48	34.8		291.6	138.7	172.5	1.24			
17.60	17.80	CIL	NC	1.85	0.48	35.5		295.2	140.4	176.3	1.26			
17.80	18.00	CIL	NC	1.85	0.48	35.6		298.9	142.0	176.3	1.24			
18.00	18.20	CIL	NC	1.85	0.48	34.6		302.5	143.6	169.5	1.18			
18.20	18.40	CIL	NC	1.85	0.48	35.3		306.1	145.2	173.1	1.19			
18.40	18.60	CIL	NC	1.85	0.48	36.0		309.8	146.9	177.2	1.21			
18.60	18.80	CIL	NC	1.85	0.48	36.5		313.4	148.5	179.5	1.21			
18.80	19.00	CIL	NC	1.85	0.48	34.8		317.0	150.1	169.0	1.13			
19.00	19.20	CIL	NC	1.85	0.48	34.5		320.6	151.8	166.5	1.10			
19.20	19.40	CIL	NC	1.85	0.48	34.9		324.3	153.4	168.5	1.10			
19.40	19.60	CIL	NC	1.85	0.48	36.0		327.9	155.0	174.9	1.13			
19.60	19.80	CIL	NC	1.85	0.48	36.4		331.5	156.6	176.8	1.13			
19.80	20.00	CIL	NC	1.85	0.48	37.2		335.2	158.3	181.4	1.15			
20.00	20.20	CIL	NC	1.85	0.48	37.3		338.8	159.9	181.0	1.13			
20.20	20.40	CIL	NC	1.85	0.48	37.1		342.4	161.5	179.8	1.11			
20.40	20.60	CIM	NC	1.85	0.48	40.1		346.0	163.2	197.3	1.21			
20.60	20.80	CIL	NC	1.85	0.48	39.1		349.7	164.8	191.1	1.16			
20.80	21.00	CIM	NC	1.85	0.48	42.7		353.3	166.4	212.6	1.28			
21.00	21.20	CIL	NC	1.85	0.48	39.5		356.9	168.1	192.3	1.14			
21.20	21.40	CIL	NC	1.80	0.48	38.2		360.5	169.6	183.8	1.08			
21.40	21.60	CIL	NC	1.80	0.48	38.1		364.0	171.2	183.1	1.07			
21.60	21.80	CIL	NC	1.80	0.48	39.4		367.6	172.7	190.5	1.10			
21.80	22.00	CIL	NC	1.80	0.48	38.5		371.1	174.2	184.7	1.06			
22.00	22.20	CIL	NC	1.80	0.48	38.6		374.6	175.8	184.9	1.05			
22.20	22.40	CIM	NC	1.80	0.48	40.3		378.2	177.3	194.7	1.10			
22.40	22.60	CIL	NC	1.80	0.48	38.4		381.7	178.8	182.6	1.02			
22.60	22.80	CIL	NC	1.80	0.48	37.9		385.2	180.4	179.8	1.00			
22.80	23.00	CIL	NC	1.80	0.48	37.1		388.8	181.9	176.0	1.00			
23.00	23.20	CIL	NC	1.80	0.48	37.8		392.3	183.4	179.3	1.00			
23.20	23.40	CIL	NC	1.80	0.48	36.5		395.8	185.0	173.0	1.00			
23.40	23.60	CIL	NC	1.80	0.48	36.6		399.4	186.5	173.6	1.00			
23.60	23.80	CIL	NC	1.80	0.48	37.3		402.9	188.0	176.7	1.00			
23.80	24.00	CIL	NC	1.80	0.48	38.4		406.4	189.5	182.2	1.00			
24.00	24.20	CIL	NC	1.80	0.48	39.1		410.0	191.1	185.3	1.00			
24.20	24.40	CIL	NC	1.80	0.48	38.9		413.5	192.6	184.5	1.00			
24.40	24.60	CIM	NC	1.80	0.48	40.1		417.0	194.1	190.2	1.00			
24.60	24.80	CIM	NC	1.80	0.48	40.3		420.6	195.7	191.0	1.00			
24.80	25.00	CIM	NC	1.80	0.48	40.7		424.1	197.2	193.0	1.00			
25.00	25.20	CIM	NC	1.80	0.48	40.9		427.6	198.7	193.7	1.00			
25.20	25.40	CIM	NC	1.80	0.48	41.3		431.1	200.3	195.9	1.00			
25.40	25.60	CIM	NC	1.80	0.48	41.2		434.7	201.8	195.1	1.00			
25.60	25.80	CIM	NC	1.80	0.48	41.7		438.2	203.3	197.6	1.00			
25.80	26.00	CIM	NC	1.80	0.48	41.7		441.7	204.9	197.5	1.00			
26.00	26.20	CIM	NC	1.80	0.48	43.0		445.3	206.4	203.8	1.00			
26.20	26.40	CIM	NC	1.80	0.48	45.0		448.8	207.9	214.8	1.03			
26.40	26.60	CIM	NC	1.80	0.48	45.4		452.3	209.5	216.4	1.03			
26.60	26.80	CIM	NC	1.80	0.48	47.0		455.9	211.0	226.0	1.07			
26.80	27.00	CIM	NC	1.80	0.48	47.9		459.4	212.5	230.5	1.08			
27.00	27.20	CIM	NC	1.80	0.48	48.2		462.9	214.1	232.3	1.09			
27.20	27.40	CIM	NC	1.80	0.48	49.1		466.5	215.6	237.1	1.10			
27.40	27.60	CIM	NC	1.80	0.48	47.8		470.0	217.1	228.7	1.05			
27.60	27.80	CIM	NC	1.80	0.48	46.5		473.5	218.6	220.9	1.01			
27.80	28.00	CIM	NC	1.80	0.48	40.5		477.1	220.2	191.9	1.00			
28.00	28.20	CIM	NC	1.80	0.48	40.2		480.6	221.7	190.5	1.00			
28.20	28.24	CIM	NC	1.80	0.48	43.5		482.7	222.6	206.1	1.00			


CPT-test performed according to EN ISO 22476-1

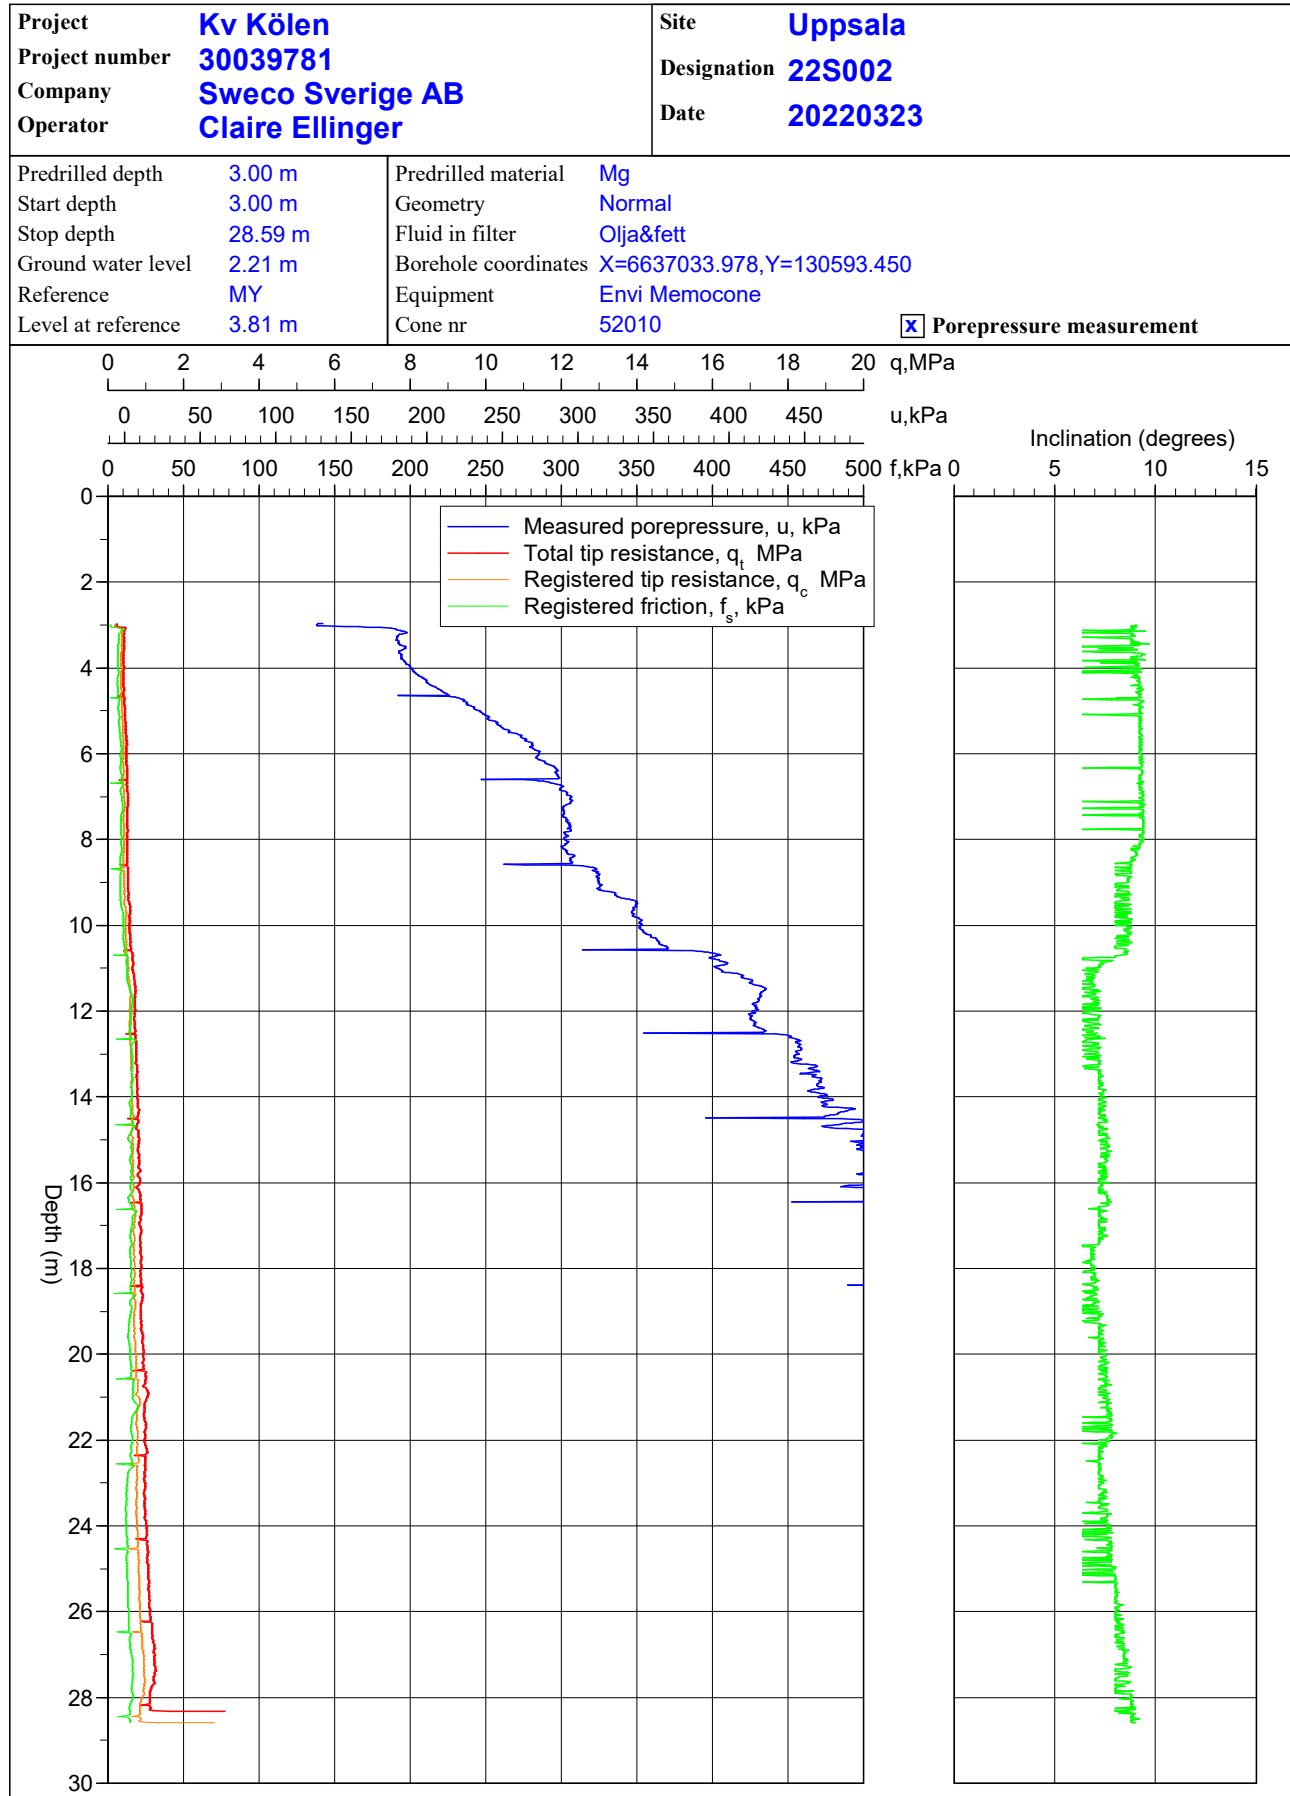

CPT-test performed according to EN ISO 22476-1

Predrilling depth	3.00 m	Reference	my	Fluid in filter	Olja&fett
Start depth	3.00 m	Level at reference	3.87 m	Coordinates	x=6637078.978,y=130688.687
Stop depth	25.82 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	2.27 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S003
Date	20220323

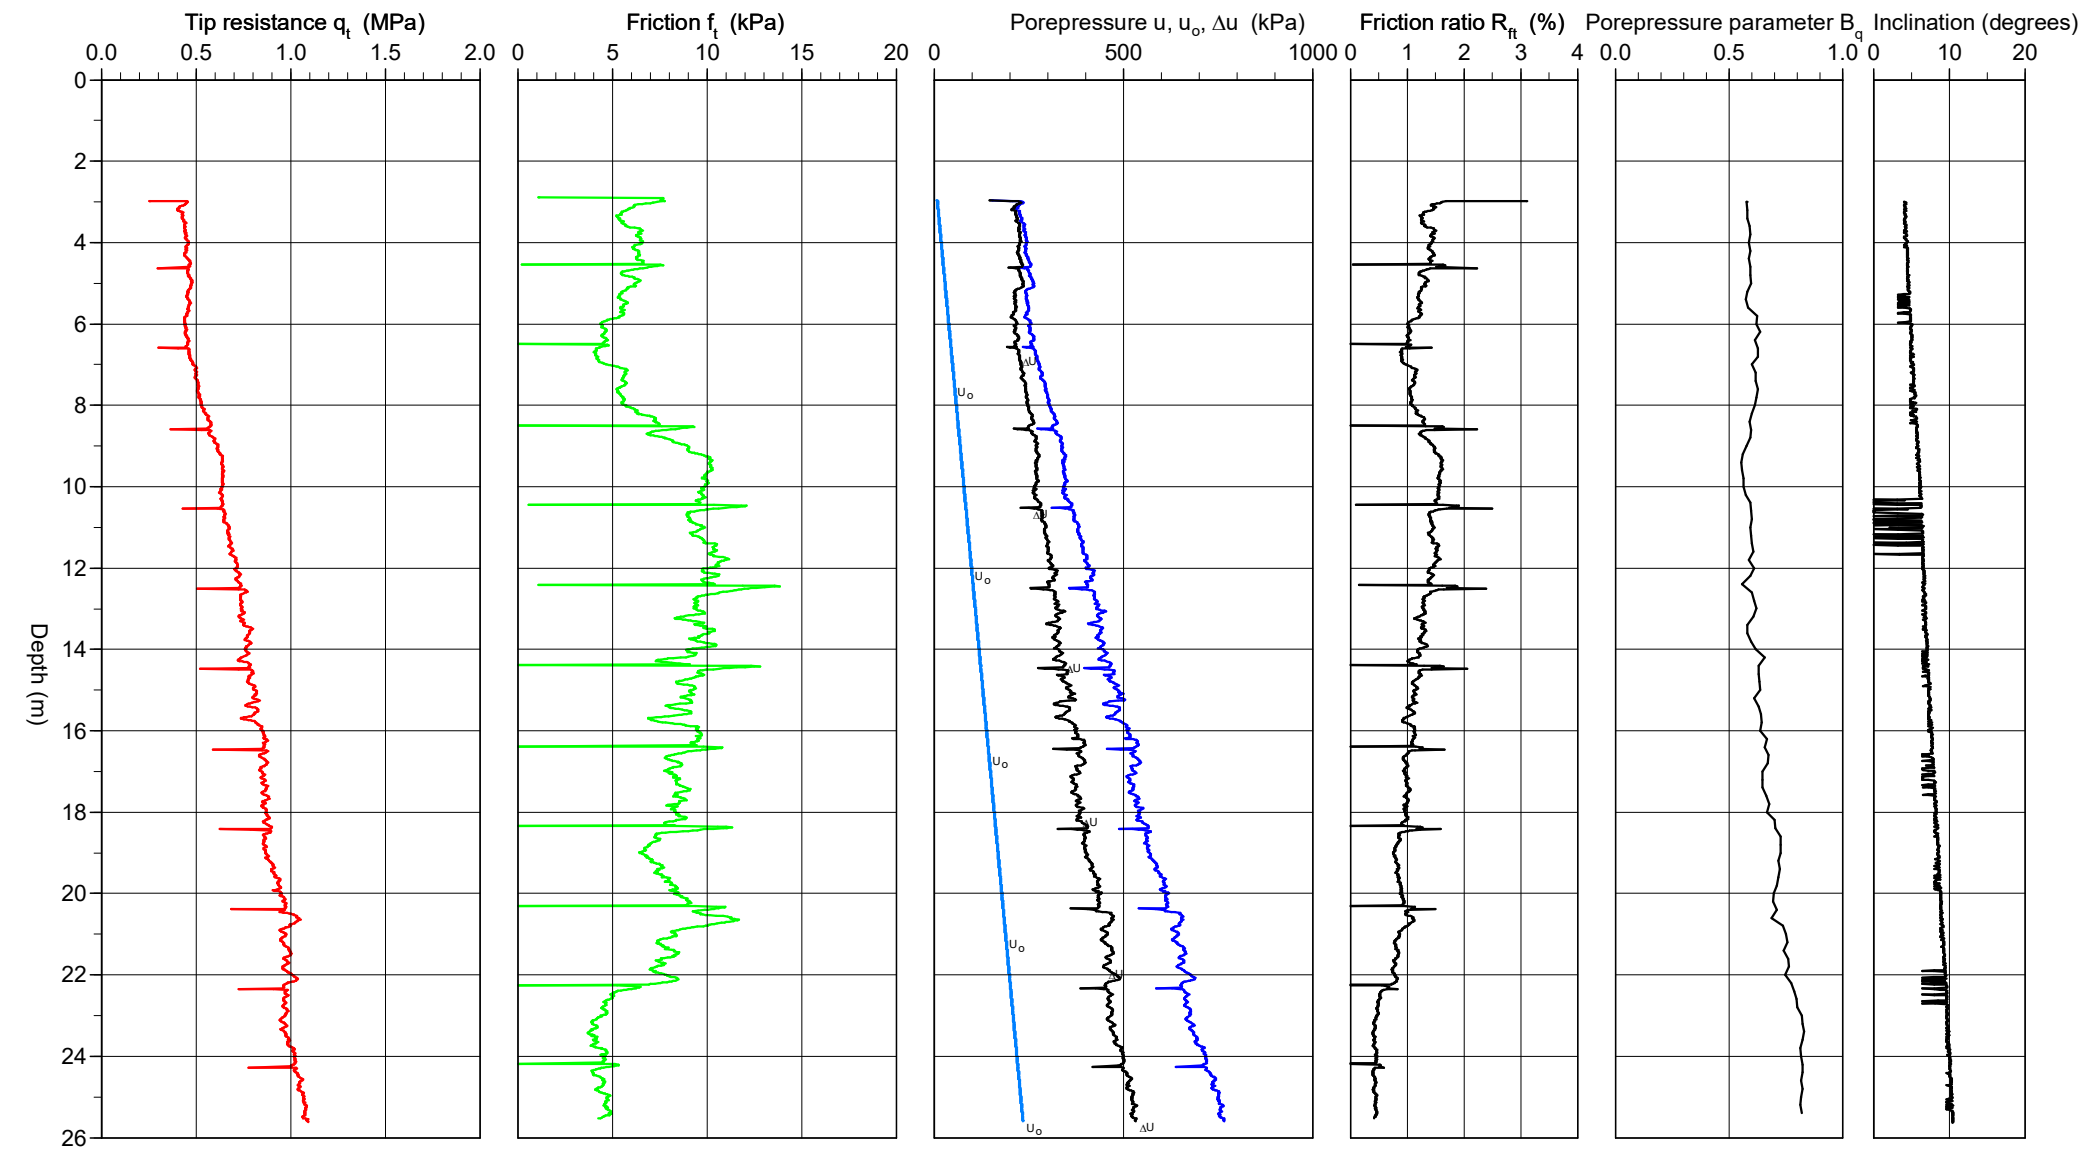

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S003
 Date 20220323


Reference my Predrilling depth 3.00 m Evaluator INPRAG
 Level at reference 3.87 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 2.27 m Equipment Envi Memocone
 Start depth 3.00 m Geometry Normal

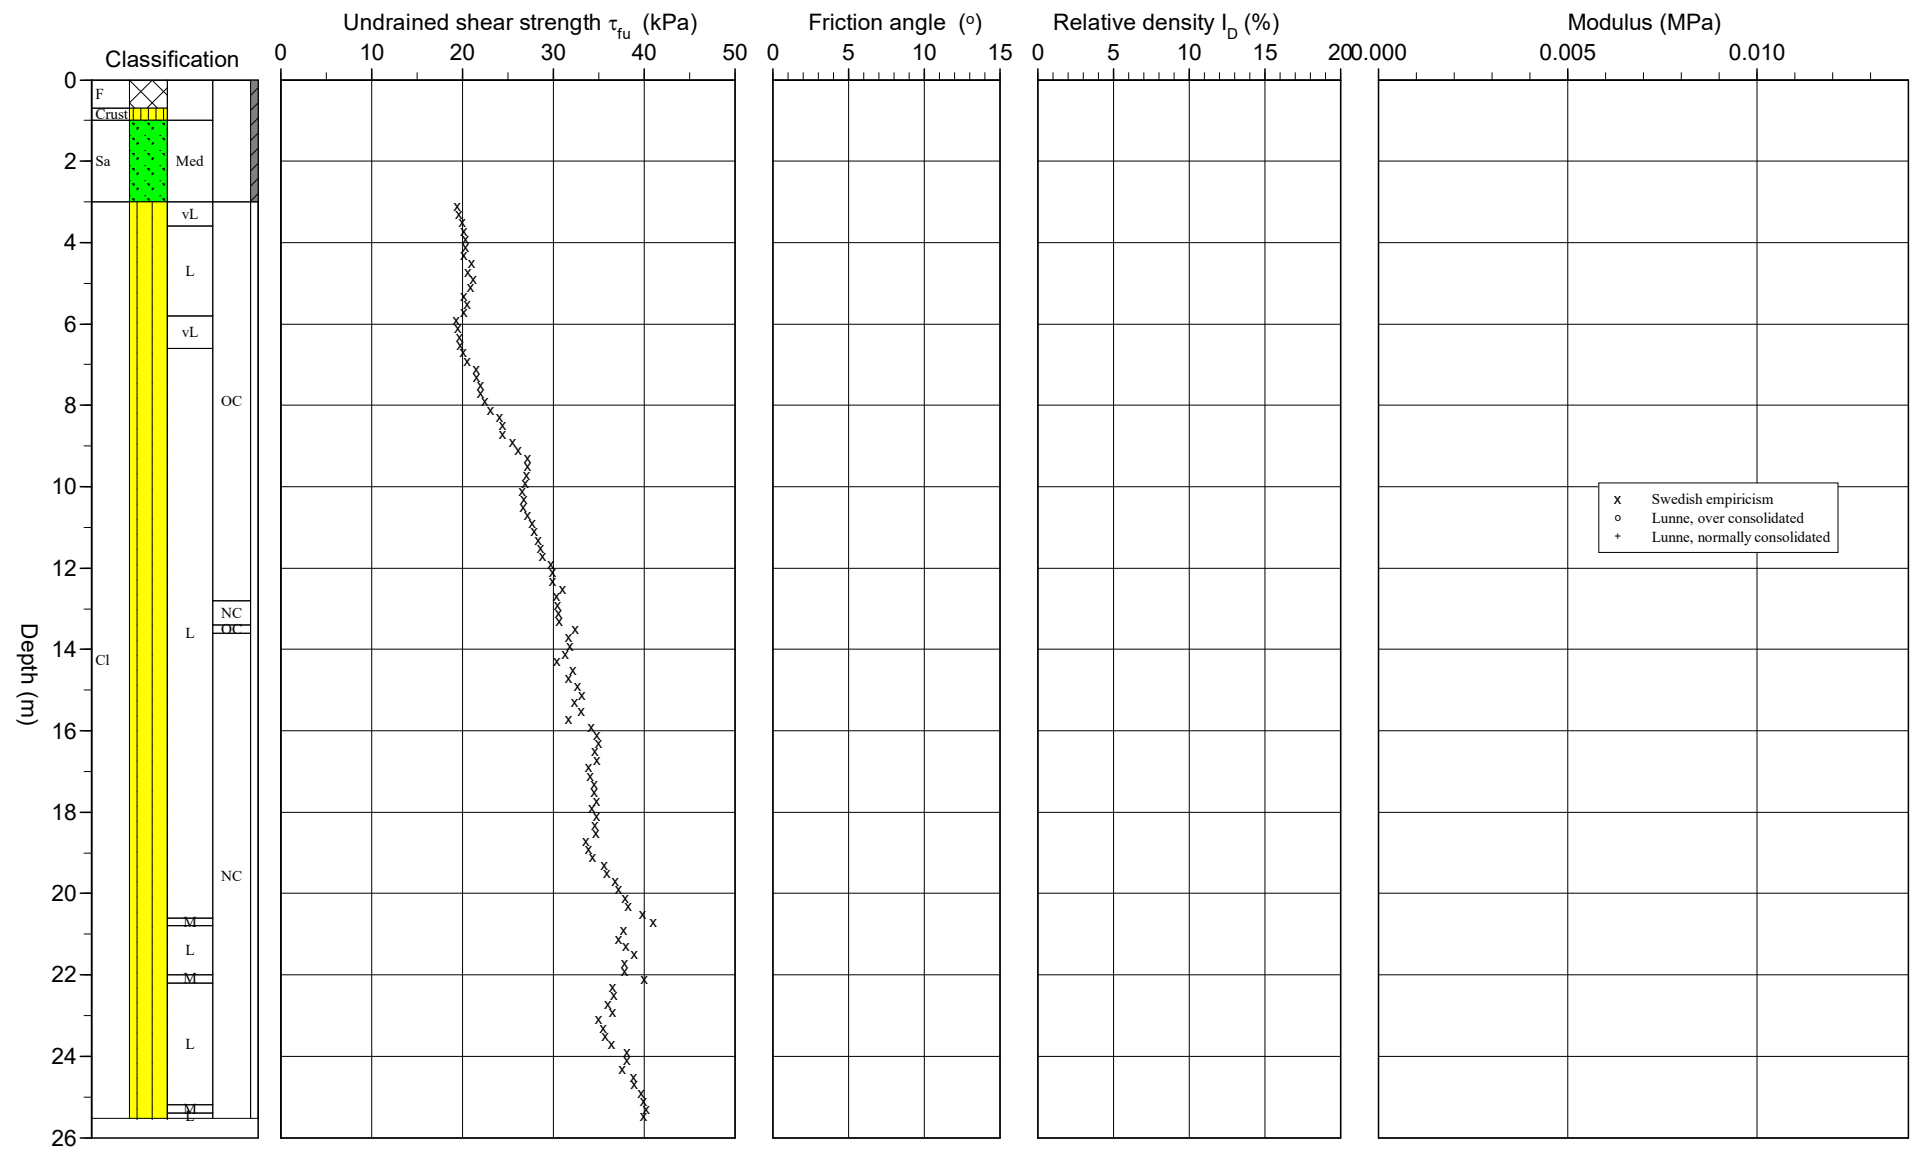

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	my	Predrilling depth	3.00 m	Evaluator	INPRAG
Ground water level	3.87 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	2.27 m	Equipment	Envi Memocone		
Start depth	3.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S003
Date	20220323

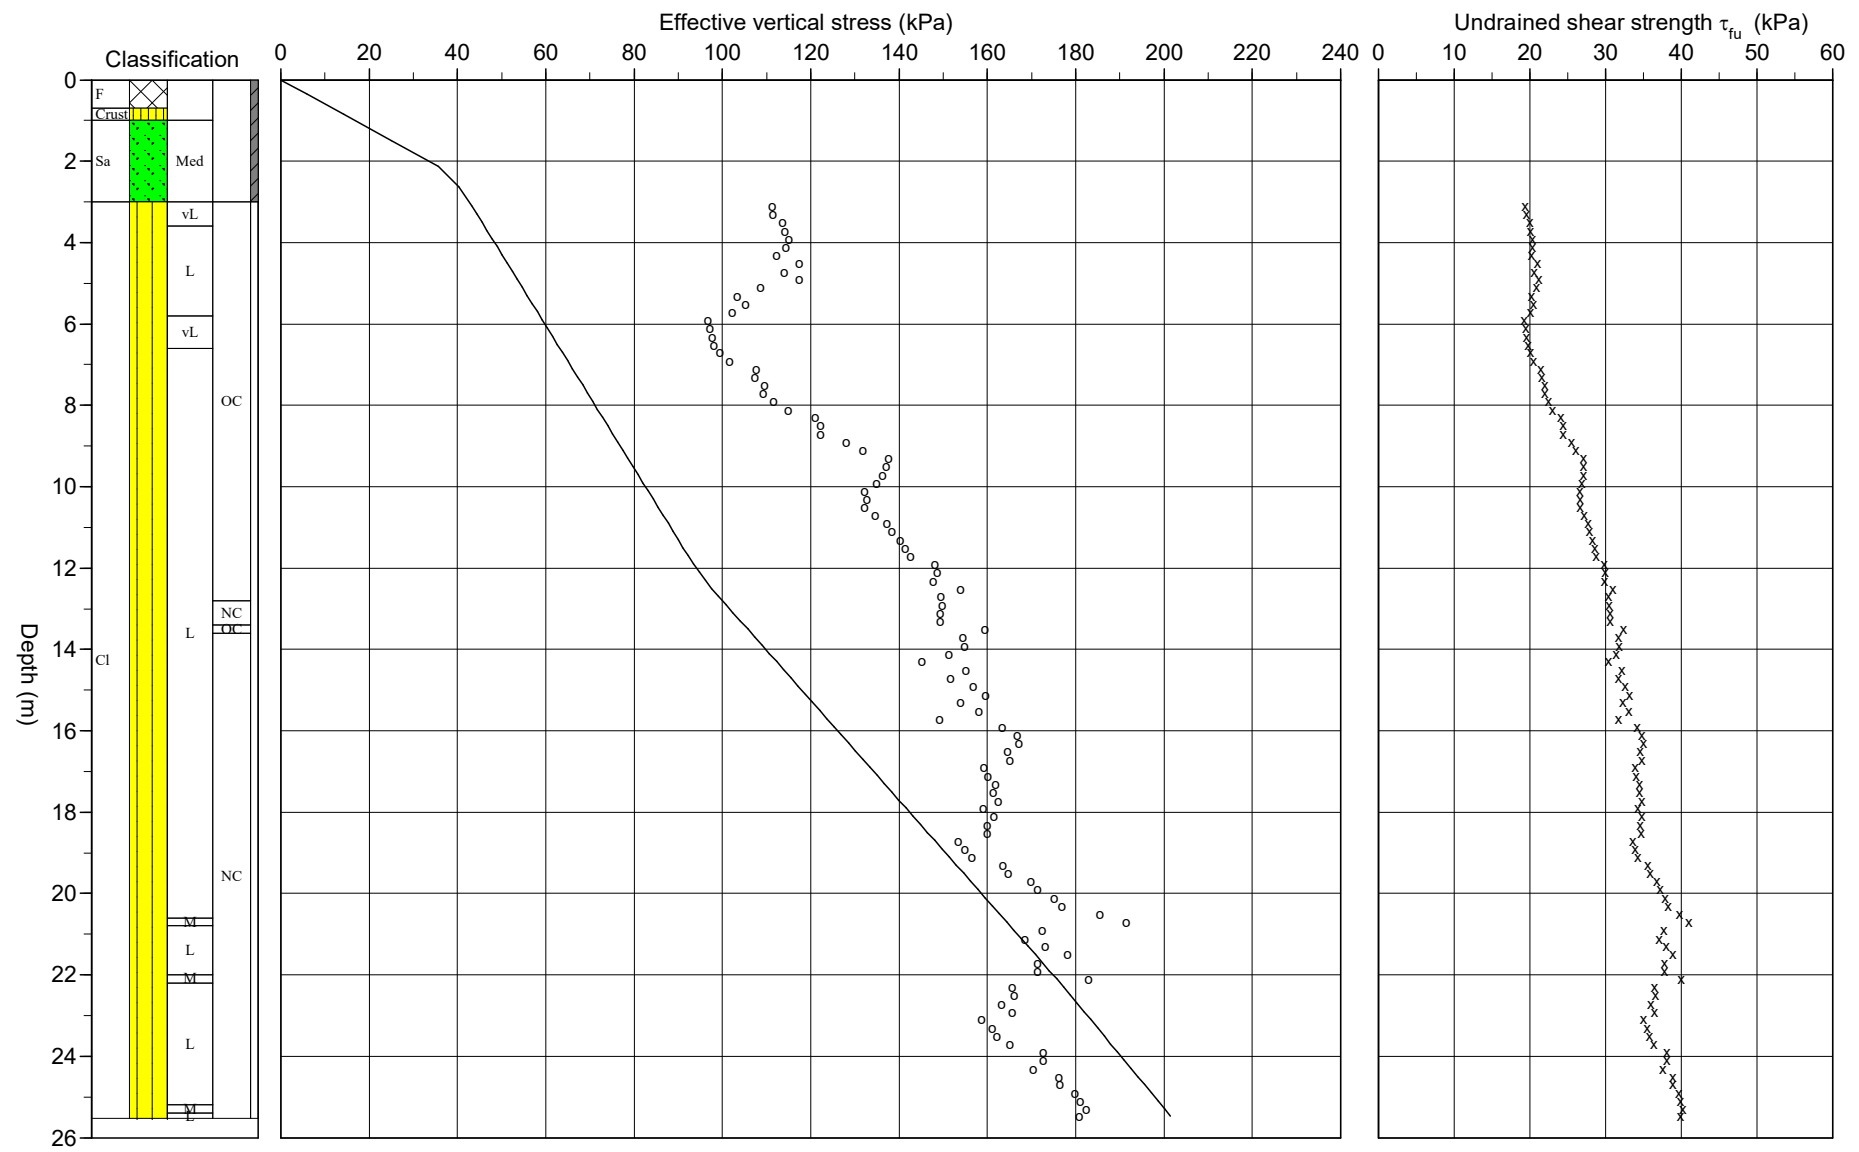

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S003 Date 20220323																																																	
Predrilling depth 3.00 m Start depth 3.00 m Stop depth 25.82 m Ground water level 2.27 m Reference my Level at reference 3.87 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																																		
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>-7.40</td> <td>0.20</td> <td>0.03</td> </tr> <tr> <td>Diff</td> <td>-7.40</td> <td>0.20</td> <td>0.03</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	-7.40	0.20	0.03	Diff	-7.40	0.20	0.03																																
	Porepressure	Friction	Tip resistance																																																
Before	0.00	0.00	0.00																																																
After	-7.40	0.20	0.03																																																
Diff	-7.40	0.20	0.03																																																
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																															
Porepressure		Friction		Tip resistance																																															
Range	Code	Range	Code	Range	Code																																														
<input type="checkbox"/> Use scale factors																																																			
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>2.27</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	2.27	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>1.00</td> <td>1.70</td> <td>0.50</td> <td>Crust</td> </tr> <tr> <td>1.00</td> <td>2.00</td> <td>1.70</td> <td>0.28</td> <td>Sa Med</td> </tr> <tr> <td>2.00</td> <td>3.00</td> <td>1.70</td> <td>0.38</td> <td>Sa Med</td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td></td> <td>0.48</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.48</td> <td></td> </tr> <tr> <td>5.00</td> <td>25.53</td> <td></td> <td>0.53</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.00	0.70	1.70		F	0.70	1.00	1.70	0.50	Crust	1.00	2.00	1.70	0.28	Sa Med	2.00	3.00	1.70	0.38	Sa Med	3.00	4.00		0.48		4.00	5.00		0.48		5.00	25.53		0.53	
Depth (m)	Porepressure (kPa)																																																		
2.27	0.00																																																		
Depth (m)																																																			
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																															
From	To																																																		
0.00	0.70	1.70		F																																															
0.70	1.00	1.70	0.50	Crust																																															
1.00	2.00	1.70	0.28	Sa Med																																															
2.00	3.00	1.70	0.38	Sa Med																																															
3.00	4.00		0.48																																																
4.00	5.00		0.48																																																
5.00	25.53		0.53																																																
Notes 																																																			


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S003										
				Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.00	Crust	1.70	0.50			14.2	14.2						
1.00	2.00	Sa Med	1.70	0.28			25.0	25.0						
2.00	2.27	Sa Med	1.70	0.38			35.6	35.6						
2.27	3.00	Sa Med	1.70	0.38			43.9	40.2						
3.00	3.20	Cl vL	OC	1.60	0.48	19.4	51.6	43.3	111.3	2.57				
3.20	3.40	Cl vL	OC	1.60	0.48	19.6	54.7	44.4	111.4	2.51				
3.40	3.60	Cl vL	OC	1.60	0.48	20.0	57.9	45.5	113.6	2.49				
3.60	3.80	Cl L	OC	1.60	0.48	20.1	61.0	46.7	114.1	2.44				
3.80	4.00	Cl L	OC	1.60	0.48	20.4	64.2	47.8	115.0	2.40				
4.00	4.20	Cl L	OC	1.60	0.48	20.4	67.3	49.0	114.4	2.34				
4.20	4.40	Cl L	OC	1.60	0.48	20.2	70.4	50.1	112.3	2.24				
4.40	4.60	Cl L	OC	1.60	0.48	21.0	73.6	51.2	117.4	2.29				
4.60	4.80	Cl L	OC	1.60	0.48	20.6	76.7	52.4	114.0	2.18				
4.80	5.00	Cl L	OC	1.60	0.48	21.2	79.9	53.5	117.5	2.20				
5.00	5.20	Cl L	OC	1.60	0.53	20.9	83.0	54.7	108.8	1.99				
5.20	5.40	Cl L	OC	1.60	0.53	20.2	86.1	55.8	103.4	1.85				
5.40	5.60	Cl L	OC	1.60	0.53	20.5	89.3	56.9	105.3	1.85				
5.60	5.80	Cl L	OC	1.60	0.53	20.1	92.4	58.1	102.2	1.76				
5.80	6.00	Cl vL	OC	1.60	0.53	19.3	95.5	59.2	96.6	1.63				
6.00	6.20	Cl vL	OC	1.60	0.53	19.5	98.7	60.3	97.2	1.61				
6.20	6.40	Cl vL	OC	1.60	0.53	19.6	101.8	61.5	97.7	1.59				
6.40	6.60	Cl vL	OC	1.60	0.53	19.8	105.0	62.6	98.0	1.57				
6.60	6.80	Cl L	OC	1.60	0.53	20.1	108.1	63.8	99.5	1.56				
6.80	7.00	Cl L	OC	1.60	0.53	20.5	111.2	64.9	101.7	1.57				
7.00	7.20	Cl L	OC	1.60	0.53	21.5	114.4	66.0	107.6	1.63				
7.20	7.40	Cl L	OC	1.60	0.53	21.6	117.5	67.2	107.3	1.60				
7.40	7.60	Cl L	OC	1.60	0.53	22.0	120.7	68.3	109.5	1.60				
7.60	7.80	Cl L	OC	1.60	0.53	22.0	123.8	69.5	109.2	1.57				
7.80	8.00	Cl L	OC	1.60	0.53	22.5	126.9	70.6	111.6	1.58				
8.00	8.20	Cl L	OC	1.60	0.53	23.0	130.1	71.7	114.8	1.60				
8.20	8.40	Cl L	OC	1.60	0.53	24.1	133.2	72.9	121.0	1.66				
8.40	8.60	Cl L	OC	1.60	0.53	24.4	136.4	74.0	122.2	1.65				
8.60	8.80	Cl L	OC	1.60	0.53	24.4	139.5	75.2	122.1	1.63				
8.80	9.00	Cl L	OC	1.60	0.53	25.5	142.6	76.3	128.1	1.68				
9.00	9.20	Cl L	OC	1.60	0.53	26.1	145.8	77.4	131.8	1.70				
9.20	9.40	Cl L	OC	1.60	0.53	27.1	148.9	78.6	137.6	1.75				
9.40	9.60	Cl L	OC	1.60	0.53	27.1	152.1	79.7	137.1	1.72				
9.60	9.80	Cl L	OC	1.60	0.53	27.1	155.2	80.9	136.3	1.69				
9.80	10.00	Cl L	OC	1.60	0.53	26.9	158.3	82.0	135.0	1.65				
10.00	10.20	Cl L	OC	1.60	0.53	26.6	161.5	83.1	132.2	1.59				
10.20	10.40	Cl L	OC	1.60	0.53	26.7	164.6	84.3	132.6	1.57				
10.40	10.60	Cl L	OC	1.60	0.53	26.7	167.8	85.4	132.1	1.55				
10.60	10.80	Cl L	OC	1.60	0.53	27.2	170.9	86.6	134.6	1.56				
10.80	11.00	Cl L	OC	1.60	0.53	27.7	174.0	87.7	137.4	1.57				
11.00	11.20	Cl L	OC	1.60	0.53	27.9	177.2	88.8	138.4	1.56				
11.20	11.40	Cl L	OC	1.60	0.53	28.3	180.3	90.0	140.3	1.56				
11.40	11.60	Cl L	OC	1.60	0.53	28.6	183.4	91.1	141.4	1.55				
11.60	11.80	Cl L	OC	1.60	0.53	28.8	186.6	92.2	142.6	1.55				
11.80	12.00	Cl L	OC	1.60	0.53	29.8	189.7	93.4	148.1	1.59				
12.00	12.20	Cl L	OC	1.85	0.53	30.0	193.1	94.8	148.6	1.57				
12.20	12.40	Cl L	OC	1.60	0.53	29.9	196.5	96.2	147.8	1.54				
12.40	12.60	Cl L	OC	1.85	0.53	31.0	199.9	97.5	153.9	1.58				
12.60	12.80	Cl L	OC	1.85	0.53	30.4	203.5	99.2	149.4	1.51				
12.80	13.00	Cl L	NC	1.85	0.53	30.5	207.1	100.8	149.9	1.49				
13.00	13.20	Cl L	NC	1.85	0.53	30.6	210.8	102.4	149.4	1.46				
13.20	13.40	Cl L	NC	1.85	0.53	30.6	214.4	104.1	149.3	1.43				
13.40	13.60	Cl L	OC	1.85	0.53	32.4	218.0	105.7	159.4	1.51				
13.60	13.80	Cl L	NC	1.85	0.53	31.7	221.7	107.3	154.5	1.44				
13.80	14.00	Cl L	NC	1.85	0.53	31.8	225.3	108.9	154.9	1.42				
14.00	14.20	Cl L	NC	1.85	0.53	31.4	228.9	110.6	151.4	1.37				
14.20	14.40	Cl L	NC	1.85	0.53	30.4	232.5	112.2	145.2	1.29				
14.40	14.60	Cl L	NC	1.85	0.53	32.2	236.2	113.8	155.1	1.36				
14.60	14.80	Cl L	NC	1.85	0.53	31.7	239.8	115.5	151.7	1.31				
14.80	15.00	Cl L	NC	1.85	0.53	32.6	243.4	117.1	156.9	1.34				
15.00	15.20	Cl L	NC	1.85	0.53	33.2	247.1	118.7	159.5	1.34				
15.20	15.40	Cl L	NC	1.85	0.53	32.3	250.7	120.4	153.9	1.28				
15.40	15.60	Cl L	NC	1.85	0.53	33.1	254.3	122.0	158.1	1.30				
15.60	15.80	Cl L	NC	1.85	0.53	31.7	258.0	123.6	149.1	1.21				
15.80	16.00	Cl L	NC	1.85	0.53	34.2	261.6	125.2	163.4	1.30				
16.00	16.20	Cl L	NC	1.85	0.53	34.8	265.2	126.9	166.9	1.32				
16.20	16.40	Cl L	NC	1.85	0.53	35.0	268.8	128.5	167.1	1.30				
16.40	16.60	Cl L	NC	1.85	0.53	34.6	272.5	130.1	164.5	1.26				
16.60	16.80	Cl L	NC	1.85	0.53	34.8	276.1	131.8	165.1	1.25				
16.80	17.00	Cl L	NC	1.85	0.53	33.9	279.7	133.4	159.2	1.19				
17.00	17.20	Cl L	NC	1.85	0.53	34.1	283.4	135.0	160.1	1.19				
17.20	17.40	Cl L	NC	1.85	0.53	34.5	287.0	136.7	161.9	1.18				

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S003 Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.40	17.60	CIL	NC	1.85	0.53	34.5		290.6	138.3	161.3	1.17			
17.60	17.80	CIL	NC	1.85	0.53	34.8		294.3	139.9	162.4	1.16			
17.80	18.00	CIL	NC	1.85	0.53	34.3		297.9	141.5	159.1	1.12			
18.00	18.20	CIL	NC	1.85	0.53	34.8		301.5	143.2	161.4	1.13			
18.20	18.40	CIL	NC	1.85	0.53	34.6		305.1	144.8	160.0	1.11			
18.40	18.60	CIL	NC	1.85	0.53	34.7		308.8	146.4	159.9	1.09			
18.60	18.80	CIL	NC	1.85	0.53	33.6		312.4	148.1	153.5	1.04			
18.80	19.00	CIL	NC	1.85	0.53	33.9		316.0	149.7	154.9	1.04			
19.00	19.20	CIL	NC	1.85	0.53	34.3		319.7	151.3	156.5	1.03			
19.20	19.40	CIL	NC	1.85	0.53	35.6		323.3	152.9	163.6	1.07			
19.40	19.60	CIL	NC	1.85	0.53	35.9		326.9	154.6	164.7	1.07			
19.60	19.80	CIL	NC	1.85	0.53	36.8		330.5	156.2	169.9	1.09			
19.80	20.00	CIL	NC	1.85	0.53	37.2		334.2	157.8	171.4	1.09			
20.00	20.20	CIL	NC	1.85	0.53	37.9		337.8	159.5	175.2	1.10			
20.20	20.40	CIL	NC	1.85	0.53	38.3		341.4	161.1	176.9	1.10			
20.40	20.60	CIL	NC	1.85	0.53	39.8		345.1	162.7	185.5	1.14			
20.60	20.80	CI M	NC	1.85	0.53	41.0		348.7	164.4	191.5	1.16			
20.80	21.00	CIL	NC	1.85	0.53	37.7		352.3	166.0	172.5	1.04			
21.00	21.20	CIL	NC	1.85	0.53	37.1		356.0	167.6	168.5	1.01			
21.20	21.40	CIL	NC	1.85	0.53	38.0		359.6	169.2	173.2	1.02			
21.40	21.60	CIL	NC	1.85	0.53	38.9		363.2	170.9	178.0	1.04			
21.60	21.80	CIL	NC	1.85	0.53	37.8		366.8	172.5	171.5	1.00			
21.80	22.00	CIL	NC	1.80	0.53	37.8		370.4	174.1	171.4	1.00			
22.00	22.20	CI M	NC	1.85	0.53	40.0		374.0	175.7	183.0	1.04			
22.20	22.40	CIL	NC	1.80	0.53	36.5		377.6	177.2	165.6	1.00			
22.40	22.60	CIL	NC	1.80	0.53	36.6		381.1	178.8	166.2	1.00			
22.60	22.80	CIL	NC	1.80	0.53	36.0		384.7	180.3	163.2	1.00			
22.80	23.00	CIL	NC	1.80	0.53	36.5		388.2	181.8	165.6	1.00			
23.00	23.20	CIL	NC	1.80	0.53	35.0		391.7	183.4	158.8	1.00			
23.20	23.40	CIL	NC	1.80	0.53	35.5		395.2	184.9	161.1	1.00			
23.40	23.60	CIL	NC	1.80	0.53	35.8		398.8	186.4	162.1	1.00			
23.60	23.80	CIL	NC	1.80	0.53	36.4		402.3	188.0	165.0	1.00			
23.80	24.00	CIL	NC	1.80	0.53	38.1		405.8	189.5	172.6	1.00			
24.00	24.20	CIL	NC	1.80	0.53	38.1		409.4	191.0	172.6	1.00			
24.20	24.40	CIL	NC	1.80	0.53	37.6		412.9	192.6	170.4	1.00			
24.40	24.60	CIL	NC	1.80	0.53	38.9		416.4	194.1	176.2	1.00			
24.60	24.80	CIL	NC	1.80	0.53	38.9		420.0	195.6	176.5	1.00			
24.80	25.00	CIL	NC	1.80	0.53	39.7		423.5	197.2	179.9	1.00			
25.00	25.20	CIL	NC	1.80	0.53	39.9		427.0	198.7	181.0	1.00			
25.20	25.40	CI M	NC	1.80	0.53	40.2		430.6	200.2	182.4	1.00			
25.40	25.53	CIL	NC	1.80	0.53	39.9		433.4	201.5	180.9	1.00			


CPT-test performed according to EN ISO 22476-1

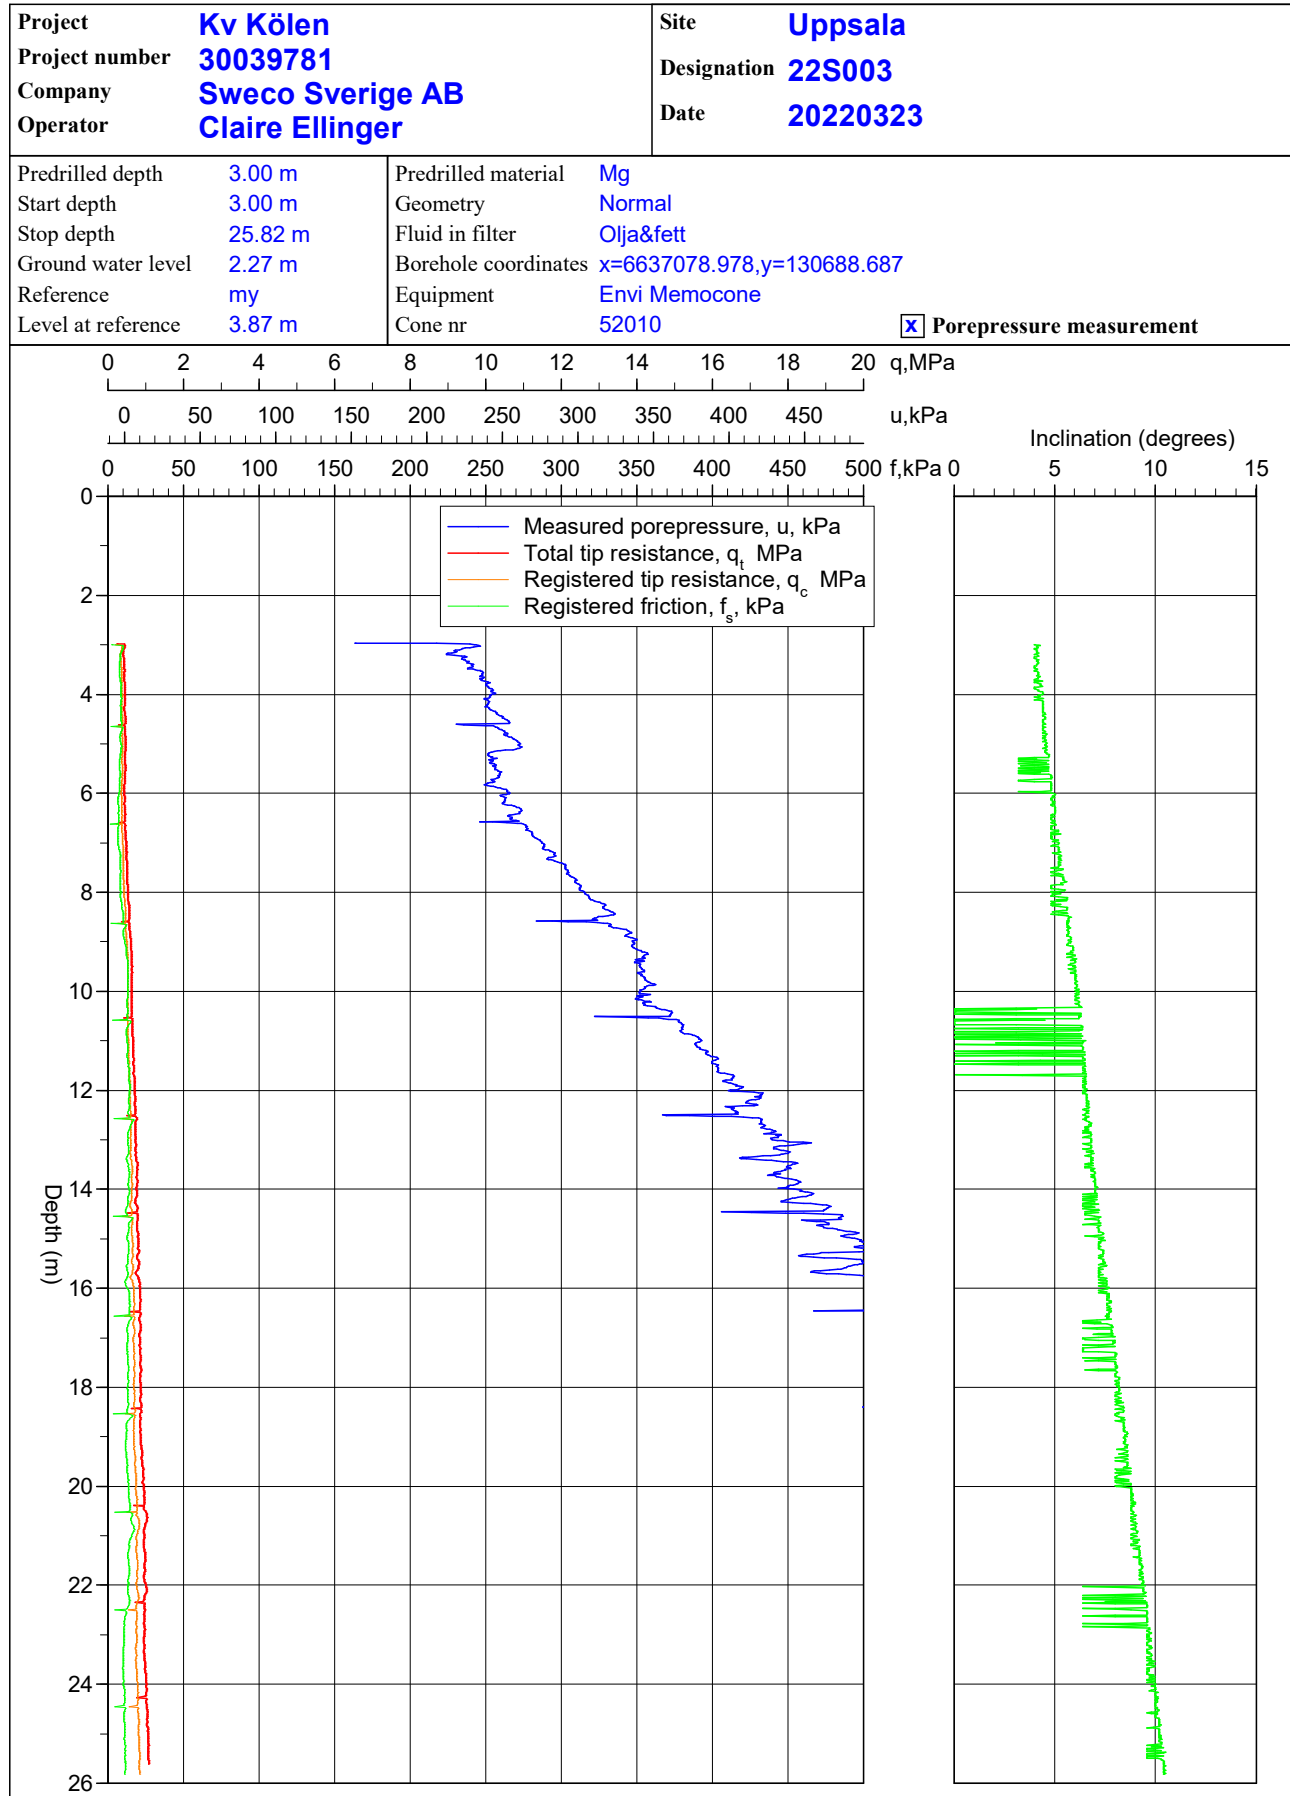

CPT-test performed according to EN ISO 22476-1

Predrilling depth	3.00 m	Reference	my	Fluid in filter	Olja&fett
Start depth	3.00 m	Level at reference	3.70 m	Coordinats	x=6636858.665,y=130524.071
Stop depth	3.73 m	Predrilled material	mg	Equipment	Envi Memocone
Ground water level	2.10 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S004
Date	20220322

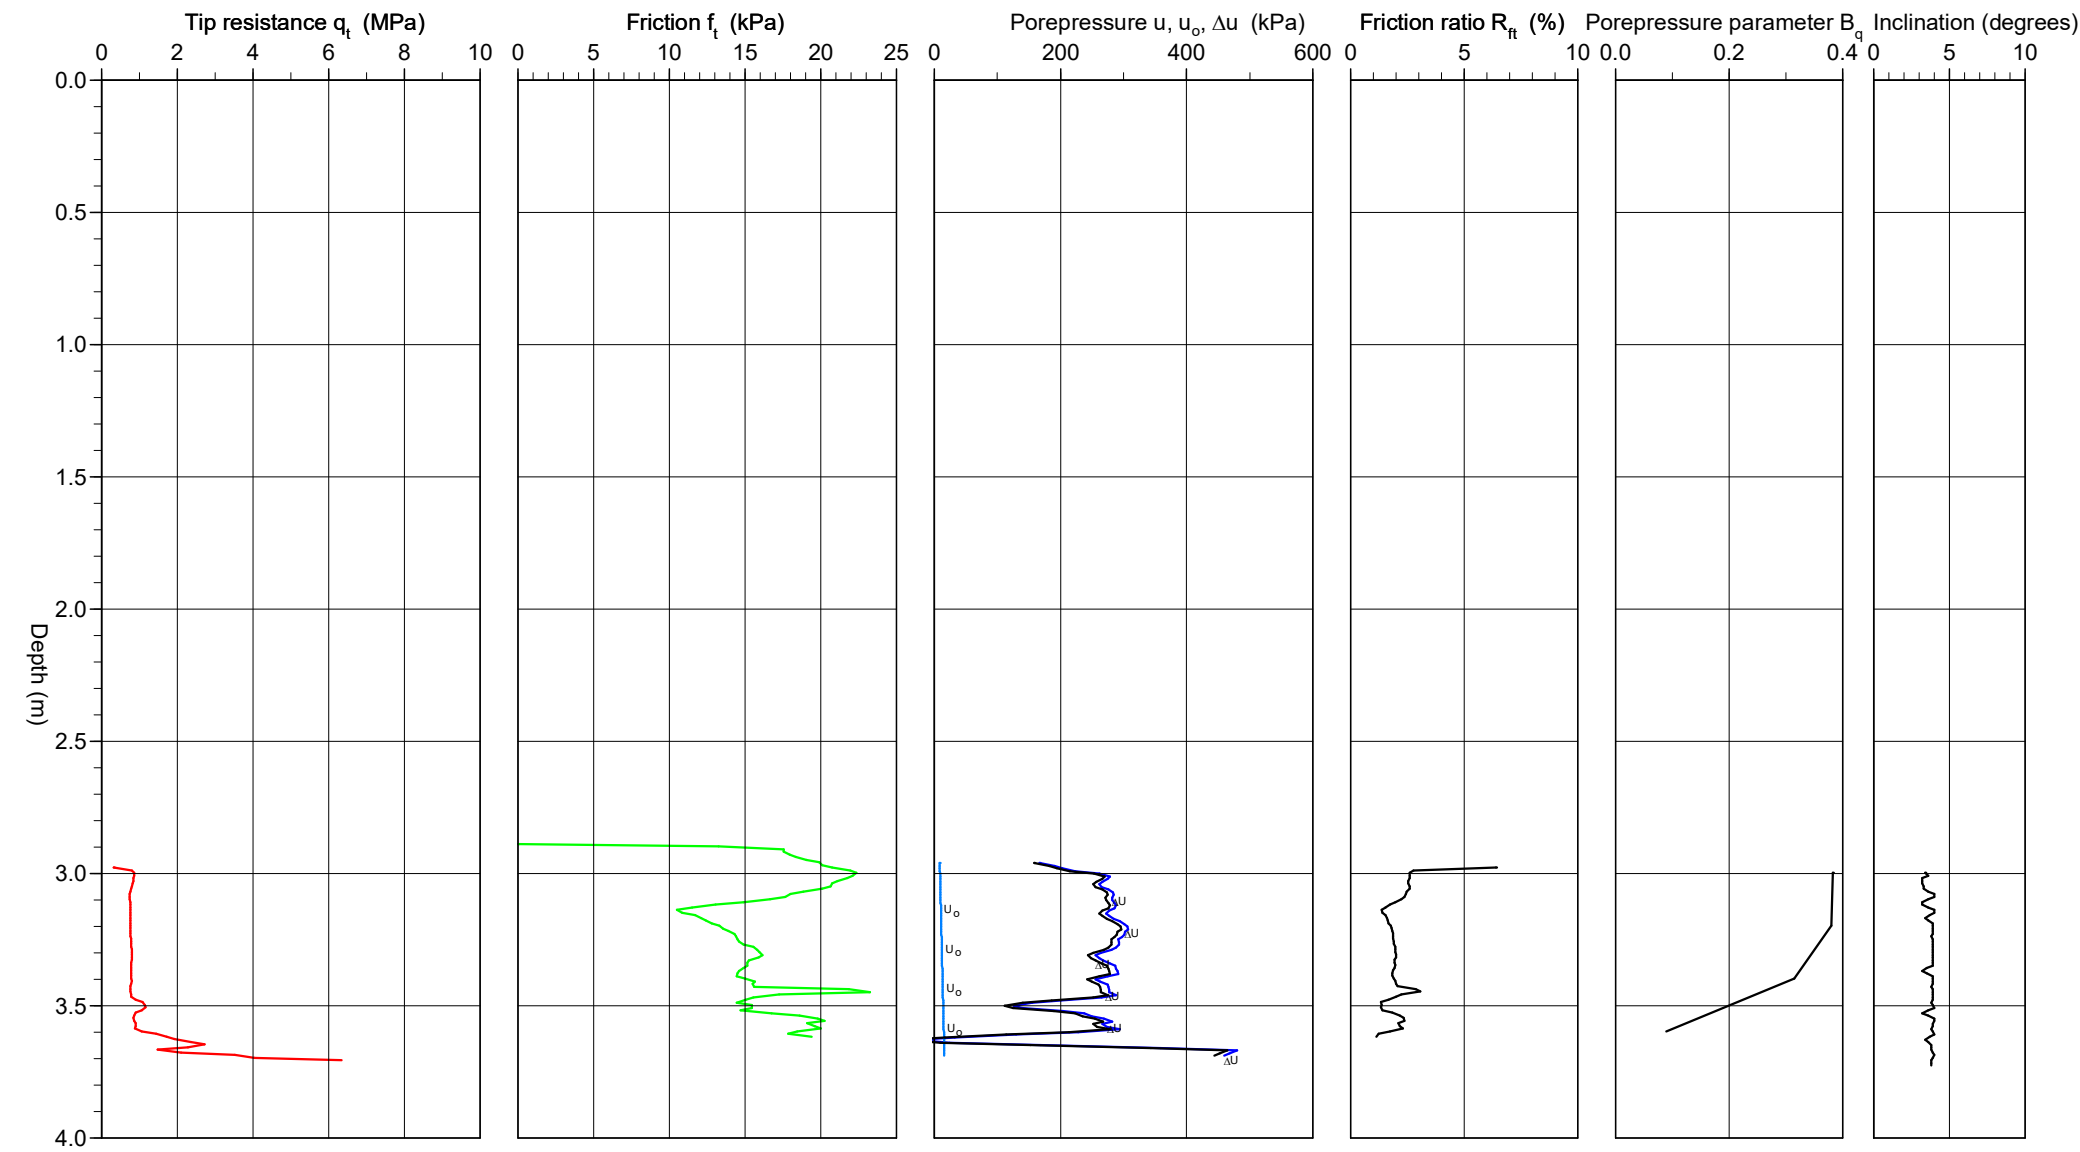

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S004
 Date 20220322


Reference my Predrilling depth 3.00 m Evaluator INPRAG
 Level at reference 3.70 m Predrilled material mg Evaluation date 2022-04-12
 Ground water level 2.10 m Equipment Envi Memocone
 Start depth 3.00 m Geometry Normal

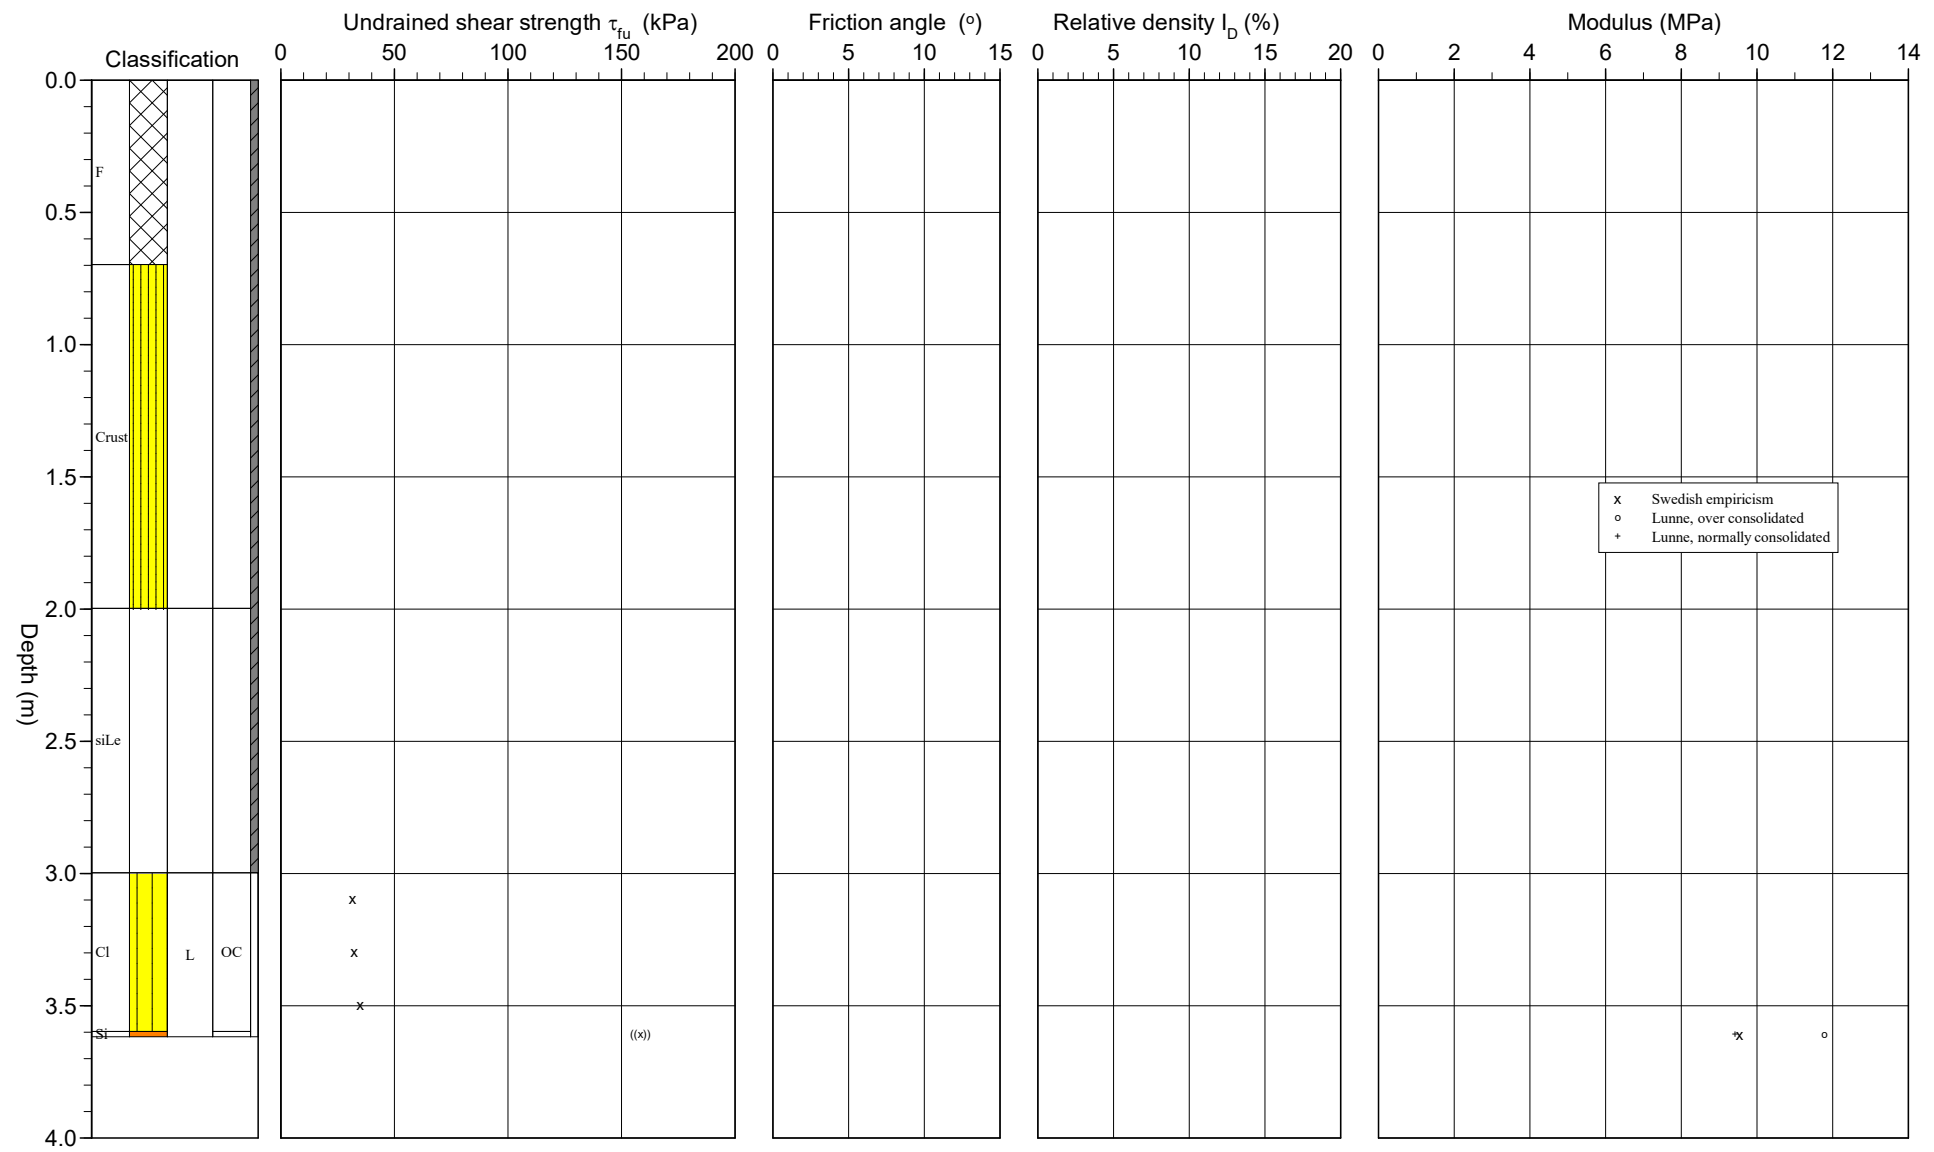

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	my	Predrilling depth	3.00 m	Evaluator	INPRAG
Ground water level	3.70 m	Predrilled material	mg	Evaluation date	2022-04-12
Grundvattenyta	2.10 m	Equipment	Envi Memocone		
Start depth	3.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S004
Date	20220322

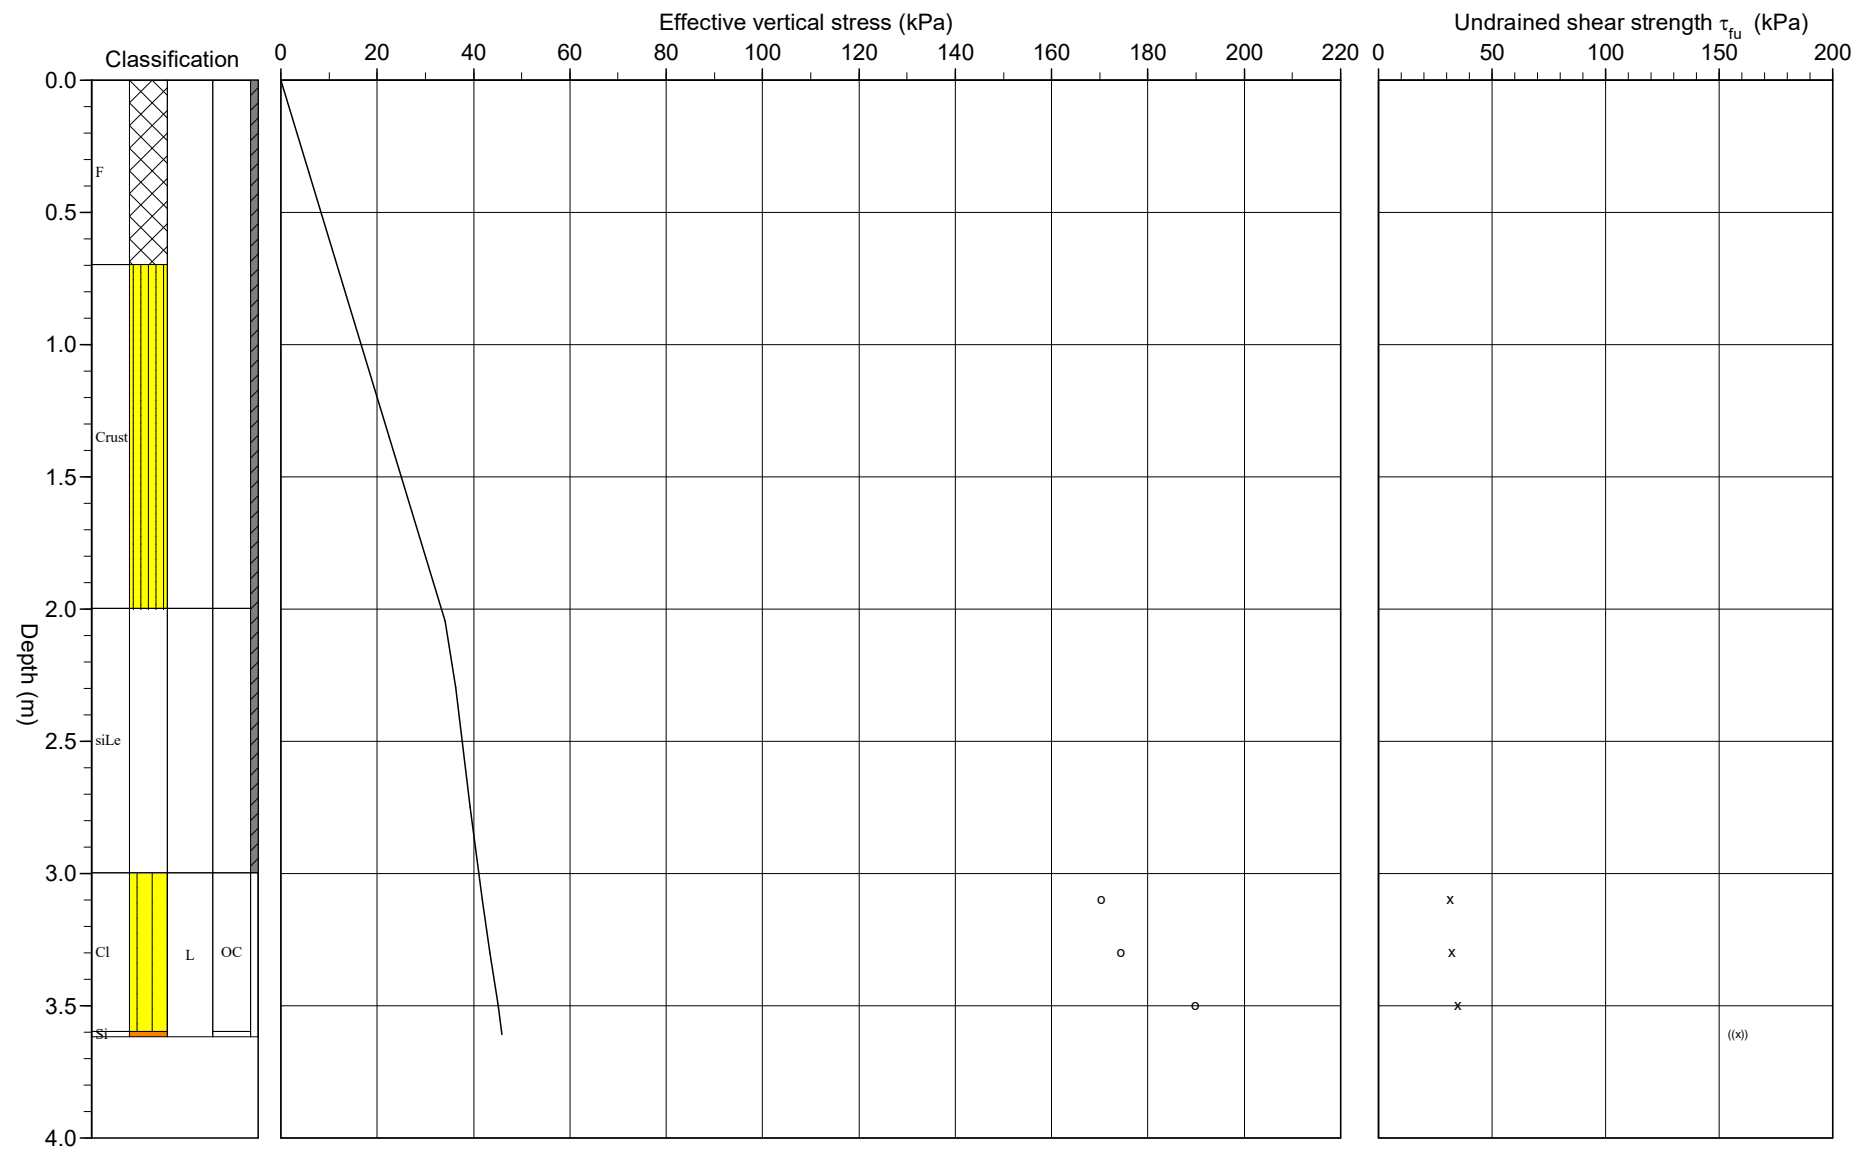


C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S004 Date 20220322																																							
Predrilling depth 3.00 m Start depth 3.00 m Stop depth 3.73 m Ground water level 2.10 m Reference my Level at reference 3.70 m	Predrilled material mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																								
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>3.90</td> <td>0.50</td> <td>0.05</td> </tr> <tr> <td>Diff</td> <td>3.90</td> <td>0.50</td> <td>0.05</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	3.90	0.50	0.05	Diff	3.90	0.50	0.05																						
	Porepressure	Friction	Tip resistance																																						
Before	0.00	0.00	0.00																																						
After	3.90	0.50	0.05																																						
Diff	3.90	0.50	0.05																																						
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																					
Porepressure		Friction		Tip resistance																																					
Range	Code	Range	Code	Range	Code																																				
<input type="checkbox"/> Use scale factors																																									
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>2.10</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	2.10	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th>Density</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> <th>(ton/m³)</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td rowspan="3"> </td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.00</td> <td>1.70</td> <td>Crust</td> </tr> <tr> <td>2.00</td> <td>2.50</td> <td>1.70</td> <td>0.37</td> </tr> <tr> <td>2.50</td> <td>3.00</td> <td>1.70</td> <td>0.70</td> <td>siLe</td> </tr> <tr> <td>3.00</td> <td>3.73</td> <td> </td> <td>0.67</td> <td> </td> </tr> </tbody> </table>		Depth (m)		Density	Liquid limit	Soil	From	To	(ton/m ³)	0.00	0.70	1.70		F	0.70	2.00	1.70	Crust	2.00	2.50	1.70	0.37	2.50	3.00	1.70	0.70	siLe	3.00	3.73		0.67	
Depth (m)	Porepressure (kPa)																																								
2.10	0.00																																								
Depth (m)																																									
Depth (m)		Density	Liquid limit	Soil																																					
From	To	(ton/m ³)																																							
0.00	0.70	1.70		F																																					
0.70	2.00	1.70		Crust																																					
2.00	2.50	1.70		0.37																																					
2.50	3.00	1.70	0.70	siLe																																					
3.00	3.73		0.67																																						
Notes 																																									

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S004 Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	2.00	Crust	1.70				22.5	22.5						
2.00	2.10	siLe	1.70	0.37			34.2	34.2						
2.10	2.50	siLe	1.70	0.37			38.3	36.3						
2.50	3.00	siLe	1.70	0.70			45.9	39.3						
3.00	3.20	Cl L	OC	1.85	0.67	31.6	51.8	41.8	170.4	4.08				
3.20	3.40	Cl L	OC	1.85	0.67	32.4	55.5	43.4	174.4	4.01				
3.40	3.60	Cl L	OC	1.85	0.67	34.9	59.1	45.1	189.8	4.21				
3.60	3.62	Si L	1.70	0.67	((158.3))		61.1	45.9			9.5	11.8	9.4	


CPT-test performed according to EN ISO 22476-1

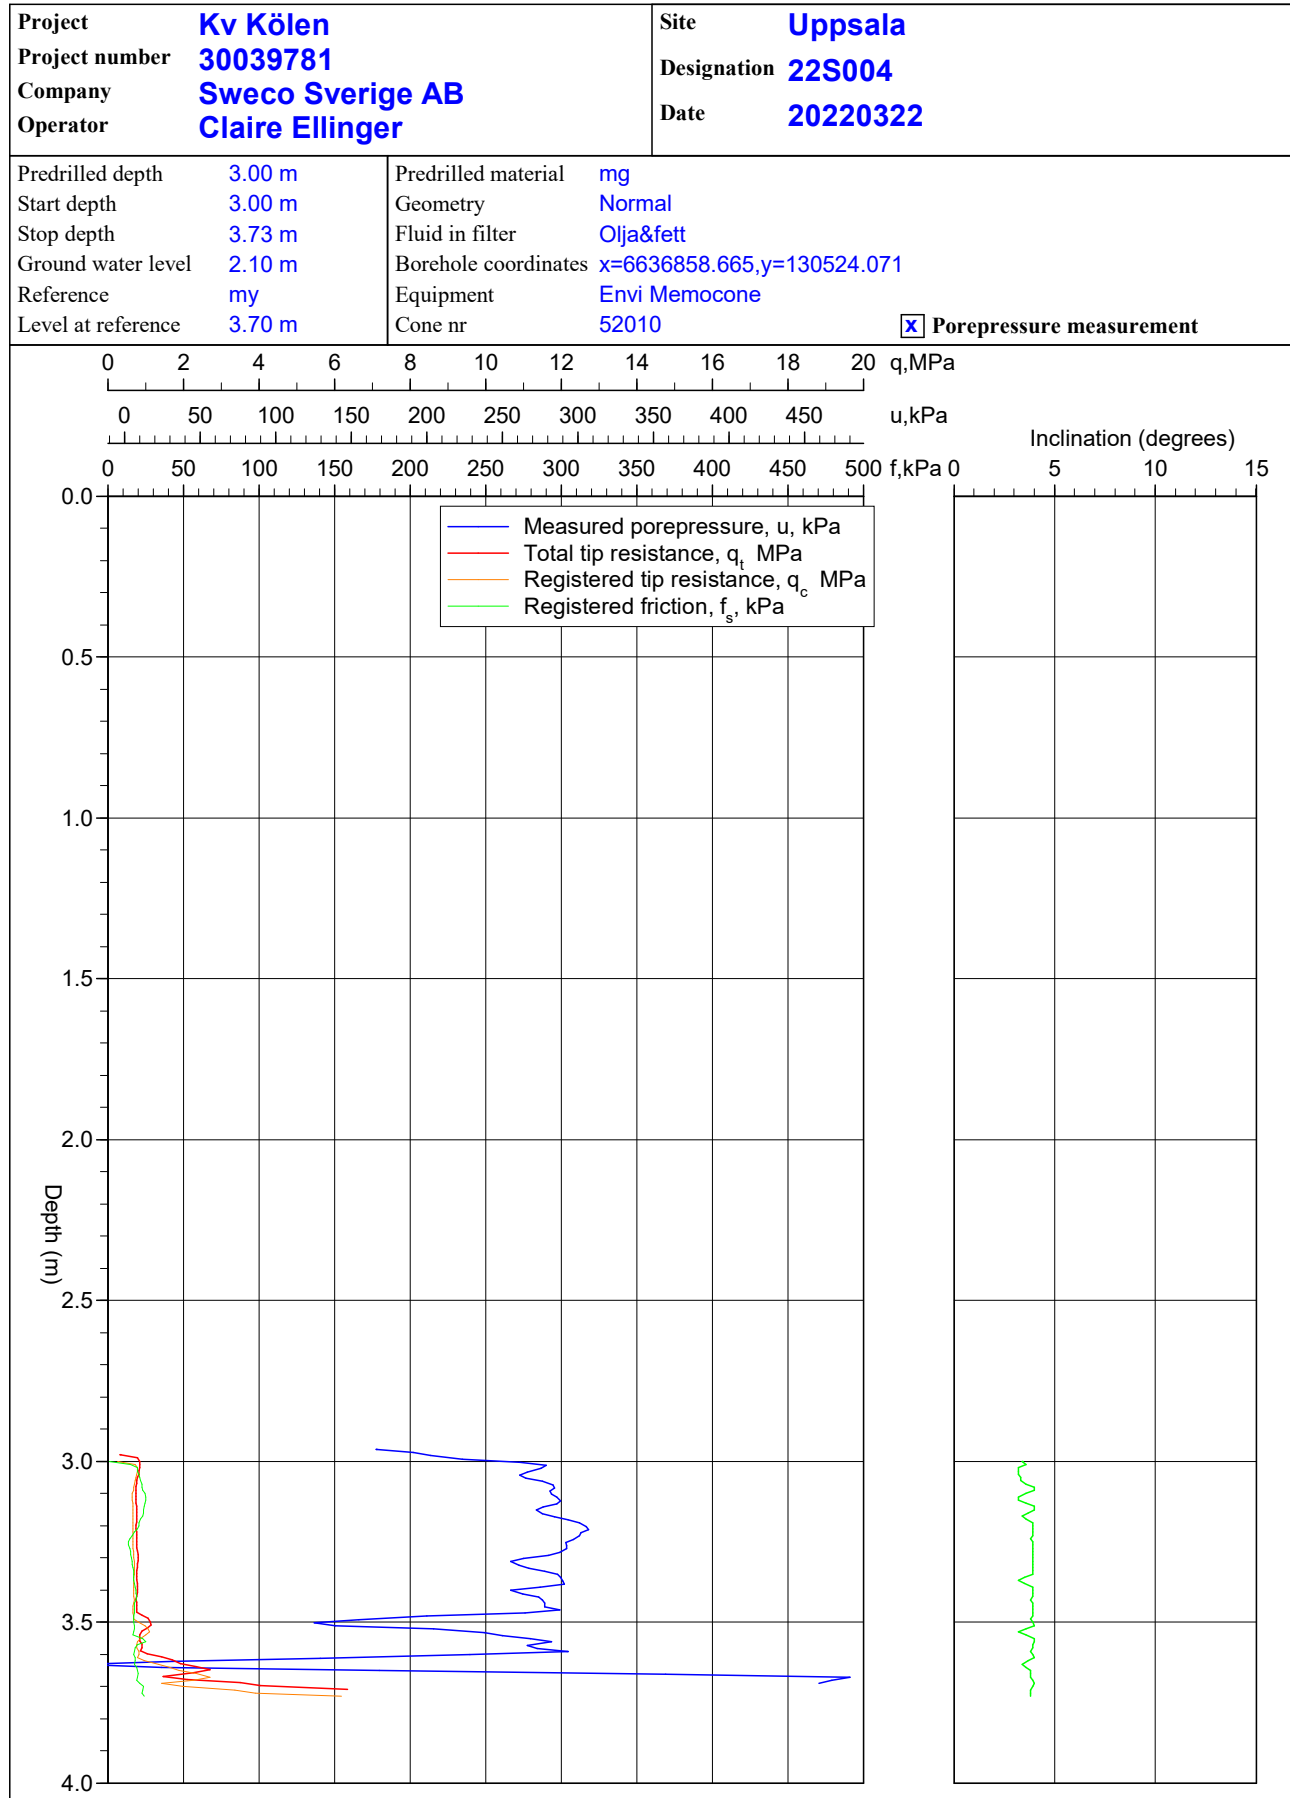

CPT-test performed according to EN ISO 22476-1

Predrilling depth	5.00 m	Reference	MY	Fluid in filter	Olja&fett
Start depth	5.00 m	Level at reference	3.70 m	Coordinates	X=6636858.665,Y=130524.071
Stop depth	23.32 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	2.10 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S004B
Date	20220322

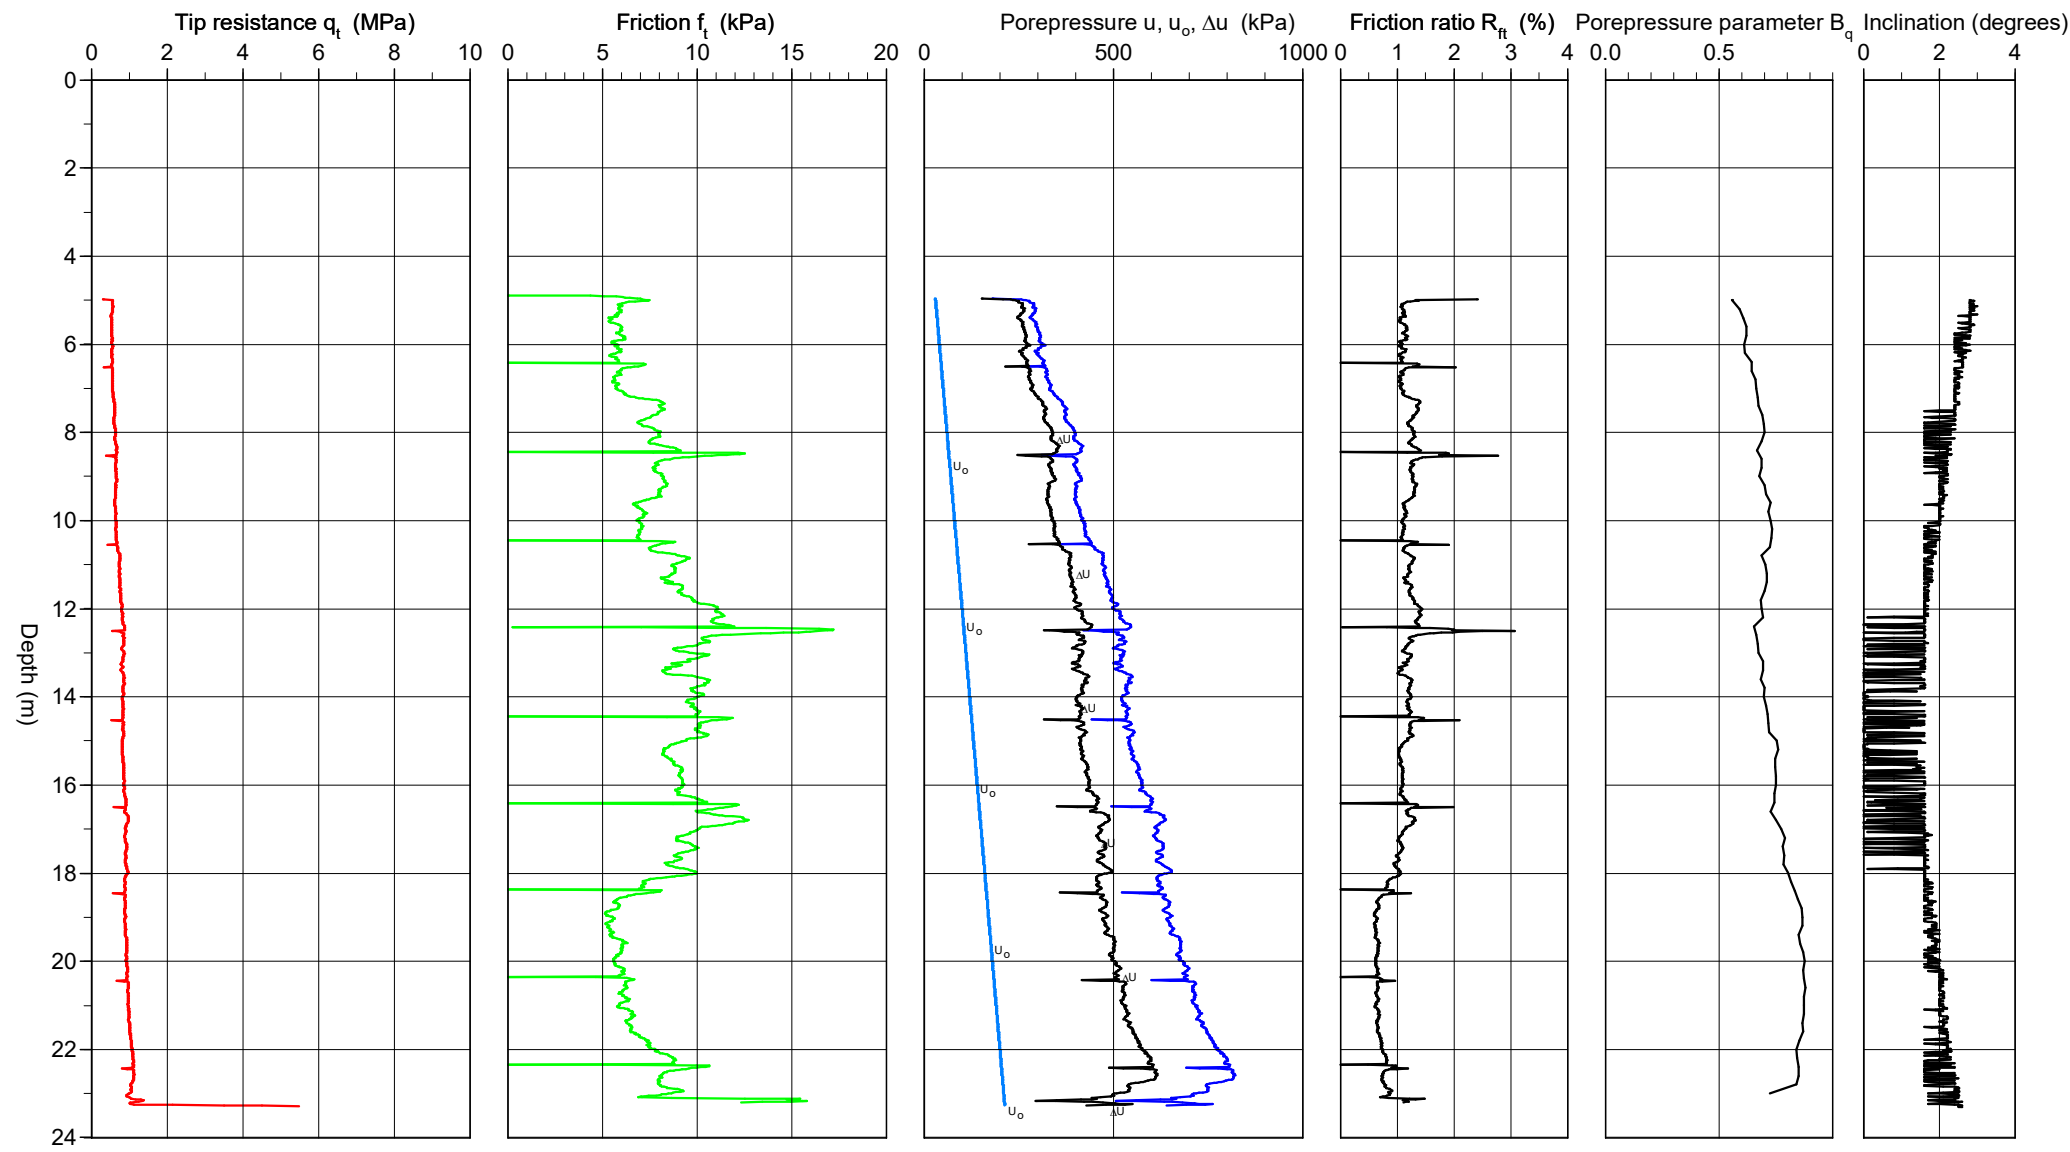

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	MY	Predrilling depth	5.00 m	Evaluator	INPRAG
Level at reference	3.70 m	Predrilled material	Mg	Evaluation date	2022-04-12
Ground water level	2.10 m	Equipment	Envi Memocone		
Start depth	5.00 m	Geometry	Normal		


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S004B
Date	20220322

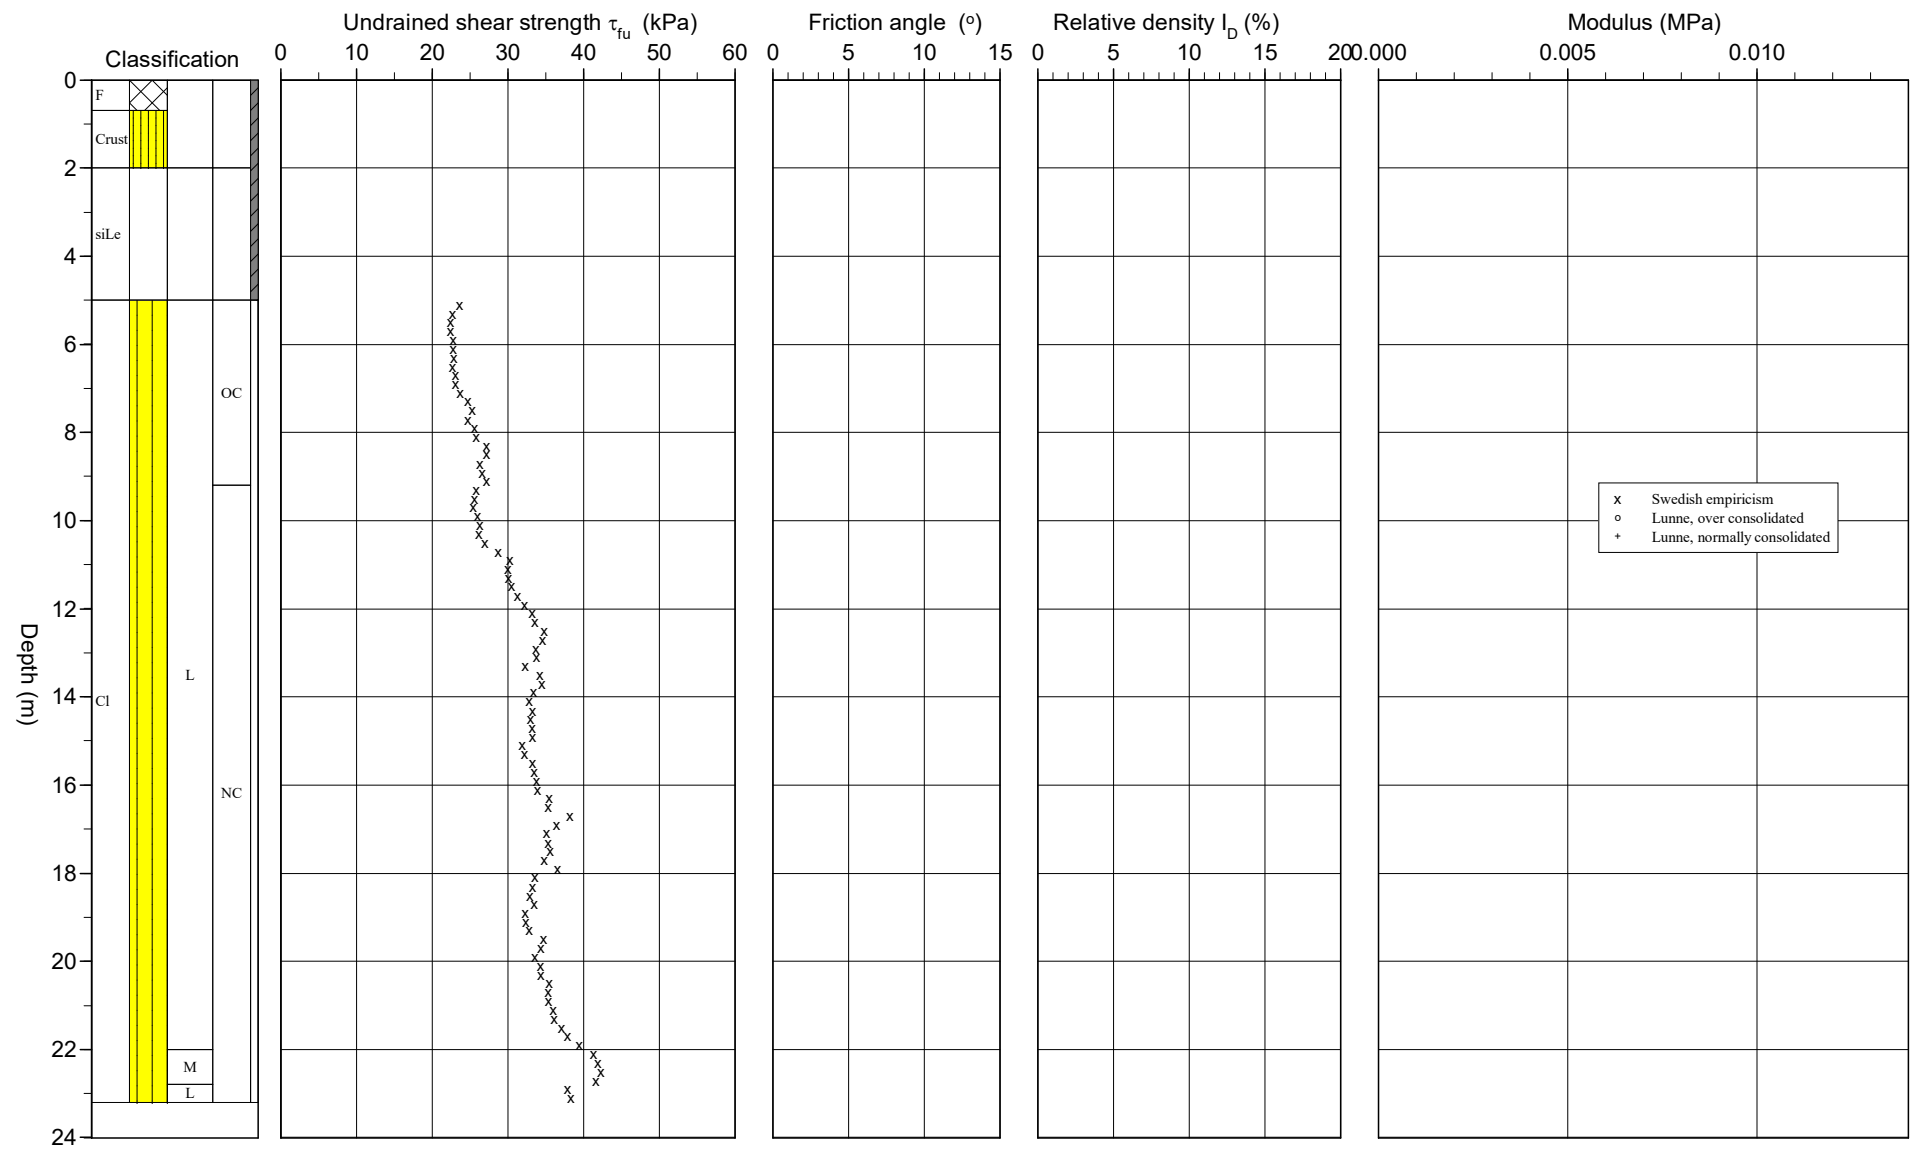

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	MY	Predrilling depth	5.00 m	Evaluator	INPRAG
Ground water level	3.70 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	2.10 m	Equipment	Envi Memocone		
Start depth	5.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S004B
Date	20220322

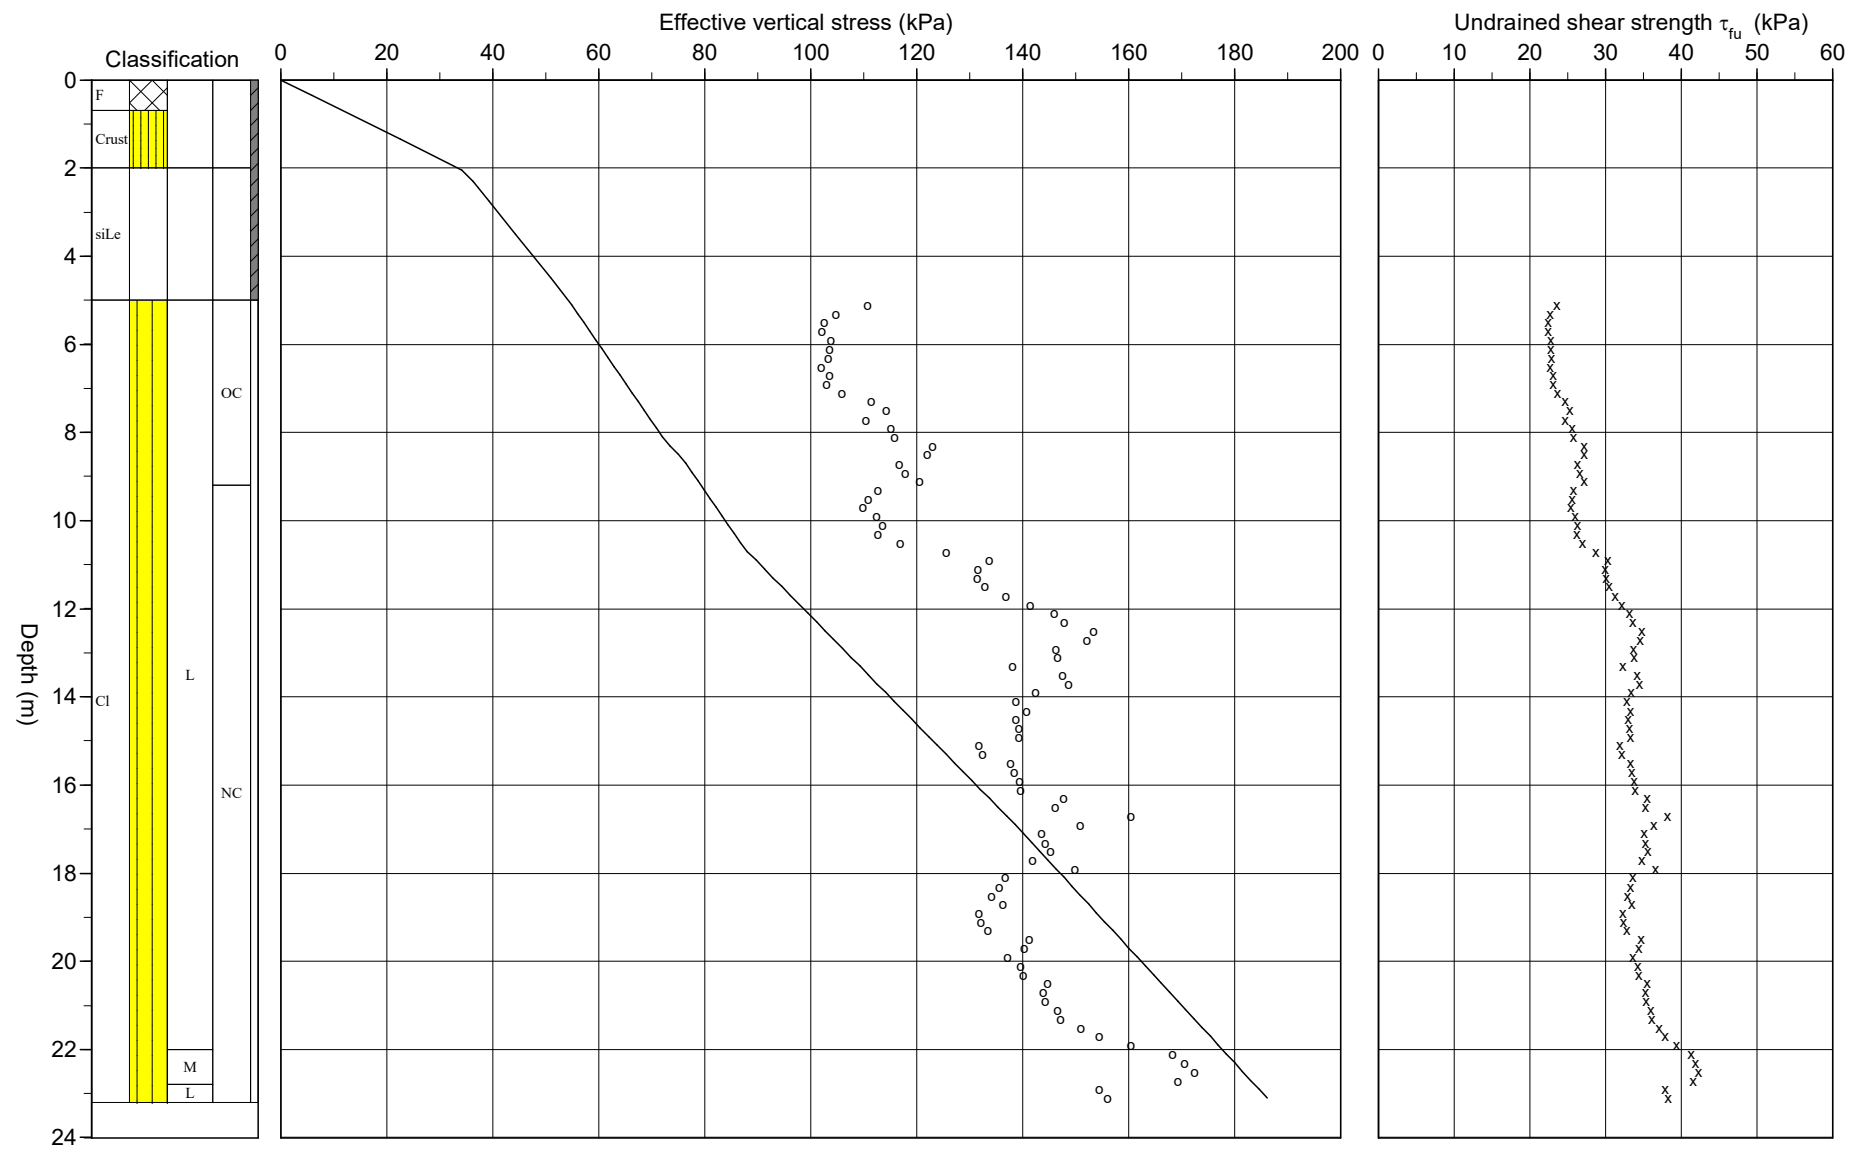

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S004B Date 20220322																																																	
Predrilling depth 5.00 m Start depth 5.00 m Stop depth 23.32 m Ground water level 2.10 m Reference MY Level at reference 3.70 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																																		
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>2.30</td> <td>-0.40</td> <td>0.01</td> </tr> <tr> <td>Diff</td> <td>2.30</td> <td>-0.40</td> <td>0.01</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	2.30	-0.40	0.01	Diff	2.30	-0.40	0.01																																
	Porepressure	Friction	Tip resistance																																																
Before	0.00	0.00	0.00																																																
After	2.30	-0.40	0.01																																																
Diff	2.30	-0.40	0.01																																																
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																															
Porepressure		Friction		Tip resistance																																															
Range	Code	Range	Code	Range	Code																																														
<input type="checkbox"/> Use scale factors																																																			
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>2.10</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	2.10	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.00</td> <td>1.70</td> <td></td> <td>Crust</td> </tr> <tr> <td>2.00</td> <td>2.50</td> <td>1.70</td> <td>0.37</td> <td>siLe</td> </tr> <tr> <td>2.50</td> <td>3.00</td> <td>1.70</td> <td>0.70</td> <td>siLe</td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td>1.70</td> <td>0.67</td> <td>siLe</td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td>1.70</td> <td>0.67</td> <td>siLe</td> </tr> <tr> <td>5.00</td> <td>23.20</td> <td></td> <td>0.67</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.00	0.70	1.70		F	0.70	2.00	1.70		Crust	2.00	2.50	1.70	0.37	siLe	2.50	3.00	1.70	0.70	siLe	3.00	4.00	1.70	0.67	siLe	4.00	5.00	1.70	0.67	siLe	5.00	23.20		0.67	
Depth (m)	Porepressure (kPa)																																																		
2.10	0.00																																																		
Depth (m)																																																			
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																															
From	To																																																		
0.00	0.70	1.70		F																																															
0.70	2.00	1.70		Crust																																															
2.00	2.50	1.70	0.37	siLe																																															
2.50	3.00	1.70	0.70	siLe																																															
3.00	4.00	1.70	0.67	siLe																																															
4.00	5.00	1.70	0.67	siLe																																															
5.00	23.20		0.67																																																
Notes 																																																			


CPT - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S004B										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	2.00	Crust	1.70				22.5	22.5						
2.00	2.10	siLe	1.70	0.37			34.2	34.2						
2.10	2.50	siLe	1.70	0.37			38.3	36.3						
2.50	3.00	siLe	1.70	0.70			45.9	39.3						
3.00	4.00	siLe	1.70	0.67			58.4	44.3						
4.00	5.00	siLe	1.70	0.67			75.0	51.0						
5.00	5.20	Cl L	OC	1.60	0.67	23.6	85.0	54.9	110.7	2.02				
5.20	5.40	Cl L	OC	1.60	0.67	22.7	88.1	56.1	104.7	1.87				
5.40	5.60	Cl L	OC	1.60	0.67	22.4	91.2	57.2	102.5	1.79				
5.60	5.80	Cl L	OC	1.60	0.67	22.4	94.4	58.3	102.1	1.75				
5.80	6.00	Cl L	OC	1.60	0.67	22.8	97.5	59.5	103.9	1.75				
6.00	6.20	Cl L	OC	1.60	0.67	22.8	100.7	60.6	103.5	1.71				
6.20	6.40	Cl L	OC	1.60	0.67	22.9	103.8	61.7	103.3	1.67				
6.40	6.60	Cl L	OC	1.60	0.67	22.7	106.9	62.9	101.9	1.62				
6.60	6.80	Cl L	OC	1.60	0.67	23.1	110.1	64.0	103.5	1.62				
6.80	7.00	Cl L	OC	1.60	0.67	23.1	113.2	65.2	103.0	1.58				
7.00	7.20	Cl L	OC	1.60	0.67	23.7	116.3	66.3	105.8	1.60				
7.20	7.40	Cl L	OC	1.60	0.67	24.7	119.5	67.4	111.4	1.65				
7.40	7.60	Cl L	OC	1.60	0.67	25.3	122.6	68.6	114.3	1.67				
7.60	7.80	Cl L	OC	1.60	0.67	24.7	125.8	69.7	110.4	1.58				
7.80	8.00	Cl L	OC	1.60	0.67	25.6	128.9	70.9	115.2	1.62				
8.00	8.20	Cl L	OC	1.60	0.67	25.8	132.0	72.0	115.8	1.61				
8.20	8.40	Cl L	OC	1.85	0.67	27.2	135.4	73.4	123.0	1.68				
8.40	8.60	Cl L	OC	1.85	0.67	27.2	139.1	75.0	122.0	1.63				
8.60	8.80	Cl L	OC	1.60	0.67	26.3	142.4	76.4	116.7	1.53				
8.80	9.00	Cl L	OC	1.60	0.67	26.6	145.6	77.5	117.9	1.52				
9.00	9.20	Cl L	OC	1.60	0.67	27.2	148.7	78.7	120.5	1.53				
9.20	9.40	Cl L	NC	1.60	0.67	25.8	151.9	79.8	112.7	1.41				
9.40	9.60	Cl L	NC	1.60	0.67	25.6	155.0	81.0	110.9	1.37				
9.60	9.80	Cl L	NC	1.60	0.67	25.4	158.1	82.1	109.9	1.34				
9.80	10.00	Cl L	NC	1.60	0.67	26.0	161.3	83.2	112.4	1.35				
10.00	10.20	Cl L	NC	1.60	0.67	26.3	164.4	84.4	113.6	1.35				
10.20	10.40	Cl L	NC	1.60	0.67	26.2	167.6	85.5	112.7	1.32				
10.40	10.60	Cl L	NC	1.60	0.67	27.0	170.7	86.7	116.9	1.35				
10.60	10.80	Cl L	NC	1.85	0.67	28.7	174.1	88.0	125.5	1.43				
10.80	11.00	Cl L	NC	1.85	0.67	30.3	177.7	89.7	133.7	1.49				
11.00	11.20	Cl L	NC	1.85	0.67	30.0	181.3	91.3	131.6	1.44				
11.20	11.40	Cl L	NC	1.85	0.67	30.1	185.0	92.9	131.5	1.41				
11.40	11.60	Cl L	NC	1.85	0.67	30.5	188.6	94.6	132.9	1.41				
11.60	11.80	Cl L	NC	1.85	0.67	31.3	192.2	96.2	136.8	1.42				
11.80	12.00	Cl L	NC	1.85	0.67	32.2	195.9	97.8	141.4	1.45				
12.00	12.20	Cl L	NC	1.85	0.67	33.2	199.5	99.4	146.0	1.47				
12.20	12.40	Cl L	NC	1.85	0.67	33.6	203.1	101.1	147.9	1.46				
12.40	12.60	Cl L	NC	1.85	0.67	34.8	206.7	102.7	153.5	1.49				
12.60	12.80	Cl L	NC	1.85	0.67	34.6	210.4	104.3	152.1	1.46				
12.80	13.00	Cl L	NC	1.85	0.67	33.7	214.0	106.0	146.3	1.38				
13.00	13.20	Cl L	NC	1.85	0.67	33.8	217.6	107.6	146.5	1.36				
13.20	13.40	Cl L	NC	1.85	0.67	32.3	221.3	109.2	138.1	1.26				
13.40	13.60	Cl L	NC	1.85	0.67	34.2	224.9	110.9	147.6	1.33				
13.60	13.80	Cl L	NC	1.85	0.67	34.5	228.5	112.5	148.7	1.32				
13.80	14.00	Cl L	NC	1.85	0.67	33.4	232.2	114.1	142.5	1.25				
14.00	14.20	Cl L	NC	1.85	0.67	32.8	235.8	115.7	138.7	1.20				
14.20	14.40	Cl L	NC	1.85	0.67	33.3	239.4	117.4	140.7	1.20				
14.40	14.60	Cl L	NC	1.85	0.67	33.0	243.0	119.0	138.8	1.17				
14.60	14.80	Cl L	NC	1.85	0.67	33.2	246.7	120.6	139.3	1.15				
14.80	15.00	Cl L	NC	1.85	0.67	33.3	250.3	122.3	139.3	1.14				
15.00	15.20	Cl L	NC	1.85	0.67	31.9	253.9	123.9	131.8	1.06				
15.20	15.40	Cl L	NC	1.85	0.67	32.2	257.6	125.5	132.4	1.06				
15.40	15.60	Cl L	NC	1.85	0.67	33.3	261.2	127.2	137.7	1.08				
15.60	15.80	Cl L	NC	1.85	0.67	33.5	264.8	128.8	138.4	1.07				
15.80	16.00	Cl L	NC	1.85	0.67	33.8	268.5	130.4	139.4	1.07				
16.00	16.20	Cl L	NC	1.85	0.67	33.9	272.1	132.0	139.5	1.06				
16.20	16.40	Cl L	NC	1.85	0.67	35.5	275.7	133.7	147.8	1.11				
16.40	16.60	Cl L	NC	1.85	0.67	35.3	279.3	135.3	146.1	1.08				
16.60	16.80	Cl L	NC	1.85	0.67	38.2	283.0	136.9	160.5	1.17				
16.80	17.00	Cl L	NC	1.85	0.67	36.4	286.6	138.6	150.9	1.09				
17.00	17.20	Cl L	NC	1.80	0.67	35.1	290.2	140.1	143.5	1.02				
17.20	17.40	Cl L	NC	1.80	0.67	35.3	293.7	141.7	144.3	1.02				
17.40	17.60	Cl L	NC	1.80	0.67	35.6	297.2	143.2	145.3	1.01				
17.60	17.80	Cl L	NC	1.80	0.67	34.8	300.8	144.7	141.8	1.00				
17.80	18.00	Cl L	NC	1.80	0.67	36.6	304.3	146.3	149.9	1.02				
18.00	18.20	Cl L	NC	1.80	0.67	33.6	307.8	147.8	136.8	1.00				
18.20	18.40	Cl L	NC	1.80	0.67	33.3	311.4	149.3	135.6	1.00				
18.40	18.60	Cl L	NC	1.80	0.67	32.9	314.9	150.9	134.1	1.00				
18.60	18.80	Cl L	NC	1.80	0.67	33.5	318.4	152.4	136.3	1.00				
18.80	19.00	Cl L	NC	1.80	0.67	32.3	322.0	153.9	131.8	1.00				

C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S004B										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
19.00	19.20	CIL	NC	1.80	0.67	32.4		325.5	155.5	132.1	1.00			
19.20	19.40	CIL	NC	1.80	0.67	32.8		329.0	157.0	133.5	1.00			
19.40	19.60	CIL	NC	1.80	0.67	34.7		332.6	158.5	141.2	1.00			
19.60	19.80	CIL	NC	1.80	0.67	34.4		336.1	160.1	140.4	1.00			
19.80	20.00	CIL	NC	1.80	0.67	33.6		339.6	161.6	137.1	1.00			
20.00	20.20	CIL	NC	1.80	0.67	34.3		343.2	163.1	139.6	1.00			
20.20	20.40	CIL	NC	1.80	0.67	34.4		346.7	164.6	140.2	1.00			
20.40	20.60	CIL	NC	1.80	0.67	35.5		350.2	166.2	144.7	1.00			
20.60	20.80	CIL	NC	1.80	0.67	35.3		353.7	167.7	143.9	1.00			
20.80	21.00	CIL	NC	1.80	0.67	35.4		357.3	169.2	144.3	1.00			
21.00	21.20	CIL	NC	1.80	0.67	36.0		360.8	170.8	146.6	1.00			
21.20	21.40	CIL	NC	1.80	0.67	36.1		364.3	172.3	147.1	1.00			
21.40	21.60	CIL	NC	1.80	0.67	37.1		367.9	173.8	151.0	1.00			
21.60	21.80	CIL	NC	1.80	0.67	37.9		371.4	175.4	154.4	1.00			
21.80	22.00	CIL	NC	1.80	0.67	39.4		374.9	176.9	160.4	1.00			
22.00	22.20	CI M	NC	1.80	0.67	41.3		378.5	178.4	168.3	1.00			
22.20	22.40	CI M	NC	1.80	0.67	41.9		382.0	180.0	170.6	1.00			
22.40	22.60	CI M	NC	1.80	0.67	42.3		385.5	181.5	172.4	1.00			
22.60	22.80	CI M	NC	1.80	0.67	41.6		389.1	183.0	169.4	1.00			
22.80	23.00	CIL	NC	1.80	0.67	37.9		392.6	184.6	154.4	1.00			
23.00	23.20	CIL	NC	1.85	0.67	38.3		396.2	186.1	156.1	1.00			


CPT-test performed according to EN ISO 22476-1

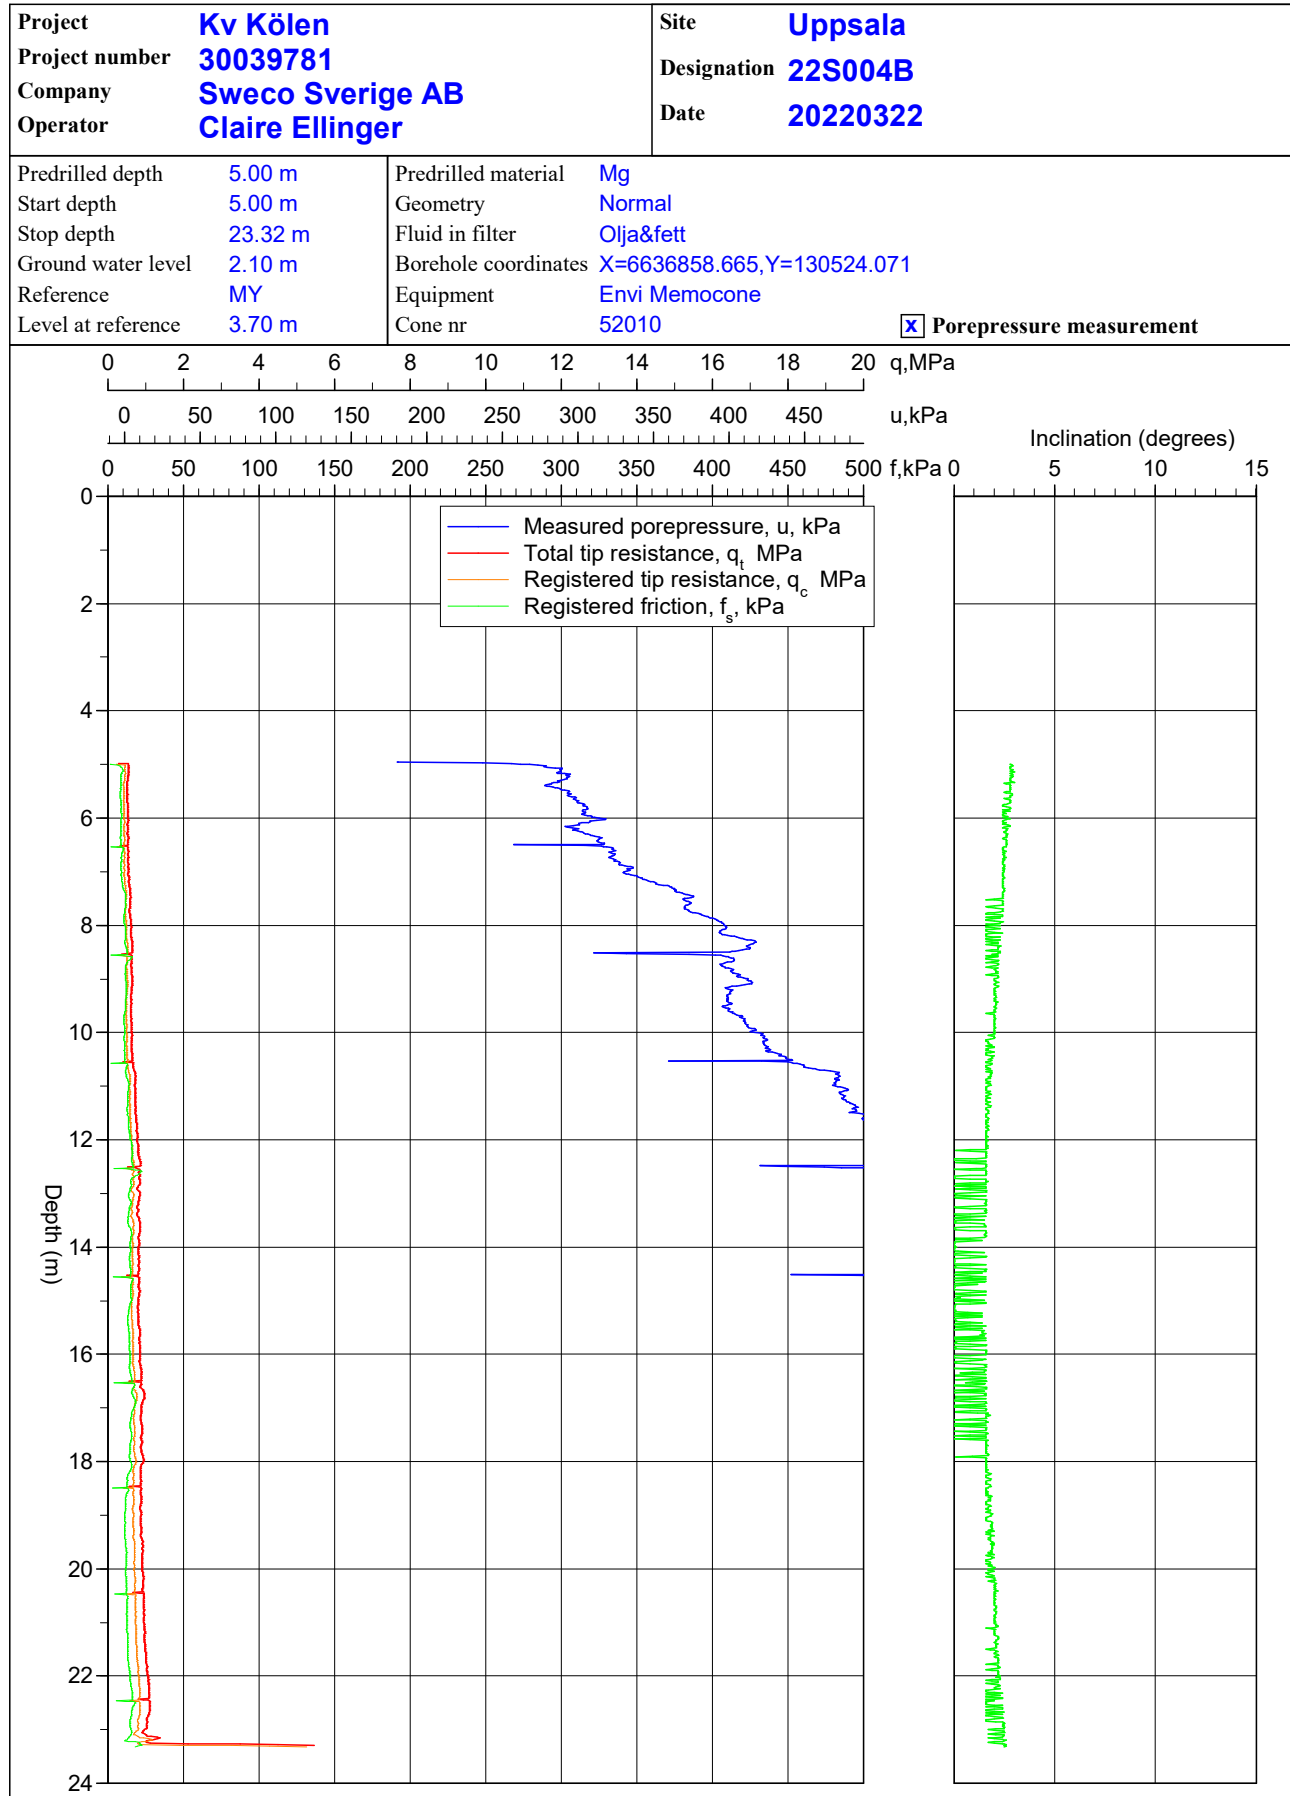

CPT-test performed according to EN ISO 22476-1

Predrilling depth	2.50 m	Reference	MY	Fluid in filter	Olja&fett
Start depth	2.50 m	Level at reference	3.55 m	Coordinats	X=6636936.178,Y=130647.251
Stop depth	35.57 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	1.95 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S005
Date	20220322

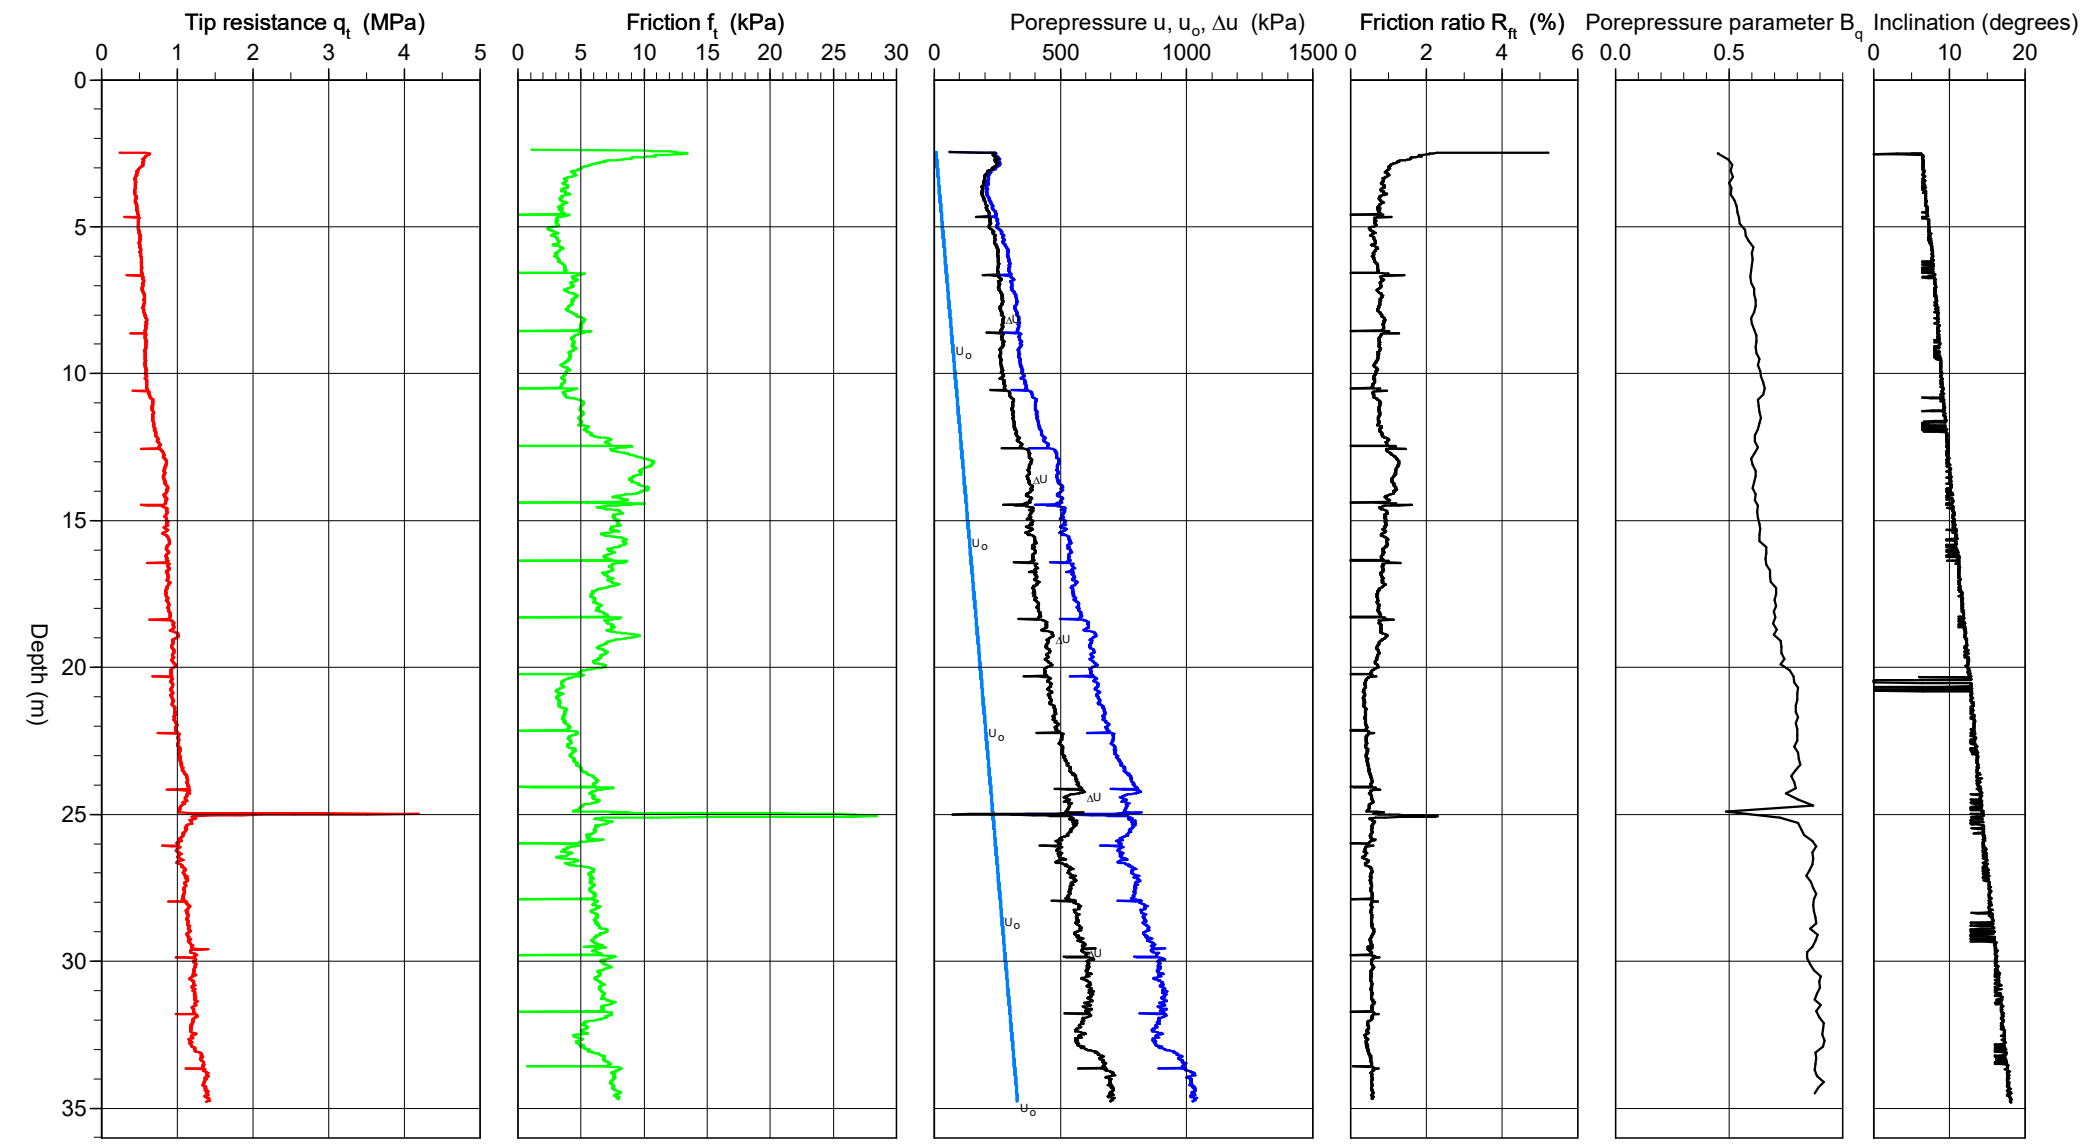

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S005
 Date 20220322


Reference MY Predrilling depth 2.50 m Evaluator INPRAG
 Level at reference 3.55 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 1.95 m Equipment Envi Memocone
 Start depth 2.50 m Geometry Normal

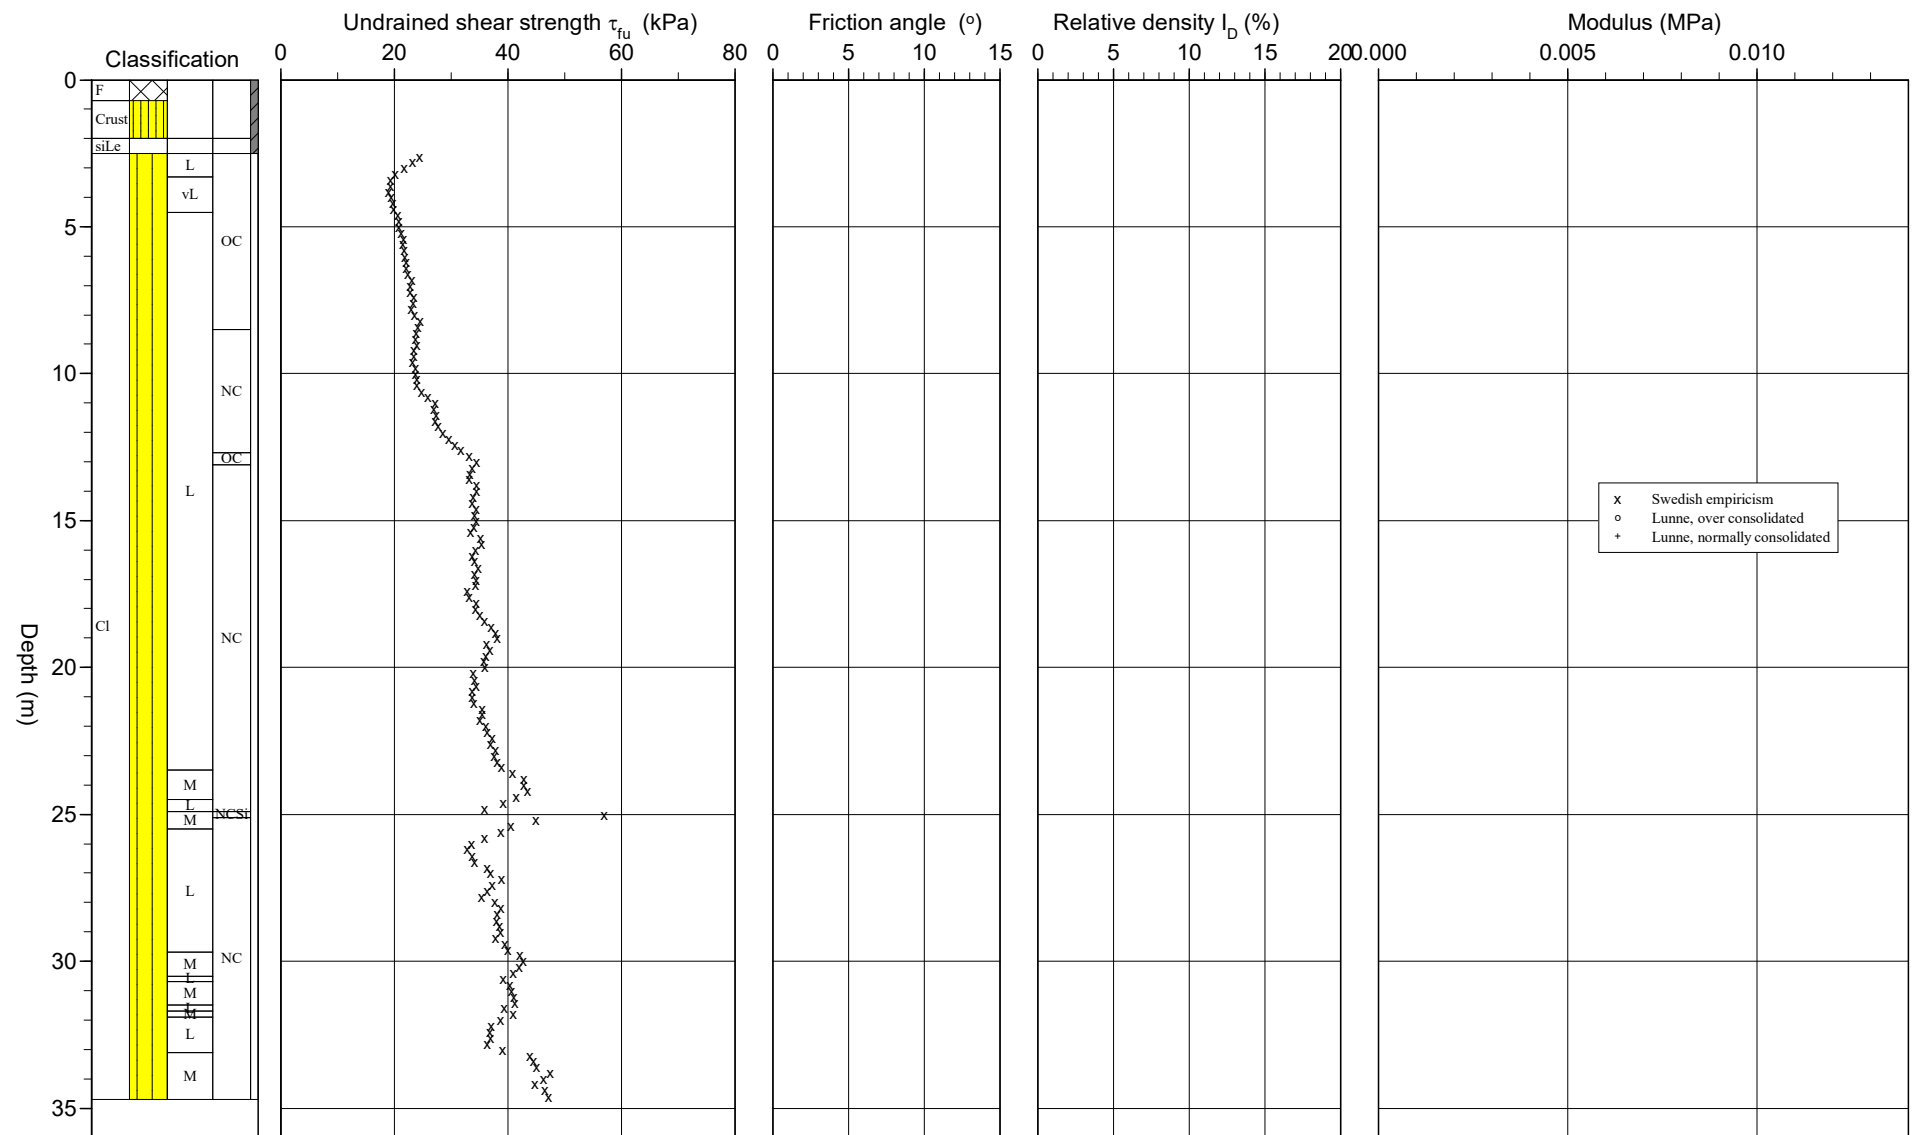

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	MY	Predrilling depth	2.50 m	Evaluator	INPRAG
Ground water level	3.55 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	1.95 m	Equipment	Envi Memocone		
Start depth	2.50 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S005
Date	20220322

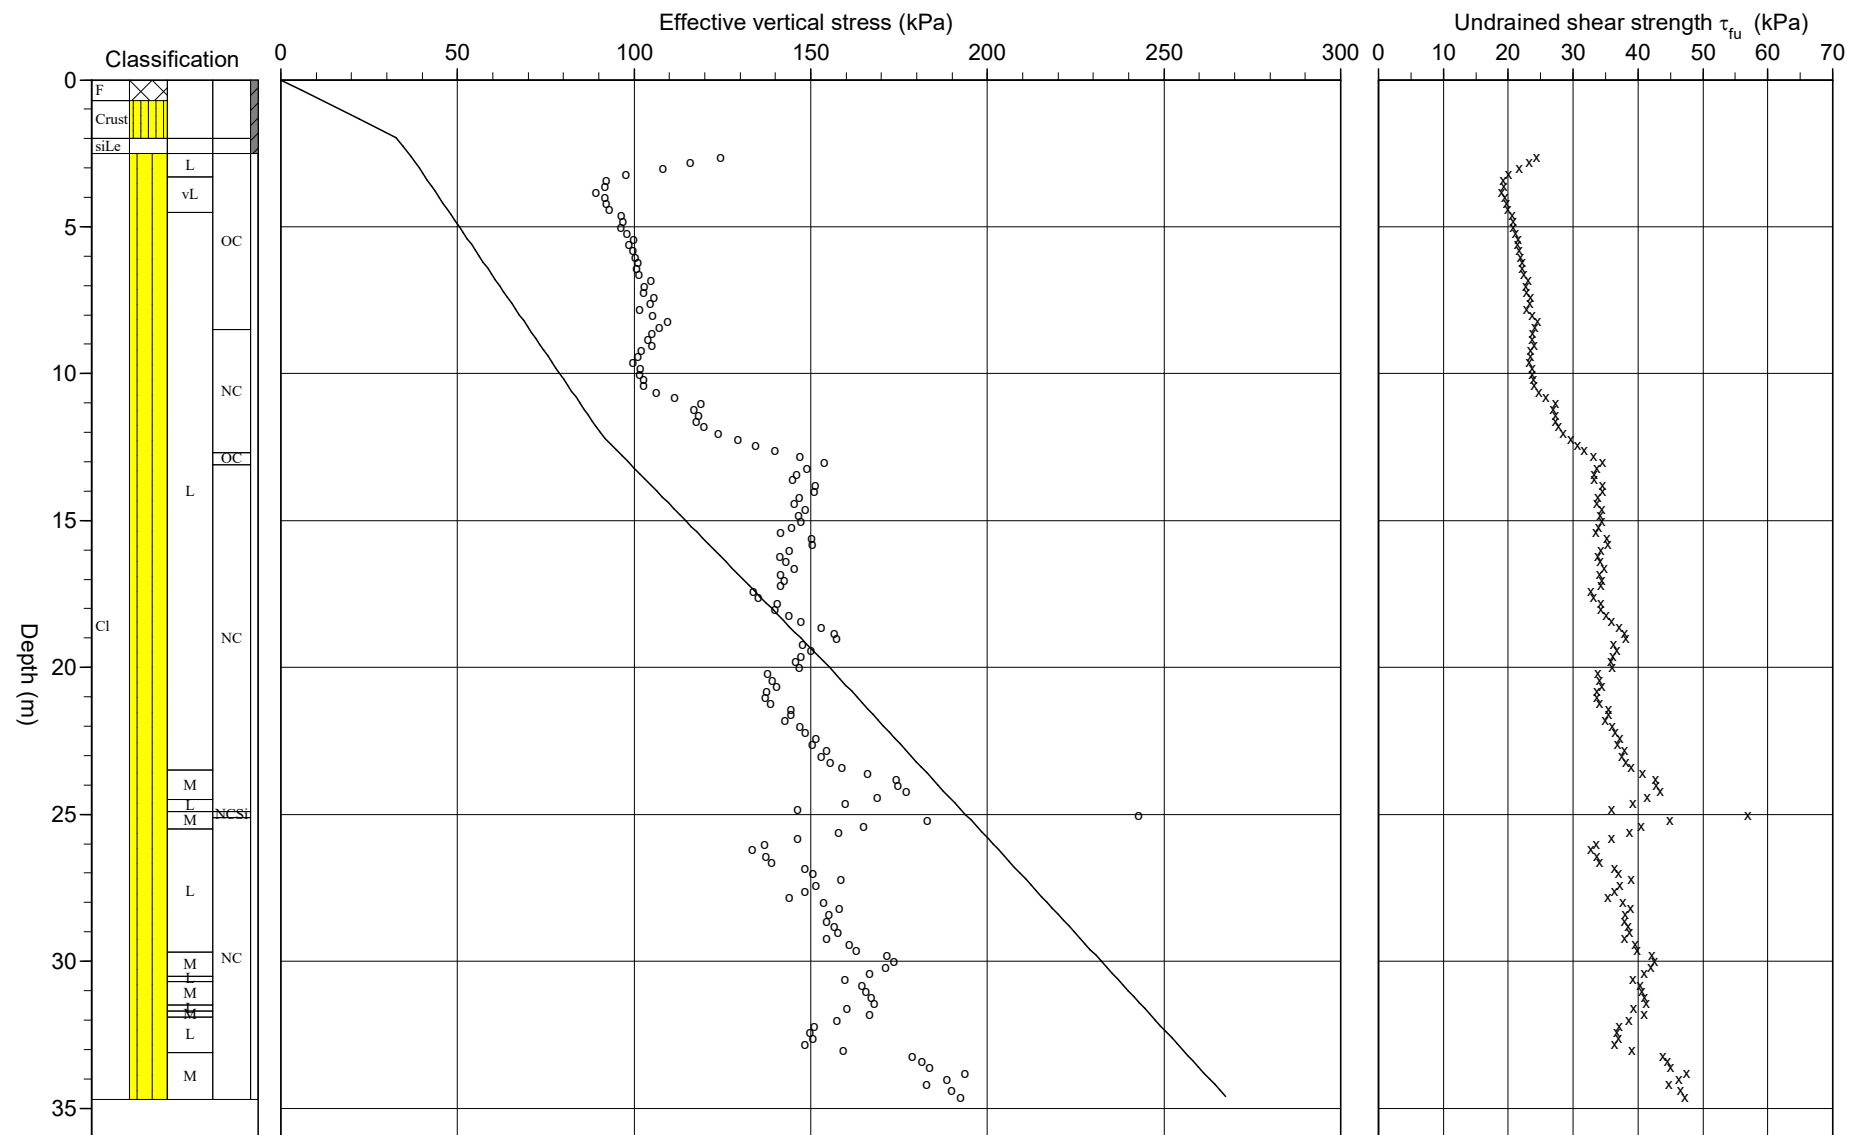

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S005 Date 20220322																																																	
Predrilling depth 2.50 m Start depth 2.50 m Stop depth 35.57 m Ground water level 1.95 m Reference MY Level at reference 3.55 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																																		
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>-4.20</td> <td>-0.10</td> <td>0.05</td> </tr> <tr> <td>Diff</td> <td>-4.20</td> <td>-0.10</td> <td>0.05</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	-4.20	-0.10	0.05	Diff	-4.20	-0.10	0.05																																
	Porepressure	Friction	Tip resistance																																																
Before	0.00	0.00	0.00																																																
After	-4.20	-0.10	0.05																																																
Diff	-4.20	-0.10	0.05																																																
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																															
Porepressure		Friction		Tip resistance																																															
Range	Code	Range	Code	Range	Code																																														
<input type="checkbox"/> Use scale factors																																																			
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>1.95</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	1.95	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.00</td> <td>1.70</td> <td></td> <td>Crust</td> </tr> <tr> <td>2.00</td> <td>2.50</td> <td>1.70</td> <td>0.37</td> <td>siLe</td> </tr> <tr> <td>2.50</td> <td>3.00</td> <td>1.64</td> <td>0.70</td> <td></td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td>1.59</td> <td>0.67</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td>1.60</td> <td>0.67</td> <td></td> </tr> <tr> <td>5.00</td> <td>34.69</td> <td></td> <td>0.67</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.00	0.70	1.70		F	0.70	2.00	1.70		Crust	2.00	2.50	1.70	0.37	siLe	2.50	3.00	1.64	0.70		3.00	4.00	1.59	0.67		4.00	5.00	1.60	0.67		5.00	34.69		0.67	
Depth (m)	Porepressure (kPa)																																																		
1.95	0.00																																																		
Depth (m)																																																			
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																															
From	To																																																		
0.00	0.70	1.70		F																																															
0.70	2.00	1.70		Crust																																															
2.00	2.50	1.70	0.37	siLe																																															
2.50	3.00	1.64	0.70																																																
3.00	4.00	1.59	0.67																																																
4.00	5.00	1.60	0.67																																																
5.00	34.69		0.67																																																
Notes 																																																			

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S005 Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.95	Crust	1.70				22.1	22.1						
1.95	2.00	Crust	1.70				32.9	32.7						
2.00	2.50	siLe	1.70	0.37			37.5	34.5						
2.50	2.70	CI L	OC 1.64	0.70	24.4		43.3	36.8	124.4	3.39				
2.70	2.90	CI L	OC 1.64	0.70	23.2		46.5	38.0	115.8	3.05				
2.90	3.10	CI L	OC 1.59	0.67	21.7		49.7	39.2	108.3	2.76				
3.10	3.30	CI L	OC 1.59	0.67	20.1		52.8	40.3	97.7	2.42				
3.30	3.50	CI vL	OC 1.59	0.67	19.3		55.9	41.4	92.2	2.23				
3.50	3.70	CI vL	OC 1.59	0.67	19.3		59.1	42.5	91.8	2.16				
3.70	3.90	CI vL	OC 1.59	0.67	19.0		62.2	43.7	89.2	2.04				
3.90	4.10	CI vL	OC 1.60	0.67	19.5		65.3	44.8	91.7	2.05				
4.10	4.30	CI vL	OC 1.60	0.67	19.7		68.4	45.9	92.1	2.01				
4.30	4.50	CI vL	OC 1.60	0.67	19.9		71.6	47.1	93.1	1.98				
4.50	4.70	CI L	OC 1.60	0.67	20.6		74.7	48.2	96.5	2.00				
4.70	4.90	CI L	OC 1.60	0.67	20.8		77.9	49.3	96.9	1.96				
4.90	5.10	CI L	OC 1.60	0.67	20.7		81.0	50.5	96.1	1.90				
5.10	5.30	CI L	OC 1.60	0.67	21.2		84.1	51.6	98.0	1.90				
5.30	5.50	CI L	OC 1.60	0.67	21.6		87.3	52.8	99.9	1.89				
5.50	5.70	CI L	OC 1.60	0.67	21.4		90.4	53.9	98.5	1.83				
5.70	5.90	CI L	OC 1.60	0.67	21.7		93.5	55.0	99.6	1.81				
5.90	6.10	CI L	OC 1.60	0.67	21.9		96.7	56.2	100.4	1.79				
6.10	6.30	CI L	OC 1.60	0.67	22.1		99.8	57.3	101.1	1.76				
6.30	6.50	CI L	OC 1.60	0.67	22.2		103.0	58.5	100.6	1.72				
6.50	6.70	CI L	OC 1.60	0.67	22.4		106.1	59.6	101.3	1.70				
6.70	6.90	CI L	OC 1.60	0.67	23.1		109.2	60.7	104.8	1.73				
6.90	7.10	CI L	OC 1.60	0.67	22.8		112.4	61.9	102.8	1.66				
7.10	7.30	CI L	OC 1.60	0.67	22.8		115.5	63.0	102.6	1.63				
7.30	7.50	CI L	OC 1.60	0.67	23.5		118.7	64.2	105.7	1.65				
7.50	7.70	CI L	OC 1.60	0.67	23.4		121.8	65.3	104.6	1.60				
7.70	7.90	CI L	OC 1.60	0.67	22.9		124.9	66.4	101.6	1.53				
7.90	8.10	CI L	OC 1.60	0.67	23.6		128.1	67.6	105.2	1.56				
8.10	8.30	CI L	OC 1.60	0.67	24.5		131.2	68.7	109.4	1.59				
8.30	8.50	CI L	OC 1.60	0.67	24.1		134.4	69.8	107.2	1.53				
8.50	8.70	CI L	NC 1.60	0.67	23.8		137.5	71.0	104.9	1.48				
8.70	8.90	CI L	NC 1.60	0.67	23.7		140.6	72.1	103.8	1.44				
8.90	9.10	CI L	NC 1.60	0.67	24.0		143.8	73.3	105.1	1.43				
9.10	9.30	CI L	NC 1.60	0.67	23.5		146.9	74.4	101.9	1.37				
9.30	9.50	CI L	NC 1.60	0.67	23.4		150.1	75.5	101.2	1.34				
9.50	9.70	CI L	NC 1.60	0.67	23.2		153.2	76.7	99.6	1.30				
9.70	9.90	CI L	NC 1.60	0.67	23.7		156.3	77.8	101.8	1.31				
9.90	10.10	CI L	NC 1.60	0.67	23.7		159.5	79.0	101.6	1.29				
10.10	10.30	CI L	NC 1.60	0.67	24.0		162.6	80.1	102.6	1.28				
10.30	10.50	CI L	NC 1.60	0.67	24.0		165.7	81.2	102.7	1.26				
10.50	10.70	CI L	NC 1.60	0.67	24.8		168.9	82.4	106.2	1.29				
10.70	10.90	CI L	NC 1.60	0.67	25.8		172.0	83.5	111.4	1.33				
10.90	11.10	CI L	NC 1.60	0.67	27.3		175.2	84.7	118.8	1.40				
11.10	11.30	CI L	NC 1.60	0.67	27.0		178.3	85.8	117.1	1.36				
11.30	11.50	CI L	NC 1.60	0.67	27.3		181.4	86.9	118.3	1.36				
11.50	11.70	CI L	NC 1.60	0.67	27.3		184.6	88.1	117.7	1.34				
11.70	11.90	CI L	NC 1.60	0.67	27.7		187.7	89.2	119.8	1.34				
11.90	12.10	CI L	NC 1.60	0.67	28.5		190.9	90.4	123.8	1.37				
12.10	12.30	CI L	NC 1.85	0.67	29.6		194.2	91.7	129.4	1.41				
12.30	12.50	CI L	NC 1.85	0.67	30.7		197.9	93.4	134.4	1.44				
12.50	12.70	CI L	NC 1.85	0.67	31.8		201.5	95.0	139.9	1.47				
12.70	12.90	CI L	OC 1.85	0.67	33.2		205.1	96.6	147.0	1.52				
12.90	13.10	CI L	OC 1.85	0.67	34.5		208.8	98.3	153.9	1.57				
13.10	13.30	CI L	NC 1.85	0.67	33.8		212.4	99.9	149.0	1.49				
13.30	13.50	CI L	NC 1.85	0.67	33.3		216.0	101.5	145.9	1.44				
13.50	13.70	CI L	NC 1.85	0.67	33.2		219.7	103.1	144.9	1.40				
13.70	13.90	CI L	NC 1.85	0.67	34.5		223.3	104.8	151.2	1.44				
13.90	14.10	CI L	NC 1.85	0.67	34.6		226.9	106.4	151.2	1.42				
14.10	14.30	CI L	NC 1.85	0.67	33.9		230.5	108.0	146.8	1.36				
14.30	14.50	CI L	NC 1.85	0.67	33.7		234.2	109.7	145.3	1.33				
14.50	14.70	CI L	NC 1.85	0.67	34.4		237.8	111.3	148.5	1.33				
14.70	14.90	CI L	NC 1.85	0.67	34.1		241.4	112.9	146.5	1.30				
14.90	15.10	CI L	NC 1.85	0.67	34.4		245.1	114.6	147.3	1.29				
15.10	15.30	CI L	NC 1.85	0.67	34.0		248.7	116.2	144.6	1.24				
15.30	15.50	CI L	NC 1.85	0.67	33.5		252.3	117.8	141.4	1.20				
15.50	15.70	CI L	NC 1.85	0.67	35.2		256.0	119.4	150.3	1.26				
15.70	15.90	CI L	NC 1.85	0.67	35.3		259.6	121.1	150.4	1.24				
15.90	16.10	CI L	NC 1.85	0.67	34.2		263.2	122.7	144.1	1.17				
16.10	16.30	CI L	NC 1.85	0.67	33.8		266.8	124.3	141.3	1.14				
16.30	16.50	CI L	NC 1.85	0.67	34.2		270.5	126.0	142.9	1.13				
16.50	16.70	CI L	NC 1.85	0.67	34.7		274.1	127.6	145.3	1.14				
16.70	16.90	CI L	NC 1.85	0.67	34.1		277.7	129.2	141.5	1.09				
16.90	17.10	CI L	NC 1.85	0.67	34.4		281.4	130.9	142.4	1.09				


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S005										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.10	17.30	CIL	NC	1.85	0.67	34.3		285.0	132.5	141.5	1.07			
17.30	17.50	CIL	NC	1.85	0.67	32.8		288.6	134.1	133.7	1.00			
17.50	17.70	CIL	NC	1.85	0.67	33.2		292.2	135.7	135.2	1.00			
17.70	17.90	CIL	NC	1.85	0.67	34.3		295.9	137.4	140.6	1.02			
17.90	18.10	CIL	NC	1.85	0.67	34.3		299.5	139.0	140.0	1.01			
18.10	18.30	CIL	NC	1.85	0.67	35.1		303.1	140.6	143.7	1.02			
18.30	18.50	CIL	NC	1.85	0.67	35.9		306.8	142.3	147.3	1.04			
18.50	18.70	CIL	NC	1.85	0.67	37.1		310.4	143.9	153.1	1.06			
18.70	18.90	CIL	NC	1.85	0.67	37.9		314.0	145.5	156.7	1.08			
18.90	19.10	CIL	NC	1.85	0.67	38.1		317.7	147.1	157.4	1.07			
19.10	19.30	CIL	NC	1.85	0.67	36.2		321.3	148.8	147.7	1.00			
19.30	19.50	CIL	NC	1.85	0.67	36.8		324.9	150.4	150.0	1.00			
19.50	19.70	CIL	NC	1.85	0.67	36.1		328.5	152.0	147.2	1.00			
19.70	19.90	CIL	NC	1.85	0.67	35.8		332.2	153.7	145.8	1.00			
19.90	20.10	CIL	NC	1.85	0.67	36.0		335.8	155.3	146.7	1.00			
20.10	20.30	CIL	NC	1.80	0.67	33.8		339.4	156.9	137.8	1.00			
20.30	20.50	CIL	NC	1.80	0.67	34.1		342.9	158.4	139.0	1.00			
20.50	20.70	CIL	NC	1.80	0.67	34.4		346.4	159.9	140.3	1.00			
20.70	20.90	CIL	NC	1.80	0.67	33.8		350.0	161.5	137.6	1.00			
20.90	21.10	CIL	NC	1.80	0.67	33.7		353.5	163.0	137.2	1.00			
21.10	21.30	CIL	NC	1.80	0.67	34.0		357.0	164.5	138.7	1.00			
21.30	21.50	CIL	NC	1.80	0.67	35.5		360.6	166.1	144.5	1.00			
21.50	21.70	CIL	NC	1.80	0.67	35.4		364.1	167.6	144.3	1.00			
21.70	21.90	CIL	NC	1.80	0.67	35.0		367.6	169.1	142.8	1.00			
21.90	22.10	CIL	NC	1.80	0.67	36.1		371.2	170.7	147.0	1.00			
22.10	22.30	CIL	NC	1.80	0.67	36.5		374.7	172.2	148.6	1.00			
22.30	22.50	CIL	NC	1.80	0.67	37.2		378.2	173.7	151.5	1.00			
22.50	22.70	CIL	NC	1.80	0.67	36.9		381.8	175.3	150.4	1.00			
22.70	22.90	CIL	NC	1.80	0.67	37.9		385.3	176.8	154.5	1.00			
22.90	23.10	CIL	NC	1.80	0.67	37.6		388.8	178.3	153.1	1.00			
23.10	23.30	CIL	NC	1.80	0.67	38.2		392.4	179.9	155.6	1.00			
23.30	23.50	CIL	NC	1.80	0.67	39.0		395.9	181.4	158.8	1.00			
23.50	23.70	CIM	NC	1.80	0.67	40.8		399.4	182.9	166.1	1.00			
23.70	23.90	CIM	NC	1.80	0.67	42.7		403.0	184.4	174.2	1.00			
23.90	24.10	CIM	NC	1.80	0.67	42.8		406.5	186.0	174.6	1.00			
24.10	24.30	CIM	NC	1.80	0.67	43.4		410.0	187.5	176.9	1.00			
24.30	24.50	CIM	NC	1.85	0.67	41.4		413.6	189.1	168.8	1.00			
24.50	24.70	CIL	NC	1.80	0.67	39.2		417.2	190.7	159.8	1.00			
24.70	24.90	CIL	NC	1.80	0.67	35.9		420.7	192.2	146.4	1.00			
24.90	25.10	CIM	NCSi	1.85	0.67	57.0		424.3	193.8	242.8	1.25			
25.10	25.30	CIM	NC	1.85	0.67	44.9		427.9	195.4	183.0	1.00			
25.30	25.50	CIM	NC	1.80	0.67	40.5		431.5	197.0	165.1	1.00			
25.50	25.70	CIL	NC	1.80	0.67	38.8		435.0	198.5	157.9	1.00			
25.70	25.90	CIL	NC	1.80	0.67	35.9		438.6	200.1	146.3	1.00			
25.90	26.10	CIL	NC	1.80	0.67	33.6		442.1	201.6	136.9	1.00			
26.10	26.30	CIL	NC	1.80	0.67	32.8		445.6	203.1	133.4	1.00			
26.30	26.50	CIL	NC	1.80	0.67	33.7		449.2	204.7	137.4	1.00			
26.50	26.70	CIL	NC	1.80	0.67	34.1		452.7	206.2	138.8	1.00			
26.70	26.90	CIL	NC	1.80	0.67	36.4		456.2	207.7	148.3	1.00			
26.90	27.10	CIL	NC	1.80	0.67	37.0		459.8	209.2	150.6	1.00			
27.10	27.30	CIL	NC	1.80	0.67	38.9		463.3	210.8	158.5	1.00			
27.30	27.50	CIL	NC	1.80	0.67	37.2		466.8	212.3	151.5	1.00			
27.50	27.70	CIL	NC	1.80	0.67	36.4		470.4	213.8	148.2	1.00			
27.70	27.90	CIL	NC	1.80	0.67	35.3		473.9	215.4	144.0	1.00			
27.90	28.10	CIL	NC	1.80	0.67	37.7		477.4	216.9	153.7	1.00			
28.10	28.30	CIL	NC	1.80	0.67	38.8		480.9	218.4	158.1	1.00			
28.30	28.50	CIL	NC	1.80	0.67	38.1		484.5	220.0	155.1	1.00			
28.50	28.70	CIL	NC	1.80	0.67	37.9		488.0	221.5	154.6	1.00			
28.70	28.90	CIL	NC	1.80	0.67	38.5		491.5	223.0	156.7	1.00			
28.90	29.10	CIL	NC	1.80	0.67	38.7		495.1	224.6	157.8	1.00			
29.10	29.30	CIL	NC	1.80	0.67	37.9		498.6	226.1	154.5	1.00			
29.30	29.50	CIL	NC	1.80	0.67	39.5		502.1	227.6	161.0	1.00			
29.50	29.70	CIL	NC	1.80	0.67	39.9		505.7	229.2	162.8	1.00			
29.70	29.90	CIM	NC	1.80	0.67	42.1		509.2	230.7	171.7	1.00			
29.90	30.10	CIM	NC	1.80	0.67	42.6		512.7	232.2	173.6	1.00			
30.10	30.30	CIM	NC	1.80	0.67	42.0		516.3	233.8	171.2	1.00			
30.30	30.50	CIM	NC	1.80	0.67	40.9		519.8	235.3	166.8	1.00			
30.50	30.70	CIL	NC	1.80	0.67	39.2		523.3	236.8	159.7	1.00			
30.70	30.90	CIM	NC	1.80	0.67	40.4		526.9	238.3	164.6	1.00			
30.90	31.10	CIM	NC	1.80	0.67	40.6		530.4	239.9	165.5	1.00			
31.10	31.30	CIM	NC	1.80	0.67	41.0		533.9	241.4	167.2	1.00			
31.30	31.50	CIM	NC	1.80	0.67	41.3		537.5	242.9	168.1	1.00			
31.50	31.70	CIL	NC	1.80	0.67	39.3		541.0	244.5	160.2	1.00			
31.70	31.90	CIM	NC	1.80	0.67	40.9		544.5	246.0	166.7	1.00			
31.90	32.10	CIL	NC	1.80	0.67	38.7		548.0	247.5	157.5	1.00			
32.10	32.30	CIL	NC	1.80	0.67	37.0		551.6	249.1	151.0	1.00			
32.30	32.50	CIL	NC	1.80	0.67	36.8		555.1	250.6	149.8	1.00			

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S005 Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
32.50	32.70	CI L	NC 1.80	0.67	37.0		558.6	252.1	150.7	1.00				
32.70	32.90	CI L	NC 1.80	0.67	36.4		562.2	253.7	148.3	1.00				
32.90	33.10	CI L	NC 1.80	0.67	39.0		565.7	255.2	159.1	1.00				
33.10	33.30	CI M	NC 1.80	0.67	43.9		569.2	256.7	178.7	1.00				
33.30	33.50	CI M	NC 1.80	0.67	44.6		572.8	258.3	181.5	1.00				
33.50	33.70	CI M	NC 1.80	0.67	45.1		576.3	259.8	183.7	1.00				
33.70	33.90	CI M	NC 1.80	0.67	47.5		579.8	261.3	193.6	1.00				
33.90	34.10	CI M	NC 1.80	0.67	46.3		583.4	262.9	188.5	1.00				
34.10	34.30	CI M	NC 1.80	0.67	44.9		586.9	264.4	182.8	1.00				
34.30	34.50	CI M	NC 1.80	0.67	46.6		590.4	265.9	189.9	1.00				
34.50	34.69	CI M	NC 1.80	0.67	47.2		593.9	267.4	192.5	1.00				


CPT-test performed according to EN ISO 22476-1

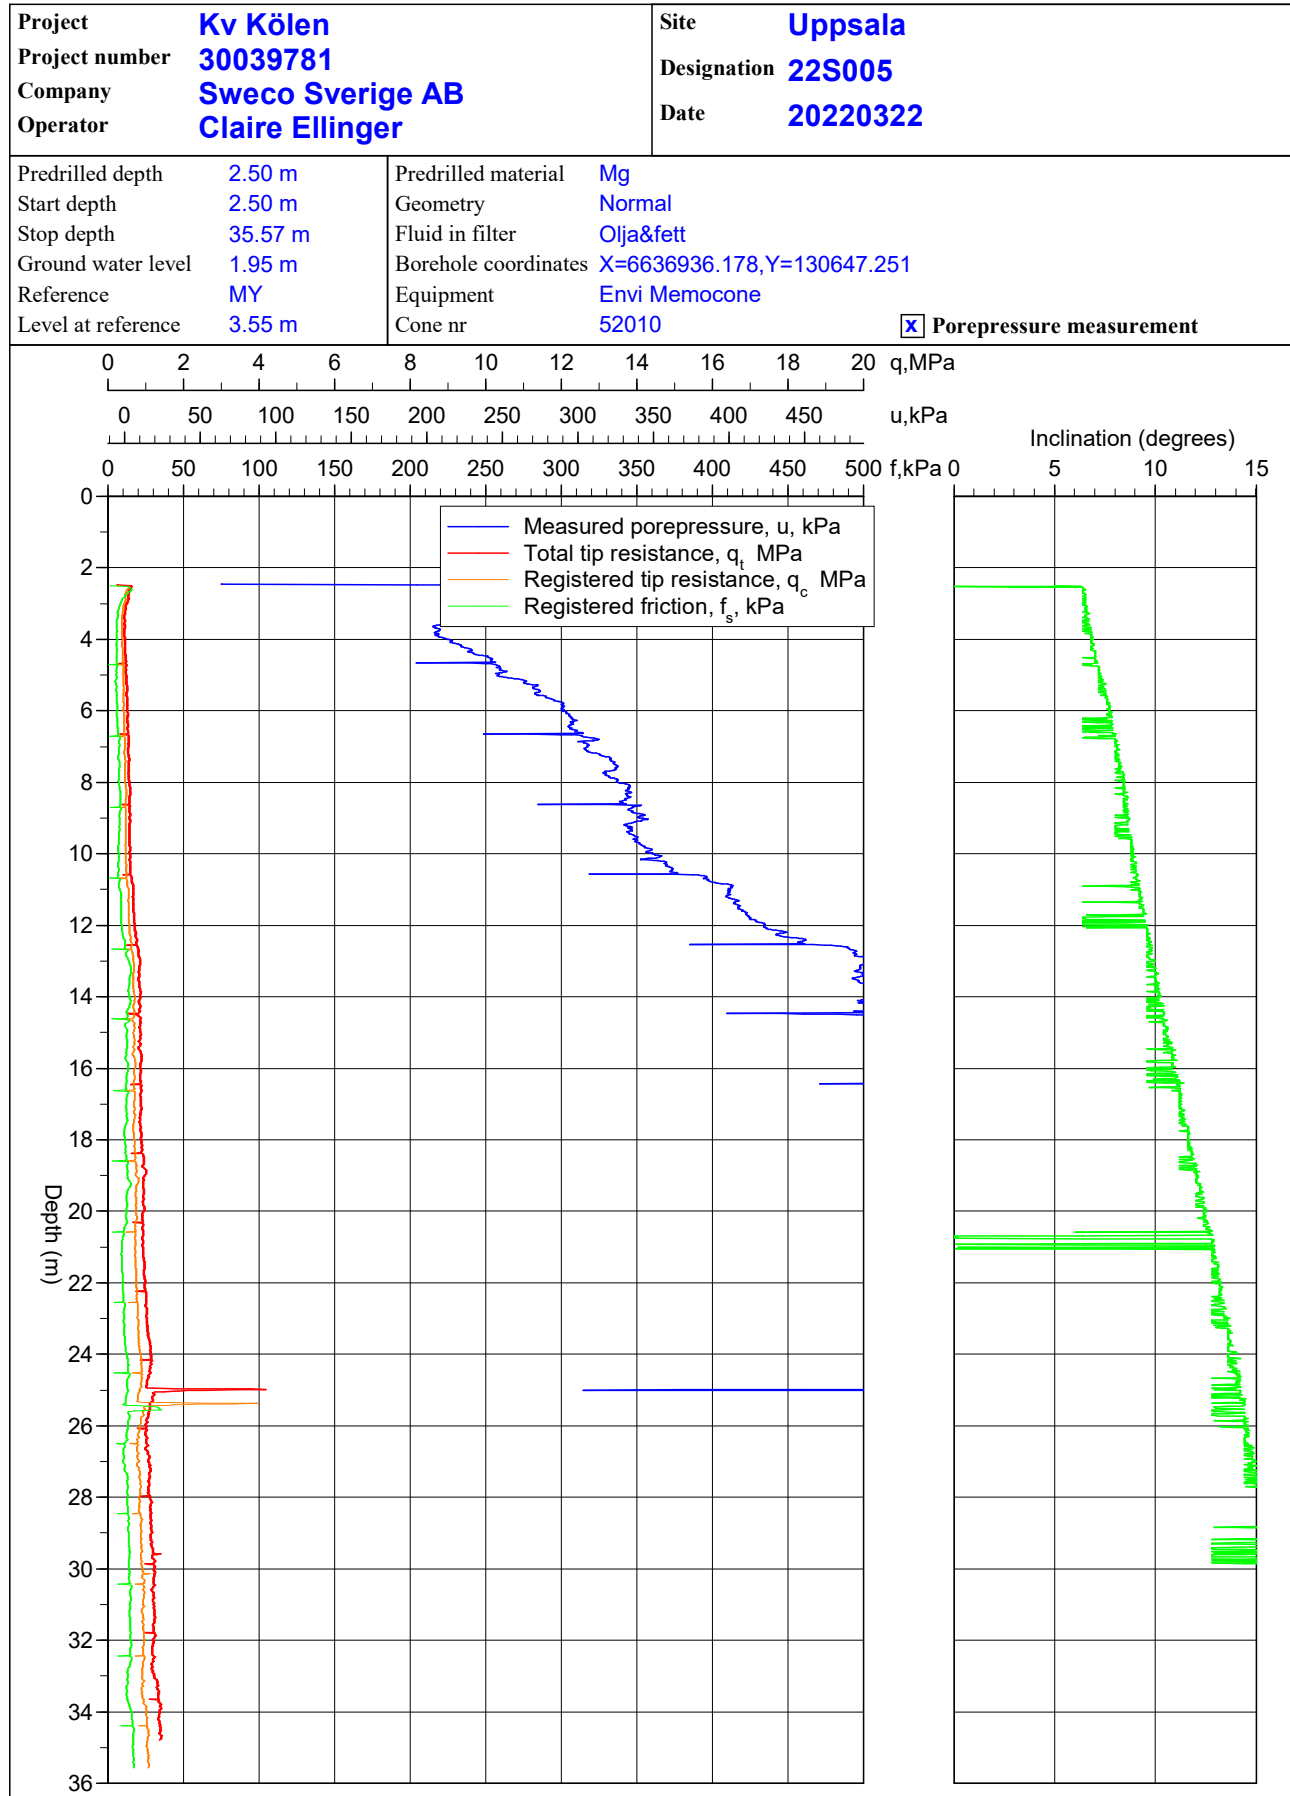

CPT-test performed according to EN ISO 22476-1

Predrilling depth	2.50 m	Reference	MY	Fluid in filter	Olja&fett
Start depth	2.50 m	Level at reference	3.48 m	Coordinates	X=6636978.336,Y=130762.603
Stop depth	35.44 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	1.89 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S006
Date	20220323

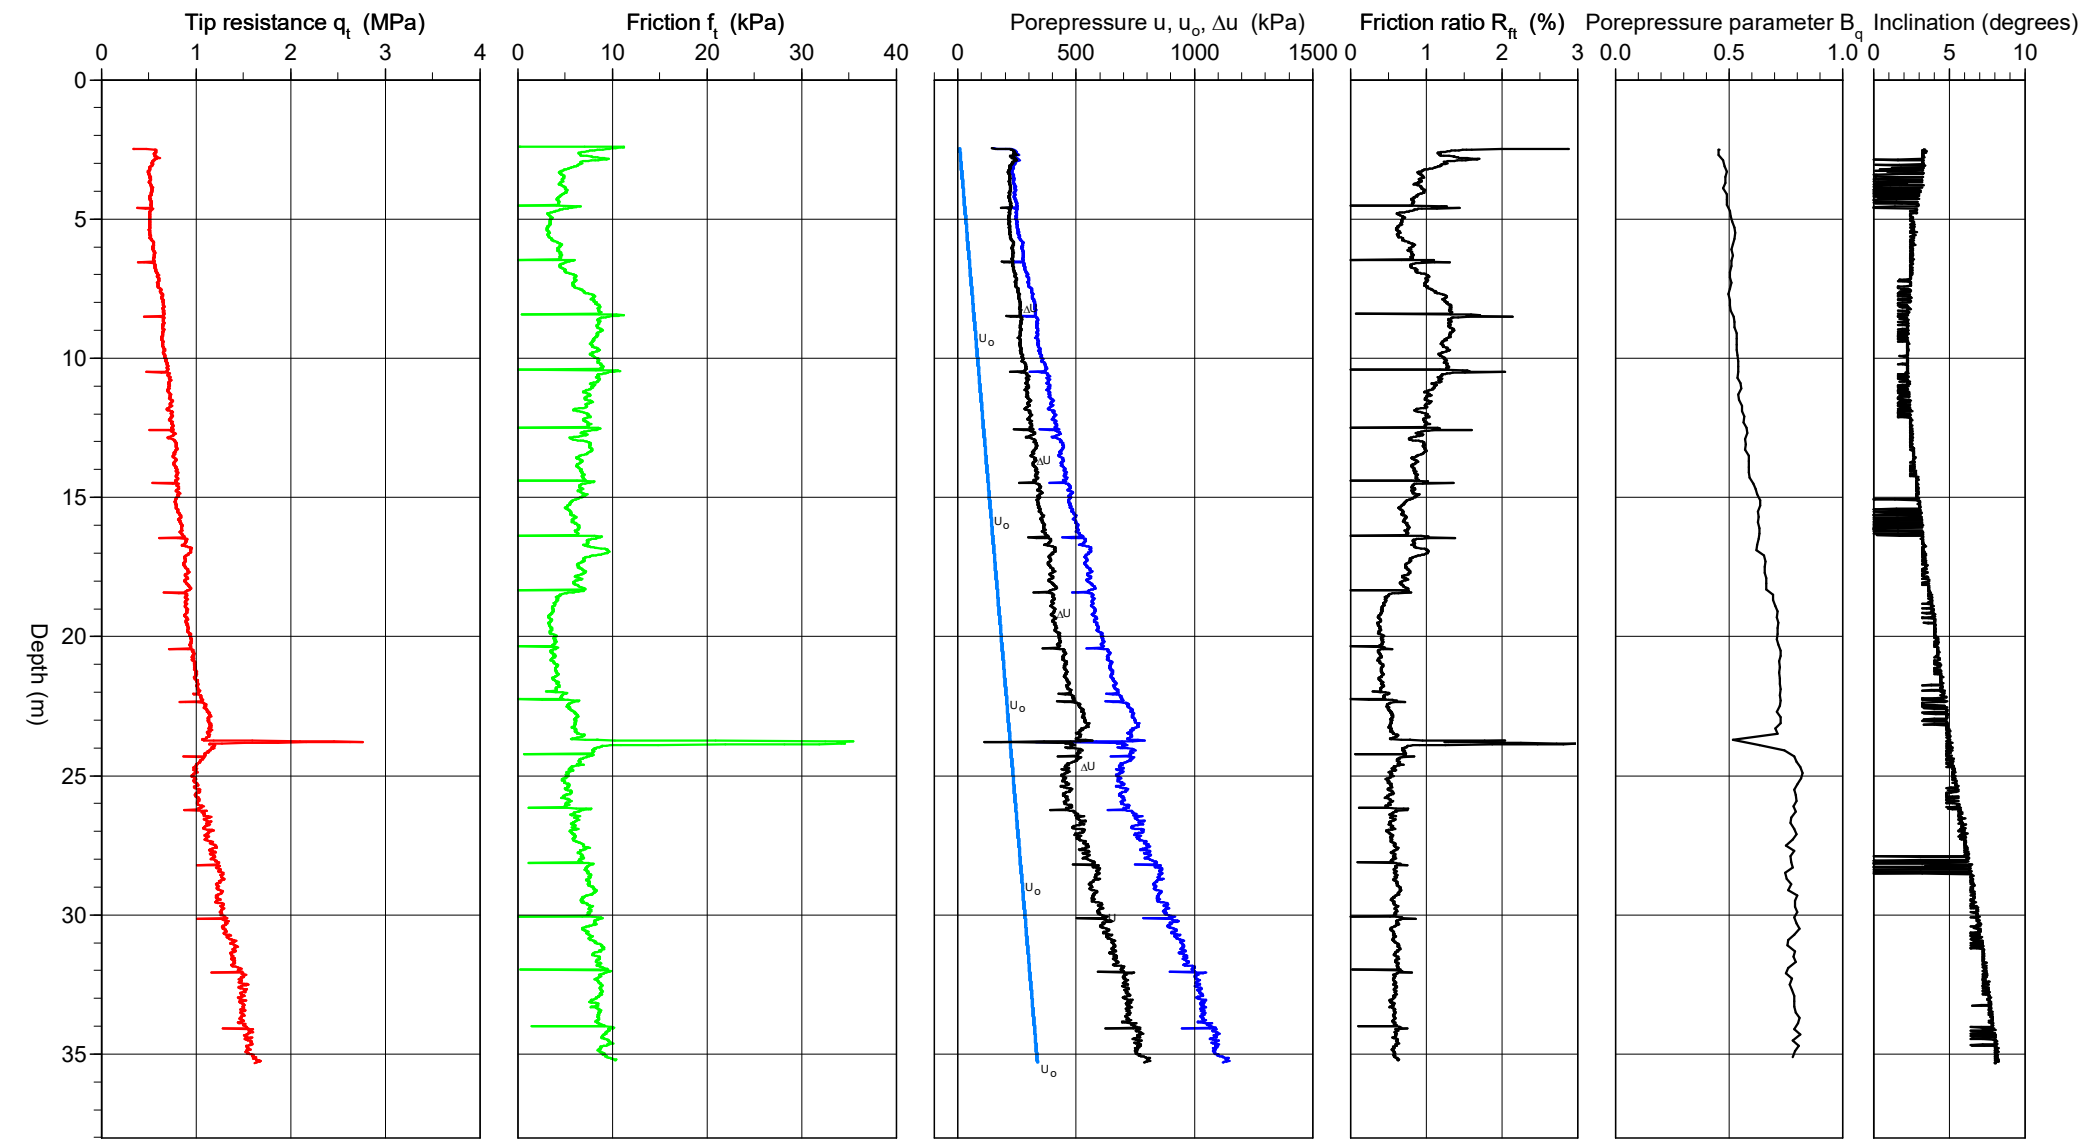

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S006
 Date 20220323


Reference MY Predrilling depth 2.50 m Evaluator INPRAG
 Level at reference 3.48 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 1.89 m Equipment Envi Memocone
 Start depth 2.50 m Geometry Normal

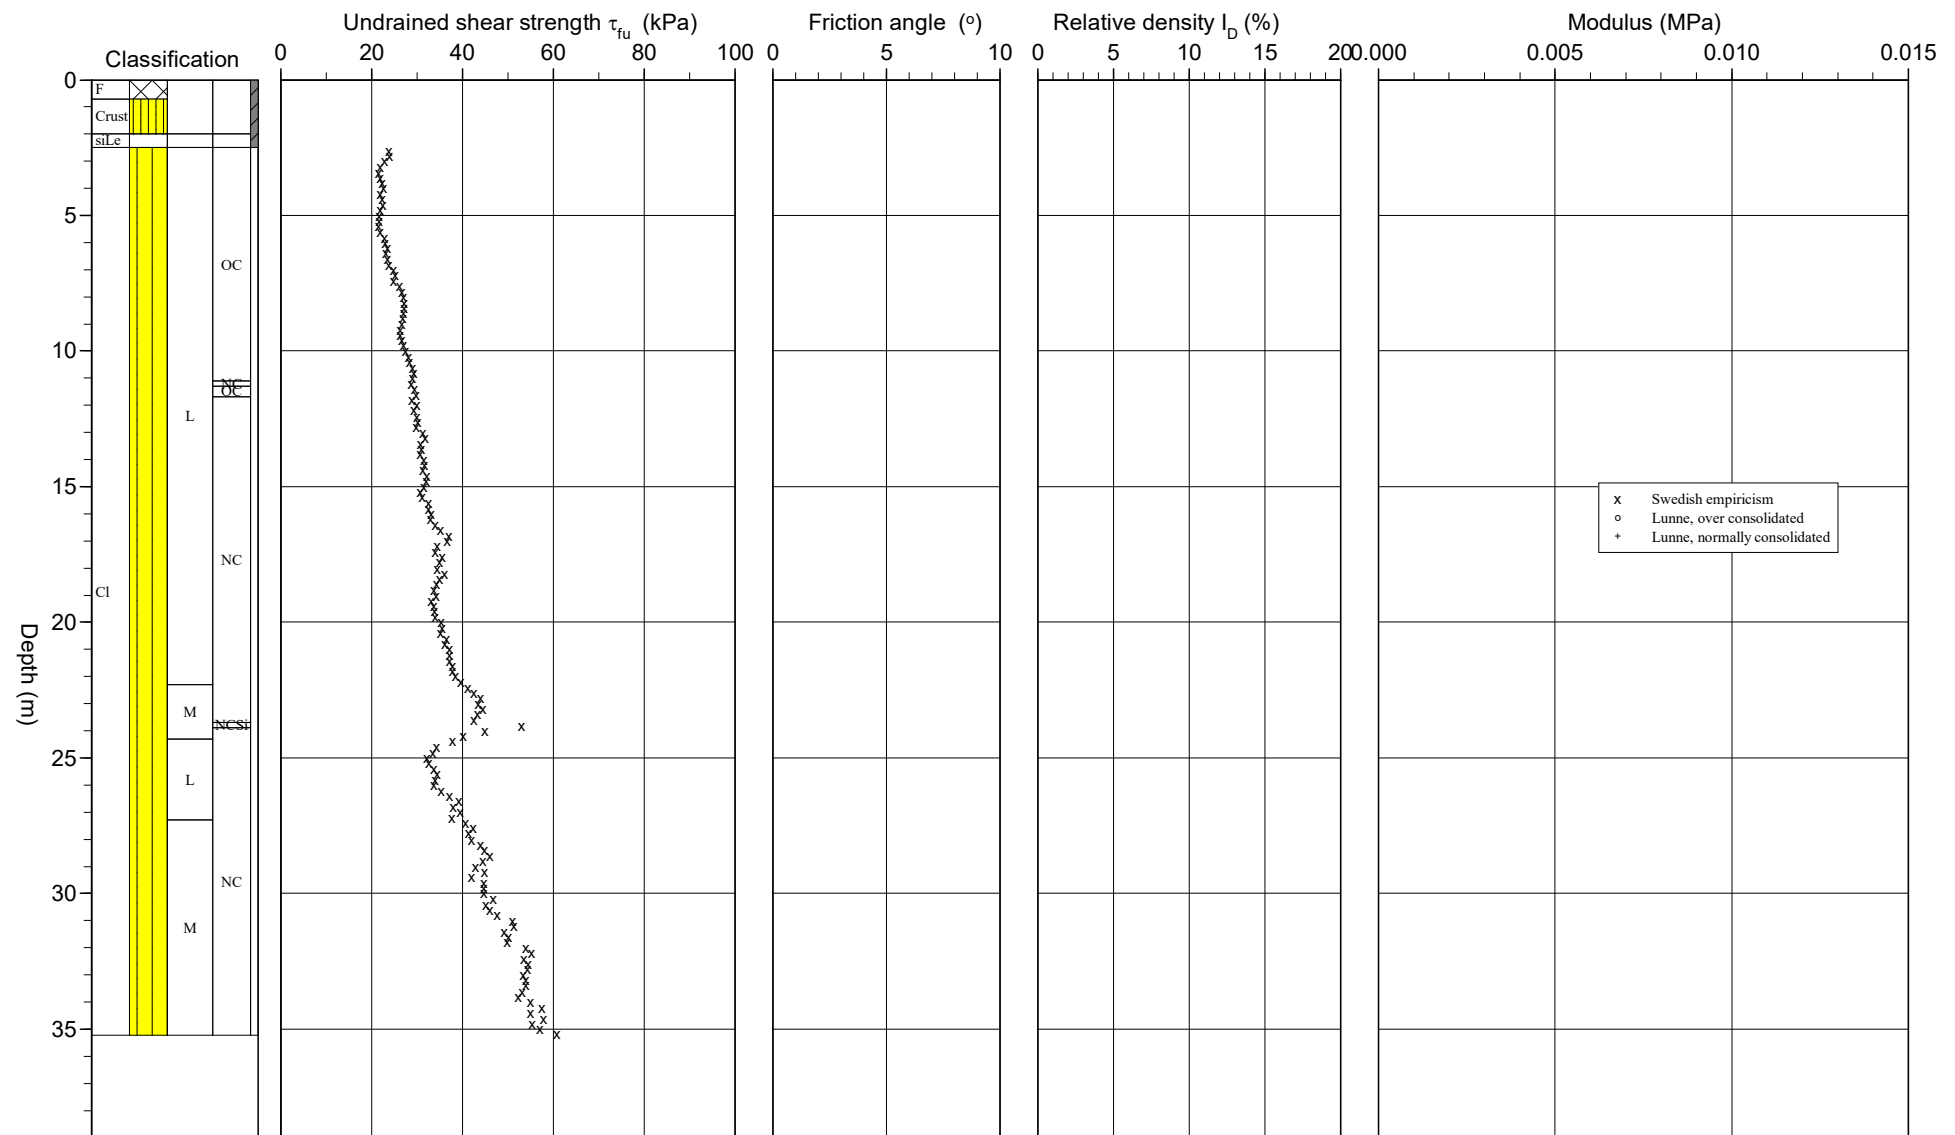

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	MY	Predrilling depth	2.50 m	Evaluator	INPRAG
Ground water level	3.48 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	1.89 m	Equipment	Envi Memocone		
Start depth	2.50 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S006
Date	20220323

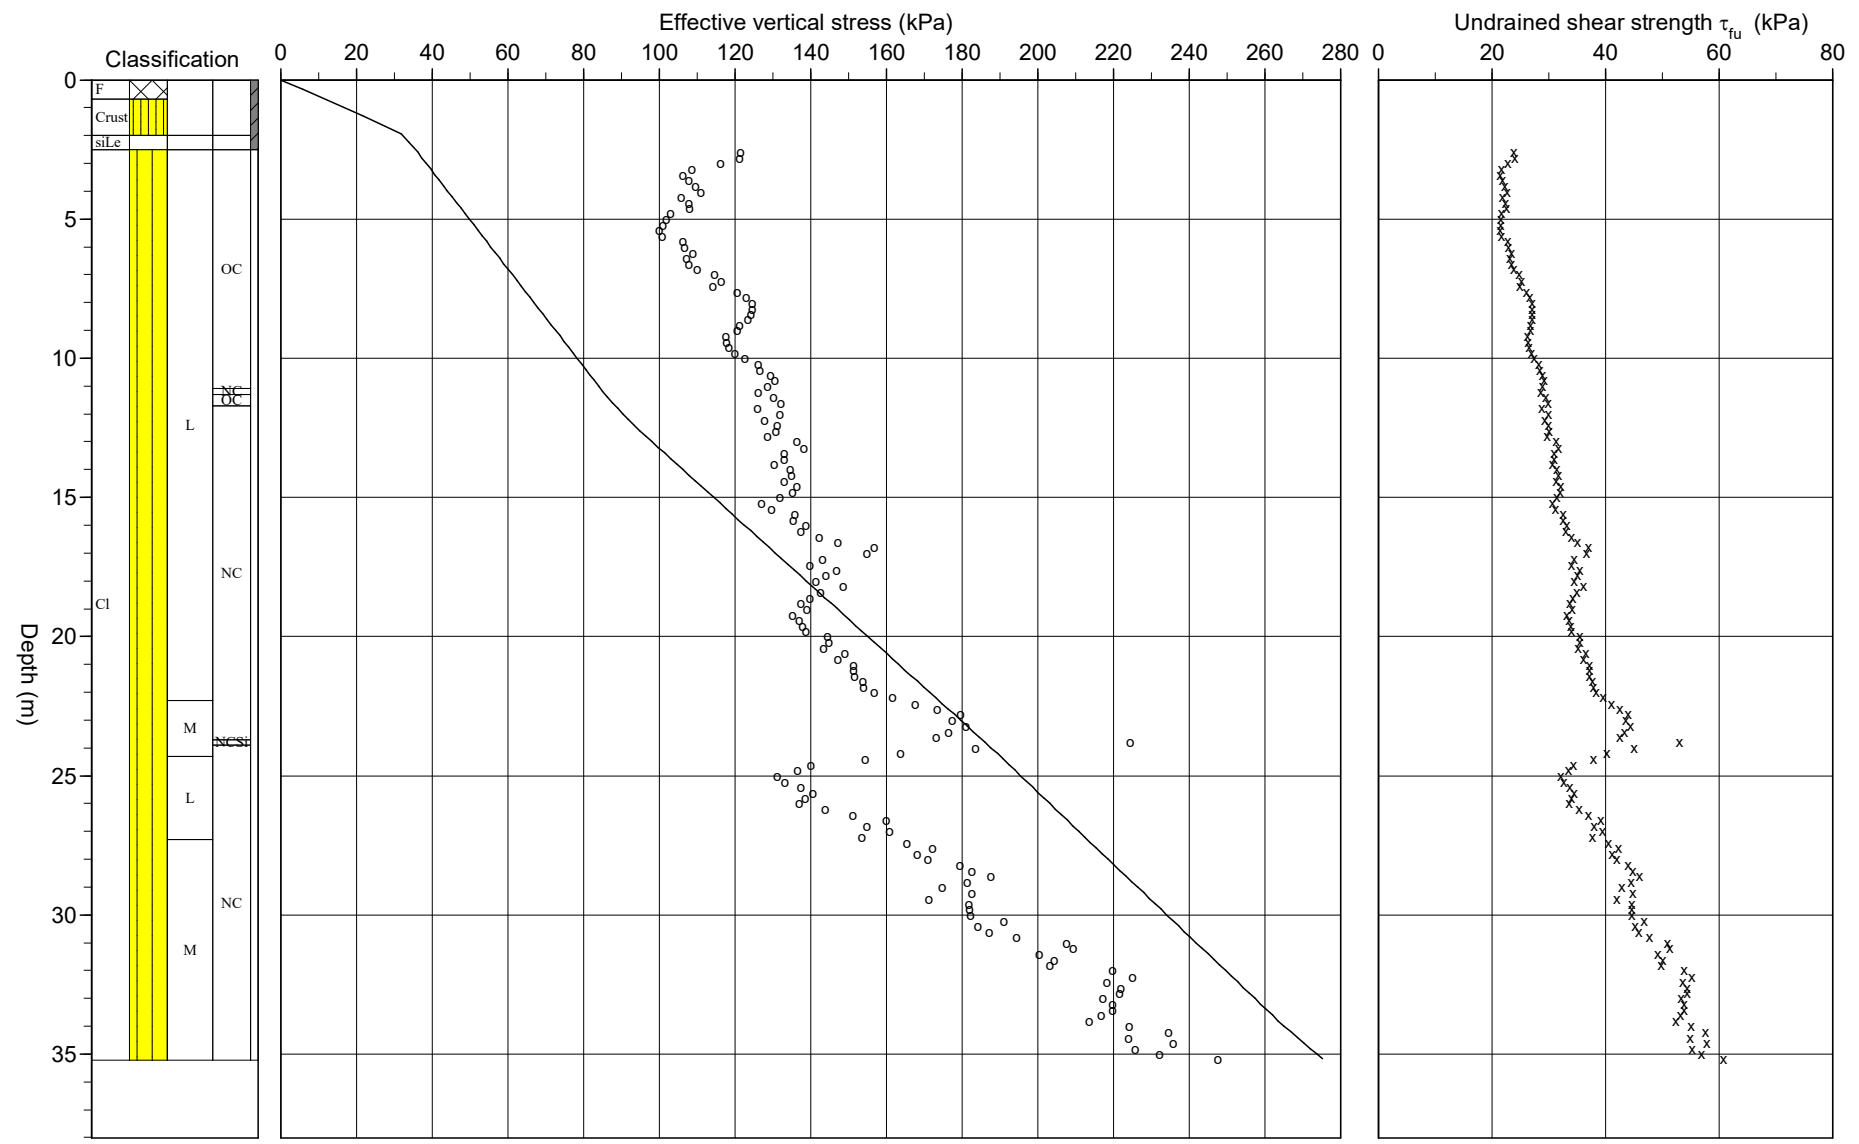

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S006 Date 20220323																																																	
Predrilling depth 2.50 m Start depth 2.50 m Stop depth 35.44 m Ground water level 1.89 m Reference MY Level at reference 3.48 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																																		
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>-1.60</td> <td>-0.20</td> <td>0.08</td> </tr> <tr> <td>Diff</td> <td>-1.60</td> <td>-0.20</td> <td>0.08</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	-1.60	-0.20	0.08	Diff	-1.60	-0.20	0.08																																
	Porepressure	Friction	Tip resistance																																																
Before	0.00	0.00	0.00																																																
After	-1.60	-0.20	0.08																																																
Diff	-1.60	-0.20	0.08																																																
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																															
Porepressure		Friction		Tip resistance																																															
Range	Code	Range	Code	Range	Code																																														
<input type="checkbox"/> Use scale factors																																																			
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>1.89</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	1.89	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td></td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th rowspan="2">Density (ton/m³)</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.00</td> <td>1.70</td> <td></td> <td>Crust</td> </tr> <tr> <td>2.00</td> <td>2.50</td> <td>1.70</td> <td>0.37</td> <td>siLe</td> </tr> <tr> <td>2.50</td> <td>3.00</td> <td></td> <td>0.70</td> <td></td> </tr> <tr> <td>3.00</td> <td>4.00</td> <td></td> <td>0.67</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.67</td> <td></td> </tr> <tr> <td>5.00</td> <td>35.23</td> <td></td> <td>0.67</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density (ton/m ³)	Liquid limit	Soil	From	To	0.00	0.70	1.70		F	0.70	2.00	1.70		Crust	2.00	2.50	1.70	0.37	siLe	2.50	3.00		0.70		3.00	4.00		0.67		4.00	5.00		0.67		5.00	35.23		0.67	
Depth (m)	Porepressure (kPa)																																																		
1.89	0.00																																																		
Depth (m)																																																			
Depth (m)		Density (ton/m ³)	Liquid limit	Soil																																															
From	To																																																		
0.00	0.70	1.70		F																																															
0.70	2.00	1.70		Crust																																															
2.00	2.50	1.70	0.37	siLe																																															
2.50	3.00		0.70																																																
3.00	4.00		0.67																																																
4.00	5.00		0.67																																																
5.00	35.23		0.67																																																
Notes 																																																			

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S006 Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.89	Crust	1.70				21.6	21.6						
1.89	2.00	Crust	1.70				32.4	31.8						
2.00	2.50	siLe	1.70	0.37			37.5	33.9						
2.50	2.70	Cl L	OC 1.60	0.70	23.8		43.3	36.1	121.3	3.36				
2.70	2.90	Cl L	OC 1.60	0.70	24.0		46.4	37.3	121.3	3.26				
2.90	3.10	Cl L	OC 1.60	0.67	22.8		49.5	38.4	116.2	3.03				
3.10	3.30	Cl L	OC 1.60	0.67	21.8		52.7	39.5	108.6	2.75				
3.30	3.50	Cl L	OC 1.60	0.67	21.5		55.8	40.7	106.2	2.61				
3.50	3.70	Cl L	OC 1.60	0.67	21.9		59.0	41.8	107.8	2.58				
3.70	3.90	Cl L	OC 1.60	0.67	22.3		62.1	42.9	109.6	2.55				
3.90	4.10	Cl L	OC 1.60	0.67	22.6		65.2	44.1	110.9	2.52				
4.10	4.30	Cl L	OC 1.60	0.67	21.9		68.4	45.2	105.8	2.34				
4.30	4.50	Cl L	OC 1.60	0.67	22.3		71.5	46.4	107.8	2.32				
4.50	4.70	Cl L	OC 1.60	0.67	22.5		74.7	47.5	108.0	2.27				
4.70	4.90	Cl L	OC 1.60	0.67	21.8		77.8	48.6	103.1	2.12				
4.90	5.10	Cl L	OC 1.60	0.67	21.6		80.9	49.8	101.7	2.04				
5.10	5.30	Cl L	OC 1.60	0.67	21.6		84.1	50.9	101.0	1.98				
5.30	5.50	Cl L	OC 1.60	0.67	21.5		87.2	52.1	99.9	1.92				
5.50	5.70	Cl L	OC 1.60	0.67	21.8		90.4	53.2	100.8	1.90				
5.70	5.90	Cl L	OC 1.60	0.67	22.8		93.5	54.3	106.2	1.96				
5.90	6.10	Cl L	OC 1.60	0.67	23.0		96.6	55.5	106.7	1.92				
6.10	6.30	Cl L	OC 1.60	0.67	23.4		99.8	56.6	108.8	1.92				
6.30	6.50	Cl L	OC 1.60	0.67	23.2		102.9	57.8	107.1	1.86				
6.50	6.70	Cl L	OC 1.60	0.67	23.4		106.0	58.9	107.8	1.83				
6.70	6.90	Cl L	OC 1.60	0.67	23.9		109.2	60.0	109.9	1.83				
6.90	7.10	Cl L	OC 1.60	0.67	24.8		112.3	61.2	114.5	1.87				
7.10	7.30	Cl L	OC 1.60	0.67	25.2		115.5	62.3	116.4	1.87				
7.30	7.50	Cl L	OC 1.60	0.67	24.9		118.6	63.5	114.2	1.80				
7.50	7.70	Cl L	OC 1.60	0.67	26.1		121.7	64.6	120.6	1.87				
7.70	7.90	Cl L	OC 1.60	0.67	26.6		124.9	65.7	123.1	1.87				
7.90	8.10	Cl L	OC 1.60	0.67	27.0		128.0	66.9	124.6	1.86				
8.10	8.30	Cl L	OC 1.60	0.67	27.1		131.2	68.0	124.6	1.83				
8.30	8.50	Cl L	OC 1.60	0.67	27.1		134.3	69.1	124.2	1.80				
8.50	8.70	Cl L	OC 1.60	0.67	27.1		137.4	70.3	123.4	1.76				
8.70	8.90	Cl L	OC 1.60	0.67	26.8		140.6	71.4	121.3	1.70				
8.90	9.10	Cl L	OC 1.60	0.67	26.7		143.7	72.6	120.6	1.66				
9.10	9.30	Cl L	OC 1.60	0.67	26.3		146.9	73.7	117.7	1.60				
9.30	9.50	Cl L	OC 1.60	0.67	26.4		150.0	74.8	117.7	1.57				
9.50	9.70	Cl L	OC 1.60	0.67	26.6		153.1	76.0	118.4	1.56				
9.70	9.90	Cl L	OC 1.60	0.67	27.0		156.3	77.1	120.0	1.56				
9.90	10.10	Cl L	OC 1.60	0.67	27.5		159.4	78.3	122.6	1.57				
10.10	10.30	Cl L	OC 1.60	0.67	28.2		162.6	79.4	126.2	1.59				
10.30	10.50	Cl L	OC 1.60	0.67	28.4		165.7	80.5	126.6	1.57				
10.50	10.70	Cl L	OC 1.60	0.67	29.0		168.8	81.7	129.5	1.59				
10.70	10.90	Cl L	OC 1.60	0.67	29.3		172.0	82.8	130.6	1.58				
10.90	11.10	Cl L	OC 1.60	0.67	29.0		175.1	84.0	128.6	1.53				
11.10	11.30	Cl L	NC 1.60	0.67	28.6		178.2	85.1	126.3	1.48				
11.30	11.50	Cl L	OC 1.60	0.67	29.4		181.4	86.2	130.3	1.51				
11.50	11.70	Cl L	OC 1.85	0.67	29.9		184.8	87.6	132.3	1.51				
11.70	11.90	Cl L	NC 1.60	0.67	28.8		188.2	89.0	125.9	1.42				
11.90	12.10	Cl L	NC 1.85	0.67	30.0		191.5	90.4	131.7	1.46				
12.10	12.30	Cl L	NC 1.60	0.67	29.3		194.9	91.8	127.8	1.39				
12.30	12.50	Cl L	NC 1.85	0.67	30.1		198.3	93.2	131.1	1.41				
12.50	12.70	Cl L	NC 1.85	0.67	30.1		201.9	94.8	130.8	1.38				
12.70	12.90	Cl L	NC 1.85	0.67	29.8		205.6	96.4	128.5	1.33				
12.90	13.10	Cl L	NC 1.85	0.67	31.3		209.2	98.0	136.4	1.39				
13.10	13.30	Cl L	NC 1.85	0.67	31.8		212.8	99.7	138.2	1.39				
13.30	13.50	Cl L	NC 1.85	0.67	30.9		216.5	101.3	132.9	1.31				
13.50	13.70	Cl L	NC 1.85	0.67	31.0		220.1	102.9	132.9	1.29				
13.70	13.90	Cl L	NC 1.85	0.67	30.6		223.7	104.6	130.3	1.25				
13.90	14.10	Cl L	NC 1.85	0.67	31.5		227.3	106.2	134.6	1.27				
14.10	14.30	Cl L	NC 1.85	0.67	31.7		231.0	107.8	135.1	1.25				
14.30	14.50	Cl L	NC 1.85	0.67	31.4		234.6	109.5	132.9	1.21				
14.50	14.70	Cl L	NC 1.85	0.67	32.1		238.2	111.1	136.4	1.23				
14.70	14.90	Cl L	NC 1.85	0.67	32.0		241.9	112.7	135.3	1.20				
14.90	15.10	Cl L	NC 1.85	0.67	31.4		245.5	114.3	131.8	1.15				
15.10	15.30	Cl L	NC 1.85	0.67	30.6		249.1	116.0	127.1	1.10				
15.30	15.50	Cl L	NC 1.85	0.67	31.2		252.8	117.6	129.5	1.10				
15.50	15.70	Cl L	NC 1.85	0.67	32.5		256.4	119.2	135.9	1.14				
15.70	15.90	Cl L	NC 1.85	0.67	32.5		260.0	120.9	135.5	1.12				
15.90	16.10	Cl L	NC 1.85	0.67	33.2		263.6	122.5	138.7	1.13				
16.10	16.30	Cl L	NC 1.85	0.67	33.1		267.3	124.1	137.5	1.11				
16.30	16.50	Cl L	NC 1.85	0.67	34.0		270.9	125.8	142.1	1.13				
16.50	16.70	Cl L	NC 1.85	0.67	35.1		274.5	127.4	147.2	1.16				
16.70	16.90	Cl L	NC 1.85	0.67	37.0		278.2	129.0	156.8	1.22				
16.90	17.10	Cl L	NC 1.85	0.67	36.7		281.8	130.6	154.8	1.18				


C P T - test

Project Kv Kölen 30039781							Site Uppsala Designation 22S006 Date 20220323							
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.10	17.30	CIL	NC	1.85	0.67	34.6		285.4	132.3	143.1	1.08			
17.30	17.50	CIL	NC	1.85	0.67	34.0		289.1	133.9	139.9	1.04			
17.50	17.70	CIL	NC	1.85	0.67	35.5		292.7	135.5	146.8	1.08			
17.70	17.90	CIL	NC	1.85	0.67	35.0		296.3	137.2	144.0	1.05			
17.90	18.10	CIL	NC	1.85	0.67	34.6		299.9	138.8	141.4	1.02			
18.10	18.30	CIL	NC	1.85	0.67	36.1		303.6	140.4	148.7	1.06			
18.30	18.50	CIL	NC	1.85	0.67	35.0		307.2	142.1	142.5	1.00			
18.50	18.70	CIL	NC	1.85	0.67	34.3		310.8	143.7	139.8	1.00			
18.70	18.90	CIL	NC	1.85	0.67	33.7		314.5	145.3	137.4	1.00			
18.90	19.10	CIL	NC	1.85	0.67	34.1		318.1	146.9	139.0	1.00			
19.10	19.30	CIL	NC	1.85	0.67	33.2		321.7	148.6	135.3	1.00			
19.30	19.50	CIL	NC	1.85	0.67	33.6		325.3	150.2	137.0	1.00			
19.50	19.70	CIL	NC	1.85	0.67	33.8		329.0	151.8	137.9	1.00			
19.70	19.90	CIL	NC	1.85	0.67	34.0		332.6	153.5	138.7	1.00			
19.90	20.10	CIL	NC	1.85	0.67	35.4		336.2	155.1	144.3	1.00			
20.10	20.30	CIL	NC	1.85	0.67	35.5		339.9	156.7	144.7	1.00			
20.30	20.50	CIL	NC	1.85	0.67	35.2		343.5	158.3	143.4	1.00			
20.50	20.70	CIL	NC	1.85	0.67	36.5		347.1	160.0	148.9	1.00			
20.70	20.90	CIL	NC	1.85	0.67	36.1		350.8	161.6	147.1	1.00			
20.90	21.10	CIL	NC	1.85	0.67	37.1		354.4	163.2	151.3	1.00			
21.10	21.30	CIL	NC	1.85	0.67	37.1		358.0	164.9	151.3	1.00			
21.30	21.50	CIL	NC	1.85	0.67	37.2		361.6	166.5	151.6	1.00			
21.50	21.70	CIL	NC	1.85	0.67	37.8		365.3	168.1	153.9	1.00			
21.70	21.90	CIL	NC	1.85	0.67	37.8		368.9	169.8	154.0	1.00			
21.90	22.10	CIL	NC	1.85	0.67	38.5		372.5	171.4	156.7	1.00			
22.10	22.30	CIL	NC	1.85	0.67	39.6		376.2	173.0	161.5	1.00			
22.30	22.50	CI M	NC	1.85	0.67	41.1		379.8	174.6	167.5	1.00			
22.50	22.70	CI M	NC	1.85	0.67	42.6		383.4	176.3	173.4	1.00			
22.70	22.90	CI M	NC	1.85	0.67	44.0		387.1	177.9	179.6	1.01			
22.90	23.10	CI M	NC	1.85	0.67	43.6		390.7	179.5	177.5	1.00			
23.10	23.30	CI M	NC	1.85	0.67	44.4		394.3	181.2	181.0	1.00			
23.30	23.50	CI M	NC	1.85	0.67	43.3		397.9	182.8	176.5	1.00			
23.50	23.70	CI M	NC	1.85	0.67	42.5		401.6	184.4	173.1	1.00			
23.70	23.90	CI M	NCSi	1.85	0.67	53.0		405.2	186.1	224.3	1.21			
23.90	24.10	CI M	NC	1.85	0.67	45.0		408.8	187.7	183.5	1.00			
24.10	24.30	CI M	NC	1.85	0.67	40.2		412.5	189.3	163.8	1.00			
24.30	24.50	CIL	NC	1.80	0.67	37.9		416.0	190.9	154.4	1.00			
24.50	24.70	CIL	NC	1.80	0.67	34.3		419.6	192.4	139.9	1.00			
24.70	24.90	CIL	NC	1.80	0.67	33.5		423.1	194.0	136.6	1.00			
24.90	25.10	CIL	NC	1.80	0.67	32.2		426.6	195.5	131.1	1.00			
25.10	25.30	CIL	NC	1.80	0.67	32.7		430.2	197.0	133.2	1.00			
25.30	25.50	CIL	NC	1.80	0.67	33.7		433.7	198.6	137.4	1.00			
25.50	25.70	CIL	NC	1.80	0.67	34.5		437.2	200.1	140.6	1.00			
25.70	25.90	CIL	NC	1.80	0.67	34.0		440.8	201.6	138.6	1.00			
25.90	26.10	CIL	NC	1.80	0.67	33.6		444.3	203.1	137.0	1.00			
26.10	26.30	CIL	NC	1.80	0.67	35.3		447.8	204.7	143.8	1.00			
26.30	26.50	CIL	NC	1.80	0.67	37.1		451.4	206.2	151.3	1.00			
26.50	26.70	CIL	NC	1.80	0.67	39.2		454.9	207.7	159.9	1.00			
26.70	26.90	CIL	NC	1.80	0.67	38.0		458.4	209.3	154.8	1.00			
26.90	27.10	CIL	NC	1.80	0.67	39.4		462.0	210.8	160.7	1.00			
27.10	27.30	CIL	NC	1.80	0.67	37.7		465.5	212.3	153.5	1.00			
27.30	27.50	CI M	NC	1.80	0.67	40.6		469.0	213.9	165.4	1.00			
27.50	27.70	CI M	NC	1.85	0.67	42.3		472.6	215.4	172.3	1.00			
27.70	27.90	CI M	NC	1.80	0.67	41.3		476.2	217.0	168.1	1.00			
27.90	28.10	CI M	NC	1.80	0.67	42.0		479.7	218.6	171.1	1.00			
28.10	28.30	CI M	NC	1.80	0.67	44.0		483.2	220.1	179.4	1.00			
28.30	28.50	CI M	NC	1.80	0.67	44.8		486.8	221.6	182.6	1.00			
28.50	28.70	CI M	NC	1.85	0.67	46.0		490.4	223.2	187.6	1.00			
28.70	28.90	CI M	NC	1.85	0.67	44.5		494.0	224.8	181.5	1.00			
28.90	29.10	CI M	NC	1.80	0.67	42.9		497.6	226.4	174.8	1.00			
29.10	29.30	CI M	NC	1.80	0.67	44.8		501.1	227.9	182.7	1.00			
29.30	29.50	CI M	NC	1.80	0.67	42.0		504.6	229.5	171.2	1.00			
29.50	29.70	CI M	NC	1.80	0.67	44.6		508.2	231.0	181.8	1.00			
29.70	29.90	CI M	NC	1.80	0.67	44.7		511.7	232.5	182.0	1.00			
29.90	30.10	CI M	NC	1.80	0.67	44.7		515.2	234.1	182.2	1.00			
30.10	30.30	CI M	NC	1.80	0.67	46.9		518.8	235.6	190.9	1.00			
30.30	30.50	CI M	NC	1.80	0.67	45.2		522.3	237.1	184.3	1.00			
30.50	30.70	CI M	NC	1.80	0.67	45.9		525.8	238.7	187.1	1.00			
30.70	30.90	CI M	NC	1.80	0.67	47.7		529.3	240.2	194.5	1.00			
30.90	31.10	CI M	NC	1.85	0.67	51.0		532.9	241.8	207.7	1.00			
31.10	31.30	CI M	NC	1.85	0.67	51.4		536.6	243.4	209.3	1.00			
31.30	31.50	CI M	NC	1.80	0.67	49.2		540.1	245.0	200.4	1.00			
31.50	31.70	CI M	NC	1.80	0.67	50.2		543.7	246.5	204.4	1.00			
31.70	31.90	CI M	NC	1.80	0.67	49.9		547.2	248.1	203.2	1.00			
31.90	32.10	CI M	NC	1.80	0.67	53.9		550.7	249.6	219.7	1.00			
32.10	32.30	CI M	NC	1.85	0.67	55.2		554.3	251.2	225.1	1.00			
32.30	32.50	CI M	NC	1.80	0.67	53.6		557.9	252.7	218.3	1.00			

C P T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S006 Date 20220323										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
32.50	32.70	CI M	NC	1.80	0.67	54.5	561.4	254.3	221.9	1.00				
32.70	32.90	CI M	NC	1.80	0.67	54.4	565.0	255.8	221.6	1.00				
32.90	33.10	CI M	NC	1.80	0.67	53.3	568.5	257.3	217.2	1.00				
33.10	33.30	CI M	NC	1.80	0.67	53.9	572.0	258.9	219.8	1.00				
33.30	33.50	CI M	NC	1.80	0.67	53.9	575.6	260.4	219.7	1.00				
33.50	33.70	CI M	NC	1.80	0.67	53.2	579.1	261.9	216.9	1.00				
33.70	33.90	CI M	NC	1.80	0.67	52.4	582.6	263.5	213.5	1.00				
33.90	34.10	CI M	NC	1.90	0.67	55.0	586.2	265.1	224.1	1.00				
34.10	34.30	CI M	NC	1.90	0.67	57.6	590.0	266.8	234.5	1.00				
34.30	34.50	CI M	NC	1.90	0.67	55.0	593.7	268.6	223.9	1.00				
34.50	34.70	CI M	NC	1.90	0.67	57.9	597.4	270.3	235.9	1.00				
34.70	34.90	CI M	NC	1.90	0.67	55.4	601.2	272.0	225.7	1.00				
34.90	35.10	CI M	NC	1.90	0.67	57.0	604.9	273.7	232.2	1.00				
35.10	35.22	CI M	NC	1.90	0.67	60.8	607.9	275.1	247.6	1.00				


CPT-test performed according to EN ISO 22476-1

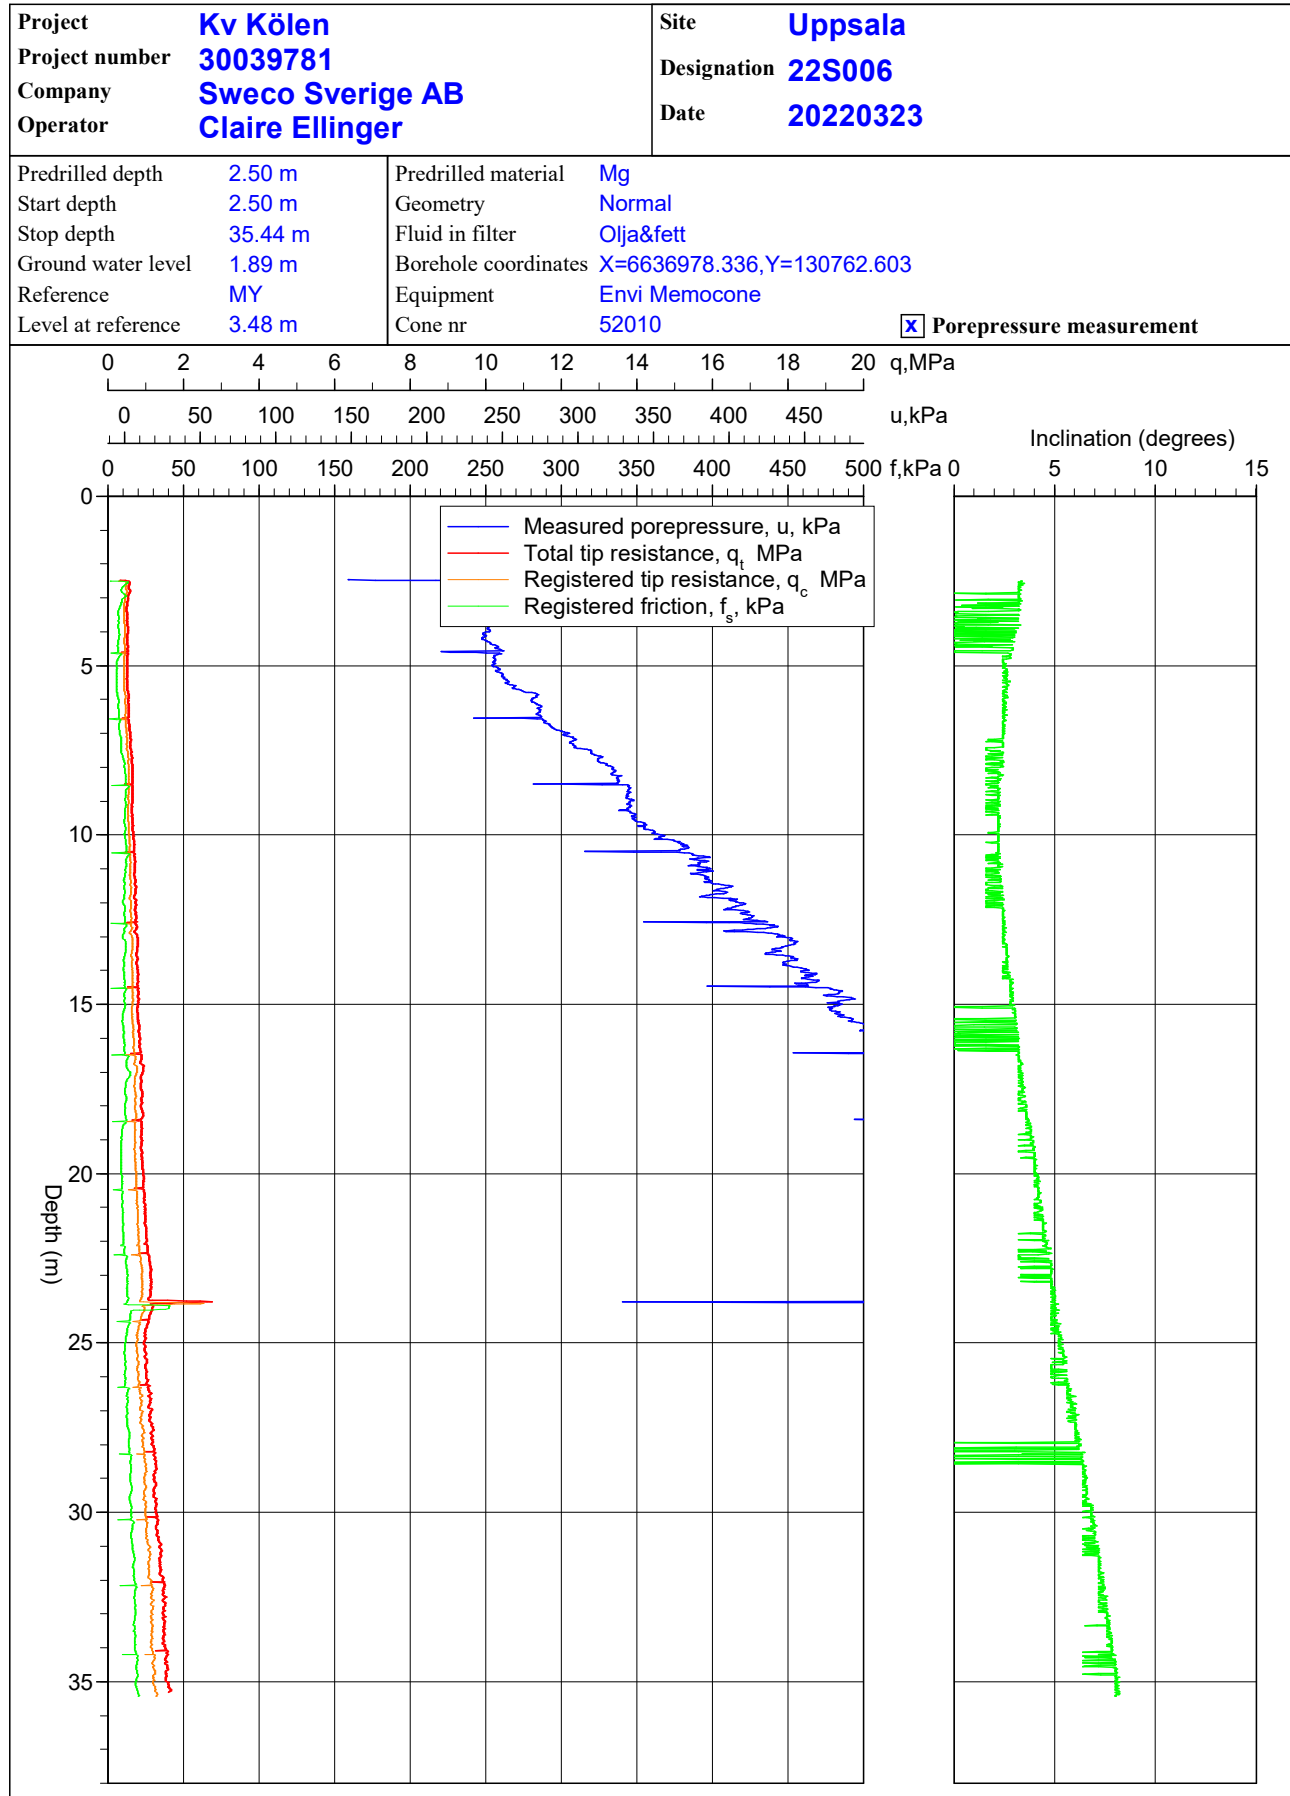

CPT-test performed according to EN ISO 22476-1

Predrilling depth	1.00 m	Reference	my	Fluid in filter	Olja&fett
Start depth	1.00 m	Level at reference	3.21 m	Coordinats	x=6636762.506,y=130625921
Stop depth	18.49 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	1.61 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S007
Date	20220321

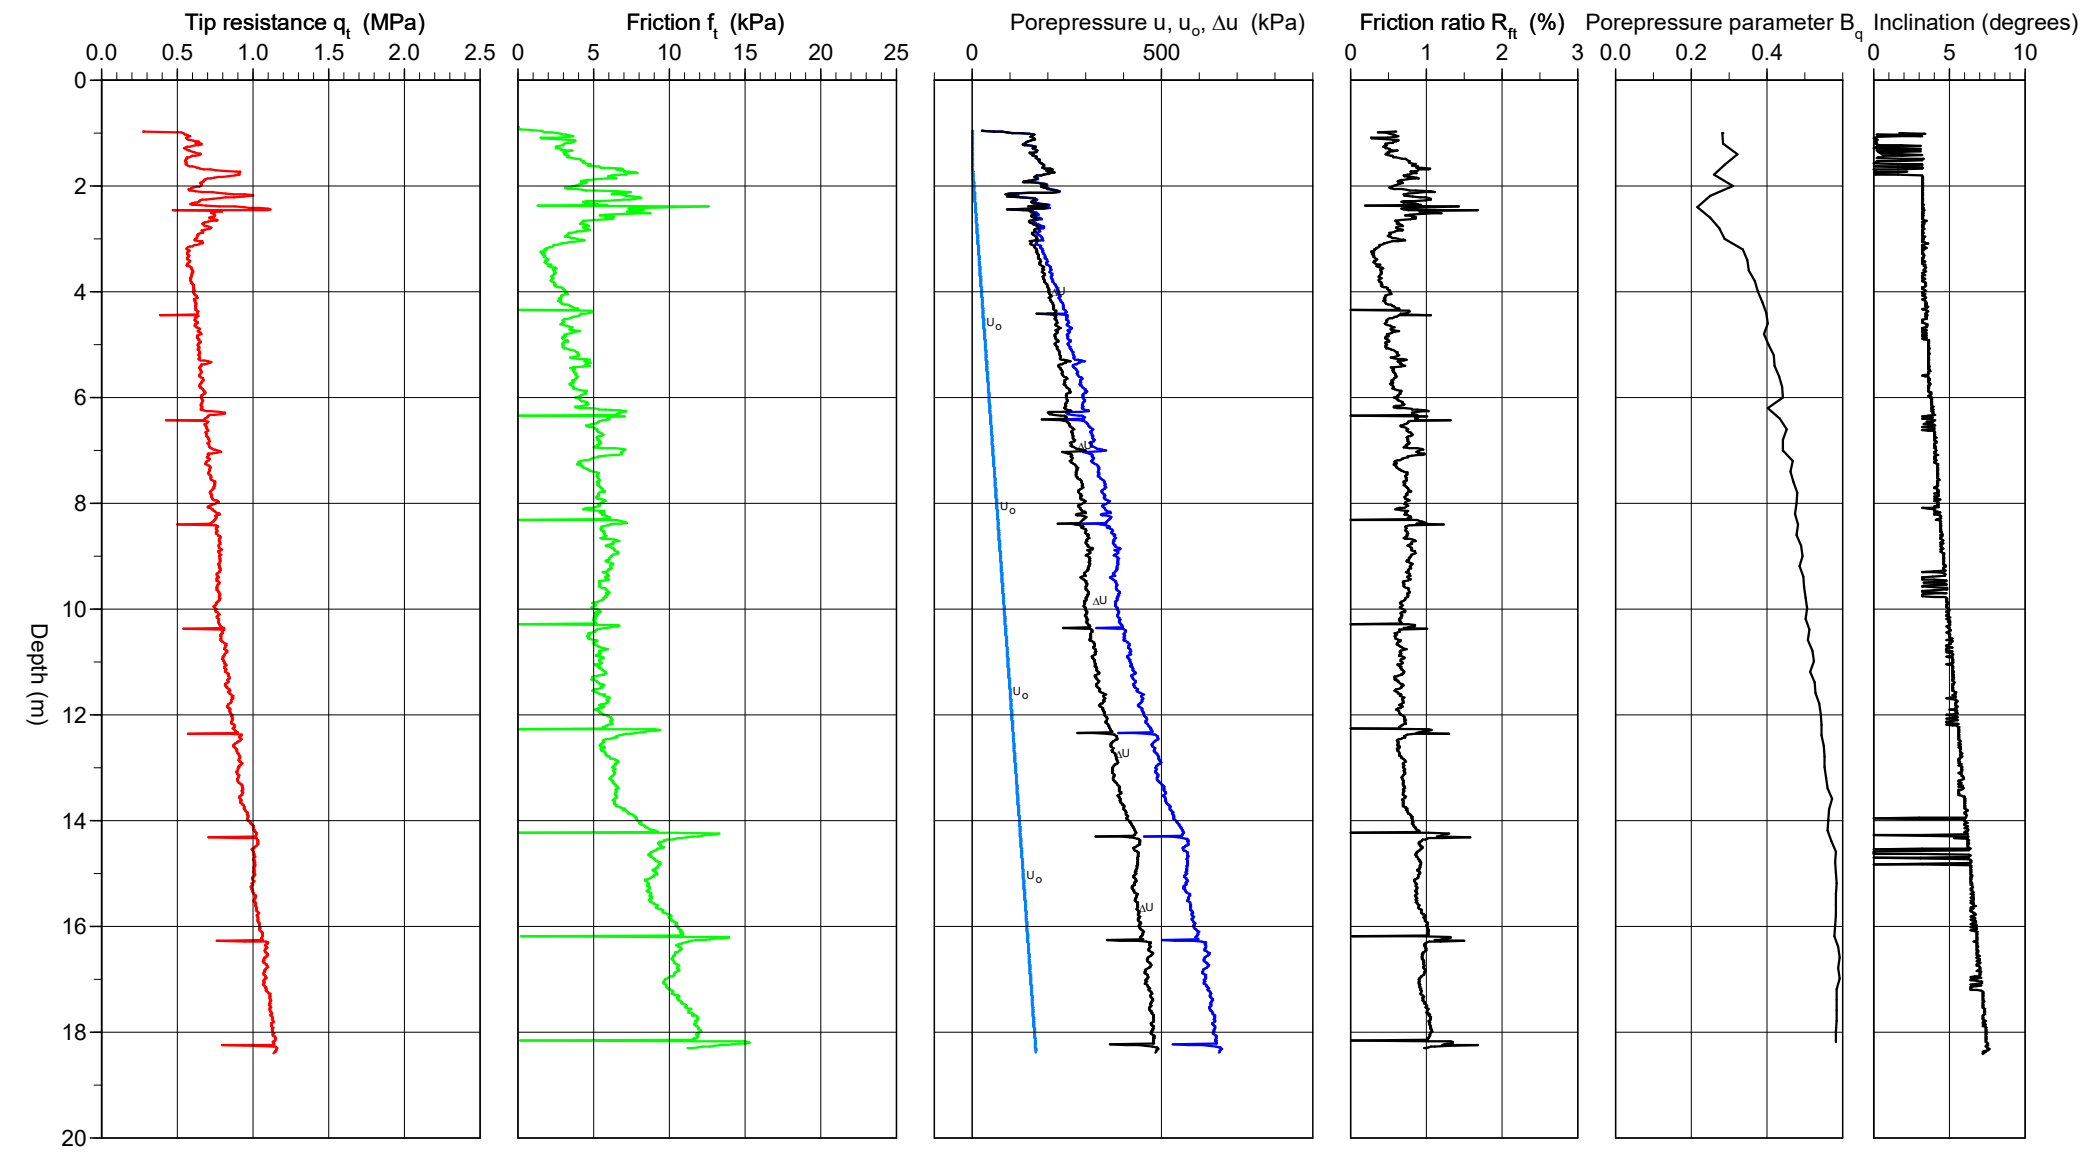

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S007
 Date 20220321


Reference my Predrilling depth 1.00 m Evaluator INPRAG
 Level at reference 3.21 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 1.61 m Equipment Envi Memocone
 Start depth 1.00 m Geometry Normal

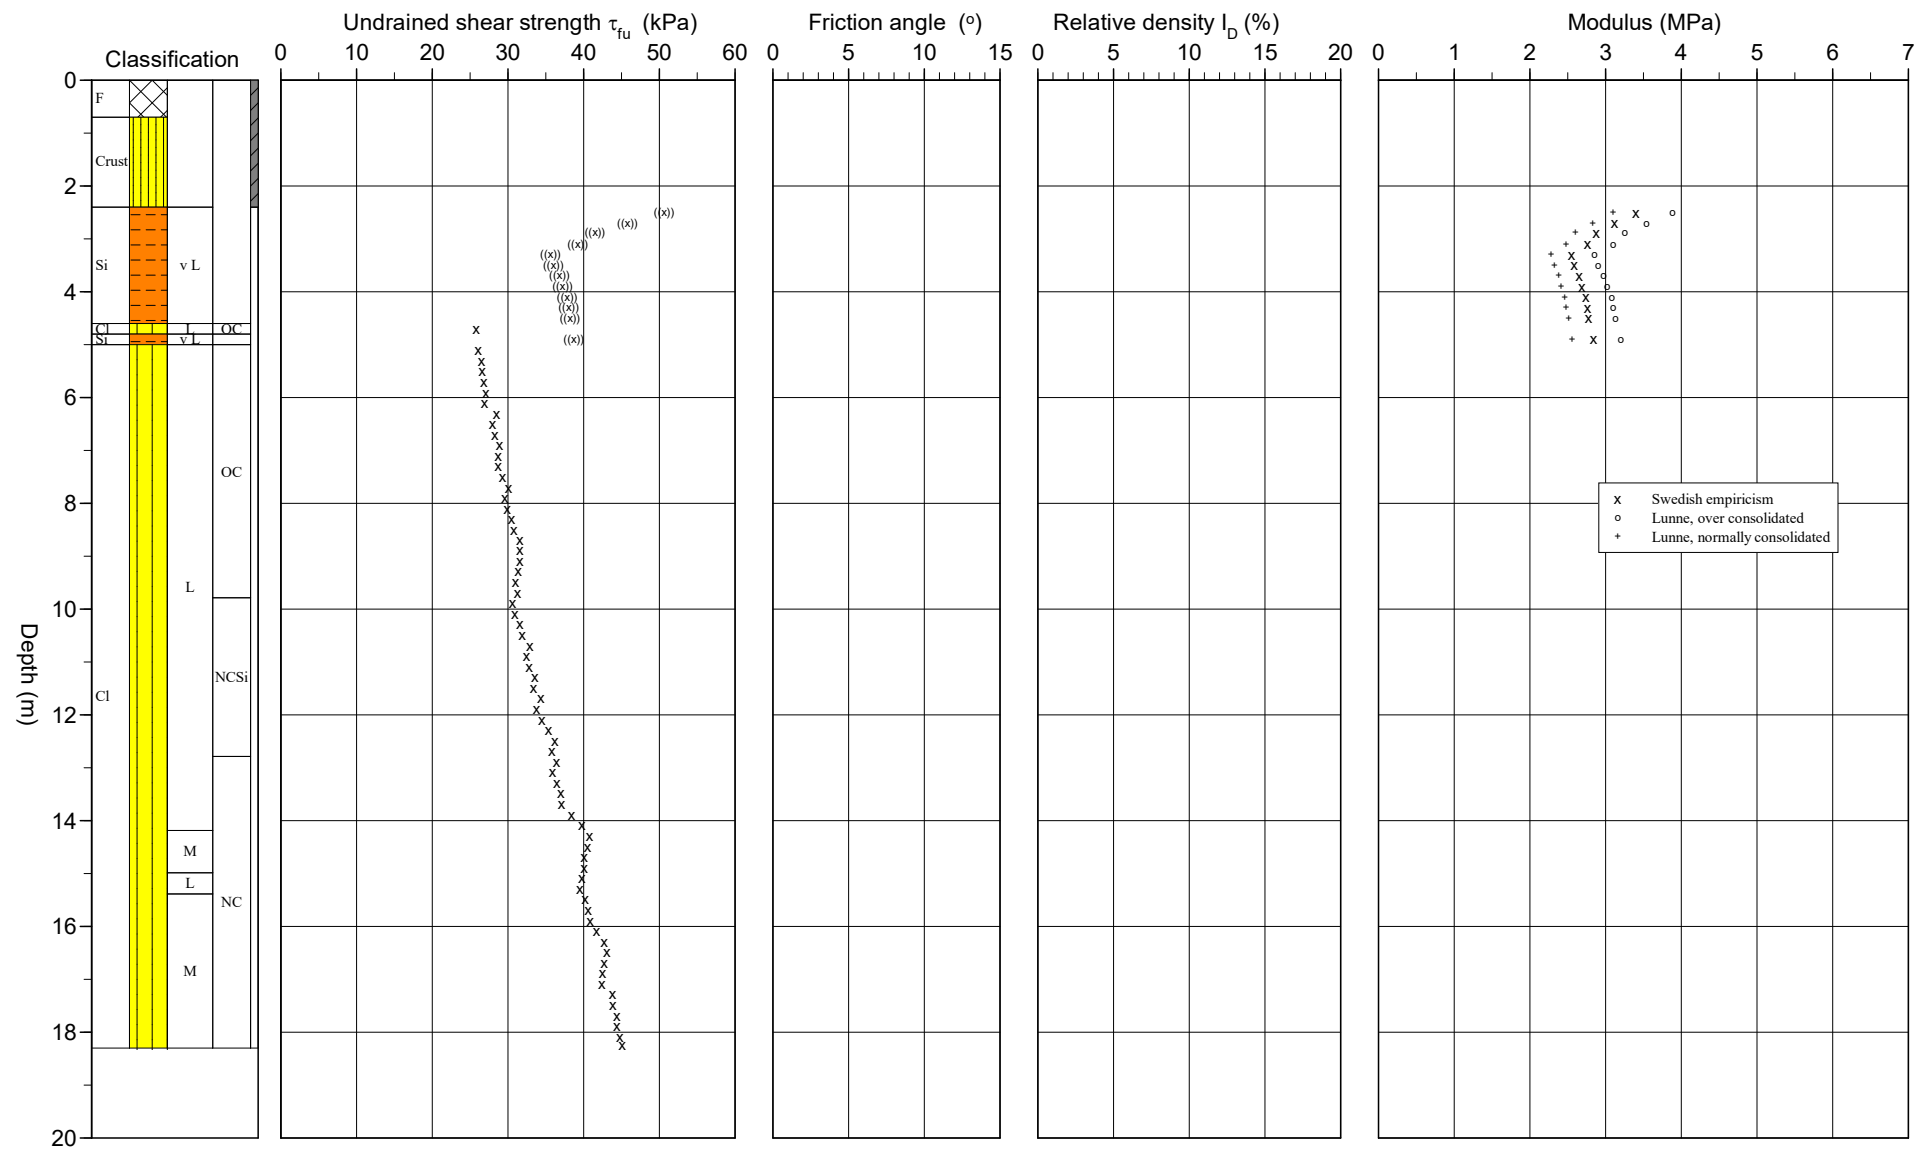

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	my	Predrilling depth	1.00 m	Evaluator	INPRAG
Ground water level	3.21 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	1.61 m	Equipment	Envi Memocone		
Start depth	1.00 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S007
Date	20220321

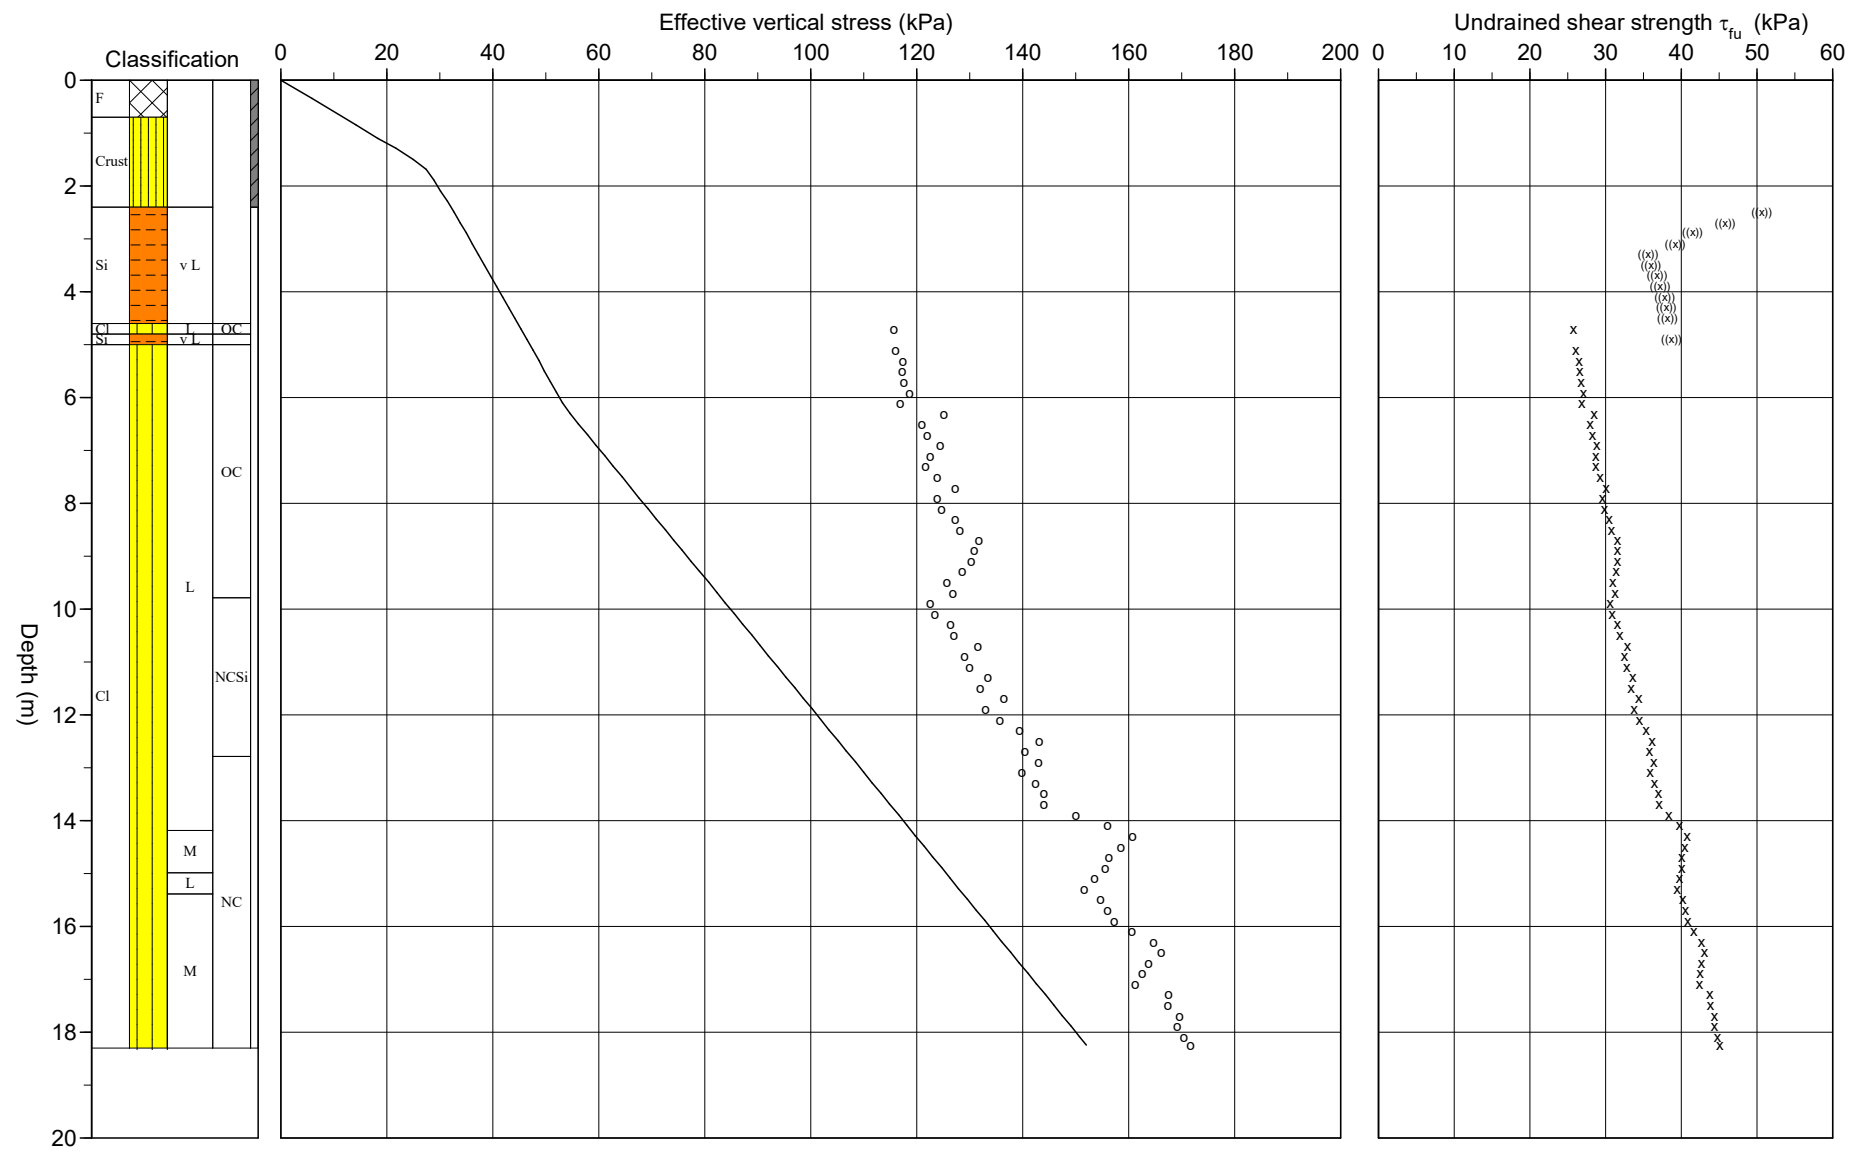

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S007 Date 20220321																																													
Predrilling depth 1.00 m Start depth 1.00 m Stop depth 18.49 m Ground water level 1.61 m Reference my Level at reference 3.21 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																														
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>8.40</td> <td>0.00</td> <td>0.11</td> </tr> <tr> <td>Diff</td> <td>8.40</td> <td>0.00</td> <td>0.11</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	8.40	0.00	0.11	Diff	8.40	0.00	0.11																												
	Porepressure	Friction	Tip resistance																																												
Before	0.00	0.00	0.00																																												
After	8.40	0.00	0.11																																												
Diff	8.40	0.00	0.11																																												
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																											
Porepressure		Friction		Tip resistance																																											
Range	Code	Range	Code	Range	Code																																										
<input type="checkbox"/> Use scale factors																																															
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>1.61</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	1.61	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td></td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th>Density</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> <th>(ton/m³)</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.50</td> <td>1.70</td> <td></td> <td>Crust</td> </tr> <tr> <td>2.50</td> <td>3.20</td> <td></td> <td>0.84</td> <td></td> </tr> <tr> <td>3.20</td> <td>4.00</td> <td></td> <td>0.82</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.82</td> <td></td> </tr> <tr> <td>5.00</td> <td>18.31</td> <td></td> <td>0.82</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density	Liquid limit	Soil	From	To	(ton/m ³)	0.00	0.70	1.70		F	0.70	2.50	1.70		Crust	2.50	3.20		0.84		3.20	4.00		0.82		4.00	5.00		0.82		5.00	18.31		0.82	
Depth (m)	Porepressure (kPa)																																														
1.61	0.00																																														
Depth (m)																																															
Depth (m)		Density	Liquid limit	Soil																																											
From	To	(ton/m ³)																																													
0.00	0.70	1.70		F																																											
0.70	2.50	1.70		Crust																																											
2.50	3.20		0.84																																												
3.20	4.00		0.82																																												
4.00	5.00		0.82																																												
5.00	18.31		0.82																																												
Notes 																																															


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S007										
				Date 20220321										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.00	Crust	1.70				14.2	14.2						
1.00	1.20	Crust	1.70				18.3	18.3						
1.20	1.40	Crust	1.70				21.7	21.7						
1.40	1.60	Crust	1.70				25.0	25.0						
1.60	1.80	Crust	1.70				28.4	27.5						
1.80	2.00	Crust	1.70				31.7	28.8						
2.00	2.20	Crust	1.70				35.0	30.1						
2.20	2.40	Crust	1.70				38.4	31.5						
2.40	2.60	Si v L	1.60	0.84	((50.6))		41.6	32.7			3.4	3.9	3.1	
2.60	2.80	Si v L	1.60	0.84	((45.8))		44.7	33.8			3.1	3.5	2.8	
2.80	3.00	Si v L	1.60	0.84	((41.5))		47.9	35.0			2.9	3.3	2.6	
3.00	3.20	Si v L	1.60	0.84	((39.2))		51.0	36.1			2.8	3.1	2.5	
3.20	3.40	Si v L	1.60	0.82	((35.6))		54.2	37.3			2.6	2.9	2.3	
3.40	3.60	Si v L	1.60	0.82	((36.0))		57.3	38.4			2.6	2.9	2.3	
3.60	3.80	Si v L	1.60	0.82	((36.8))		60.4	39.5			2.6	3.0	2.4	
3.80	4.00	Si v L	1.60	0.82	((37.2))		63.6	40.7			2.7	3.0	2.4	
4.00	4.20	Si v L	1.60	0.82	((37.8))		66.7	41.8			2.7	3.1	2.5	
4.20	4.40	Si v L	1.60	0.82	((38.0))		69.8	42.9			2.8	3.1	2.5	
4.40	4.60	Si v L	1.60	0.82	((38.2))		73.0	44.1			2.8	3.1	2.5	
4.60	4.80	Cl L	OC	1.60	0.82	25.8	76.1	45.2	115.7	2.56				
4.80	5.00	Si v L		1.60	0.82	((38.7))	79.3	46.4			2.8	3.2	2.6	
5.00	5.20	Cl L	OC	1.60	0.82	26.1	82.4	47.5	116.0	2.44				
5.20	5.40	Cl L	OC	1.60	0.82	26.5	85.5	48.6	117.4	2.41				
5.40	5.60	Cl L	OC	1.60	0.82	26.6	88.7	49.8	117.3	2.36				
5.60	5.80	Cl L	OC	1.60	0.82	26.8	91.8	50.9	117.6	2.31				
5.80	6.00	Cl L	OC	1.60	0.82	27.1	95.0	52.1	118.6	2.28				
6.00	6.20	Cl L	OC	1.60	0.82	26.9	98.1	53.2	116.9	2.20				
6.20	6.40	Cl L	OC	1.85	0.82	28.5	101.5	54.6	125.1	2.29				
6.40	6.60	Cl L	OC	1.85	0.82	28.0	105.1	56.2	121.1	2.15				
6.60	6.80	Cl L	OC	1.85	0.82	28.3	108.7	57.8	122.0	2.11				
6.80	7.00	Cl L	OC	1.85	0.82	28.9	112.4	59.5	124.5	2.09				
7.00	7.20	Cl L	OC	1.85	0.82	28.7	116.0	61.1	122.6	2.01				
7.20	7.40	Cl L	OC	1.85	0.82	28.7	119.6	62.7	121.7	1.94				
7.40	7.60	Cl L	OC	1.85	0.82	29.3	123.3	64.4	123.9	1.92				
7.60	7.80	Cl L	OC	1.85	0.82	30.1	126.9	66.0	127.3	1.93				
7.80	8.00	Cl L	OC	1.85	0.82	29.6	130.5	67.6	123.9	1.83				
8.00	8.20	Cl L	OC	1.85	0.82	29.9	134.2	69.3	124.8	1.80				
8.20	8.40	Cl L	OC	1.85	0.82	30.5	137.8	70.9	127.2	1.79				
8.40	8.60	Cl L	OC	1.85	0.82	30.8	141.4	72.5	128.2	1.77				
8.60	8.80	Cl L	OC	1.85	0.82	31.6	145.0	74.1	131.7	1.78				
8.80	9.00	Cl L	OC	1.85	0.82	31.6	148.7	75.8	130.9	1.73				
9.00	9.20	Cl L	OC	1.85	0.82	31.6	152.3	77.4	130.3	1.68				
9.20	9.40	Cl L	OC	1.85	0.82	31.4	155.9	79.0	128.6	1.63				
9.40	9.60	Cl L	OC	1.85	0.82	31.0	159.6	80.7	125.7	1.56				
9.60	9.80	Cl L	OC	1.85	0.82	31.3	163.2	82.3	126.8	1.54				
9.80	10.00	Cl L	NCSi	1.85	0.82	30.6	166.8	83.9	122.5	1.46				
10.00	10.20	Cl L	NCSi	1.85	0.82	30.9	170.4	85.5	123.5	1.44				
10.20	10.40	Cl L	NCSi	1.85	0.82	31.6	174.1	87.2	126.5	1.45				
10.40	10.60	Cl L	NCSi	1.85	0.82	31.9	177.7	88.8	127.1	1.43				
10.60	10.80	Cl L	NCSi	1.85	0.82	32.9	181.3	90.4	131.6	1.45				
10.80	11.00	Cl L	NCSi	1.85	0.82	32.5	185.0	92.1	129.0	1.40				
11.00	11.20	Cl L	NCSi	1.85	0.82	32.8	188.6	93.7	129.9	1.39				
11.20	11.40	Cl L	NCSi	1.85	0.82	33.6	192.2	95.3	133.4	1.40				
11.40	11.60	Cl L	NCSi	1.85	0.82	33.4	195.9	97.0	131.9	1.36				
11.60	11.80	Cl L	NCSi	1.85	0.82	34.4	199.5	98.6	136.4	1.38				
11.80	12.00	Cl L	NCSi	1.85	0.82	33.8	203.1	100.2	132.9	1.33				
12.00	12.20	Cl L	NCSi	1.85	0.82	34.5	206.7	101.8	135.7	1.33				
12.20	12.40	Cl L	NCSi	1.85	0.82	35.4	210.4	103.5	139.4	1.35				
12.40	12.60	Cl L	NCSi	1.85	0.82	36.2	214.0	105.1	143.2	1.36				
12.60	12.80	Cl L	NCSi	1.85	0.82	35.8	217.6	106.7	140.4	1.32				
12.80	13.00	Cl L	NC	1.85	0.82	36.4	221.3	108.4	143.1	1.32				
13.00	13.20	Cl L	NC	1.85	0.82	35.9	224.9	110.0	139.8	1.27				
13.20	13.40	Cl L	NC	1.85	0.82	36.5	228.5	111.6	142.4	1.28				
13.40	13.60	Cl L	NC	1.85	0.82	37.0	232.2	113.3	144.1	1.27				
13.60	13.80	Cl L	NC	1.85	0.82	37.1	235.8	114.9	144.1	1.25				
13.80	14.00	Cl L	NC	1.85	0.82	38.4	239.4	116.5	150.0	1.29				
14.00	14.20	Cl L	NC	1.85	0.82	39.8	243.0	118.1	156.1	1.32				
14.20	14.40	Cl M	NC	1.85	0.82	40.8	246.7	119.8	160.7	1.34				
14.40	14.60	Cl M	NC	1.85	0.82	40.5	250.3	121.4	158.6	1.31				
14.60	14.80	Cl M	NC	1.85	0.82	40.1	253.9	123.0	156.3	1.27				
14.80	15.00	Cl M	NC	1.85	0.82	40.1	257.6	124.7	155.5	1.25				
15.00	15.20	Cl L	NC	1.85	0.82	39.8	261.2	126.3	153.5	1.22				
15.20	15.40	Cl L	NC	1.85	0.82	39.5	264.8	127.9	151.6	1.18				
15.40	15.60	Cl M	NC	1.85	0.82	40.2	268.5	129.6	154.8	1.19				
15.60	15.80	Cl M	NC	1.85	0.82	40.6	272.1	131.2	156.1	1.19				
15.80	16.00	Cl M	NC	1.85	0.82	40.9	275.7	132.8	157.2	1.18				

CP T - test

Project Kv Kölen 30039781				Site Uppsala Designation 22S007 Date 20220321										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
16.00	16.20	CI M	NC 1.85	0.82	41.7		279.3	134.4	160.6	1.19				
16.20	16.40	CI M	NC 1.85	0.82	42.7		283.0	136.1	164.7	1.21				
16.40	16.60	CI M	NC 1.85	0.82	43.1		286.6	137.7	166.1	1.21				
16.60	16.80	CI M	NC 1.85	0.82	42.7		290.2	139.3	163.7	1.18				
16.80	17.00	CI M	NC 1.85	0.82	42.5		293.9	141.0	162.5	1.15				
17.00	17.20	CI M	NC 1.85	0.82	42.4		297.5	142.6	161.2	1.13				
17.20	17.40	CI M	NC 1.85	0.82	43.8		301.1	144.2	167.5	1.16				
17.40	17.60	CI M	NC 1.85	0.82	43.9		304.7	145.8	167.5	1.15				
17.60	17.80	CI M	NC 1.85	0.82	44.4		308.4	147.5	169.5	1.15				
17.80	18.00	CI M	NC 1.85	0.82	44.4		312.0	149.1	169.1	1.13				
18.00	18.20	CI M	NC 1.85	0.82	44.8		315.6	150.7	170.4	1.13				
18.20	18.31	CI M	NC 1.85	0.82	45.1		318.5	152.0	171.7	1.13				


CPT-test performed according to EN ISO 22476-1

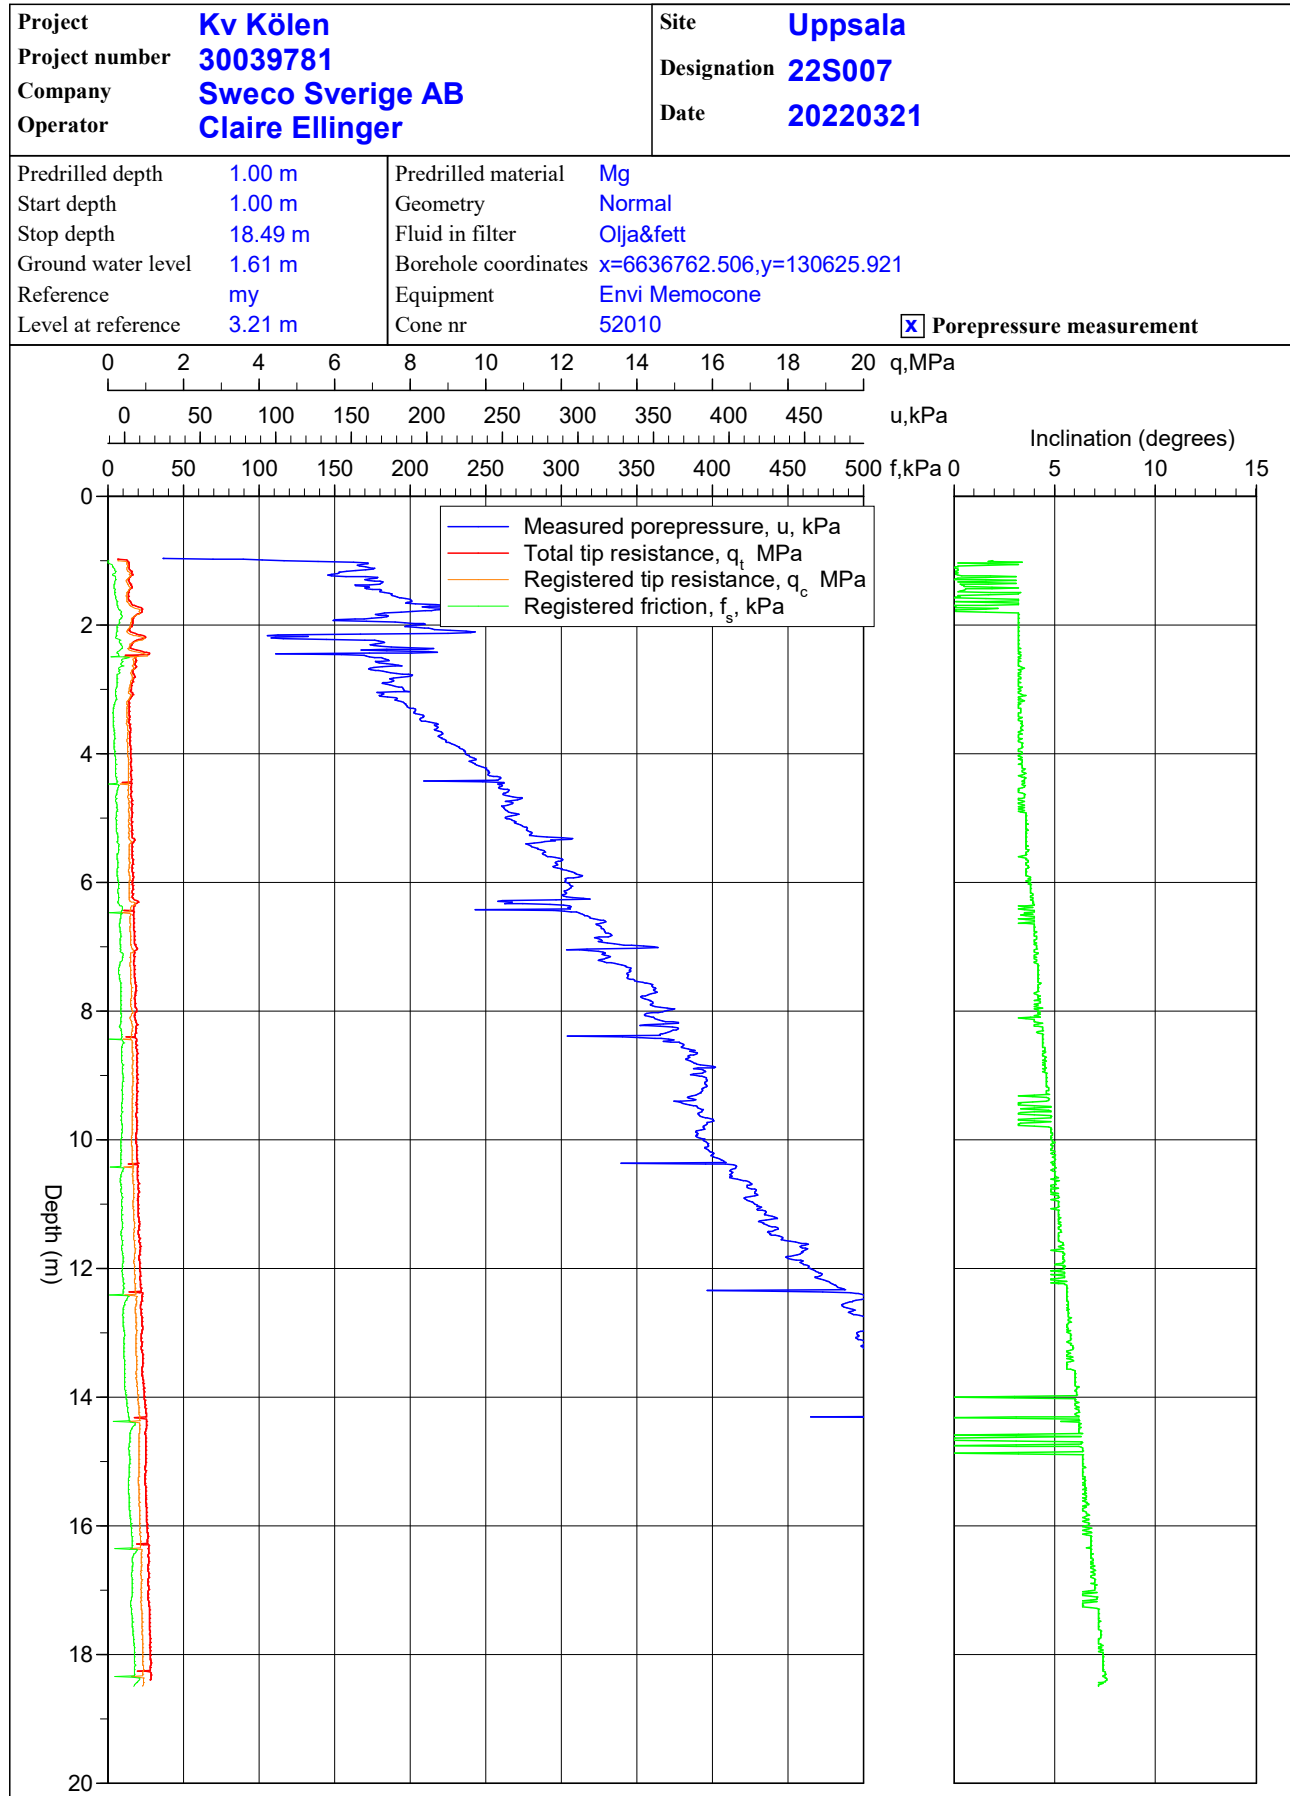

CPT-test performed according to EN ISO 22476-1

Predrilling depth	2.50 m	Reference	My	Fluid in filter	Olja&fett
Start depth	2.50 m	Level at reference	3.01 m	Coordinates	X=6636825.707,Y=130739.978
Stop depth	22.29 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	1.41 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S008
Date	20220322

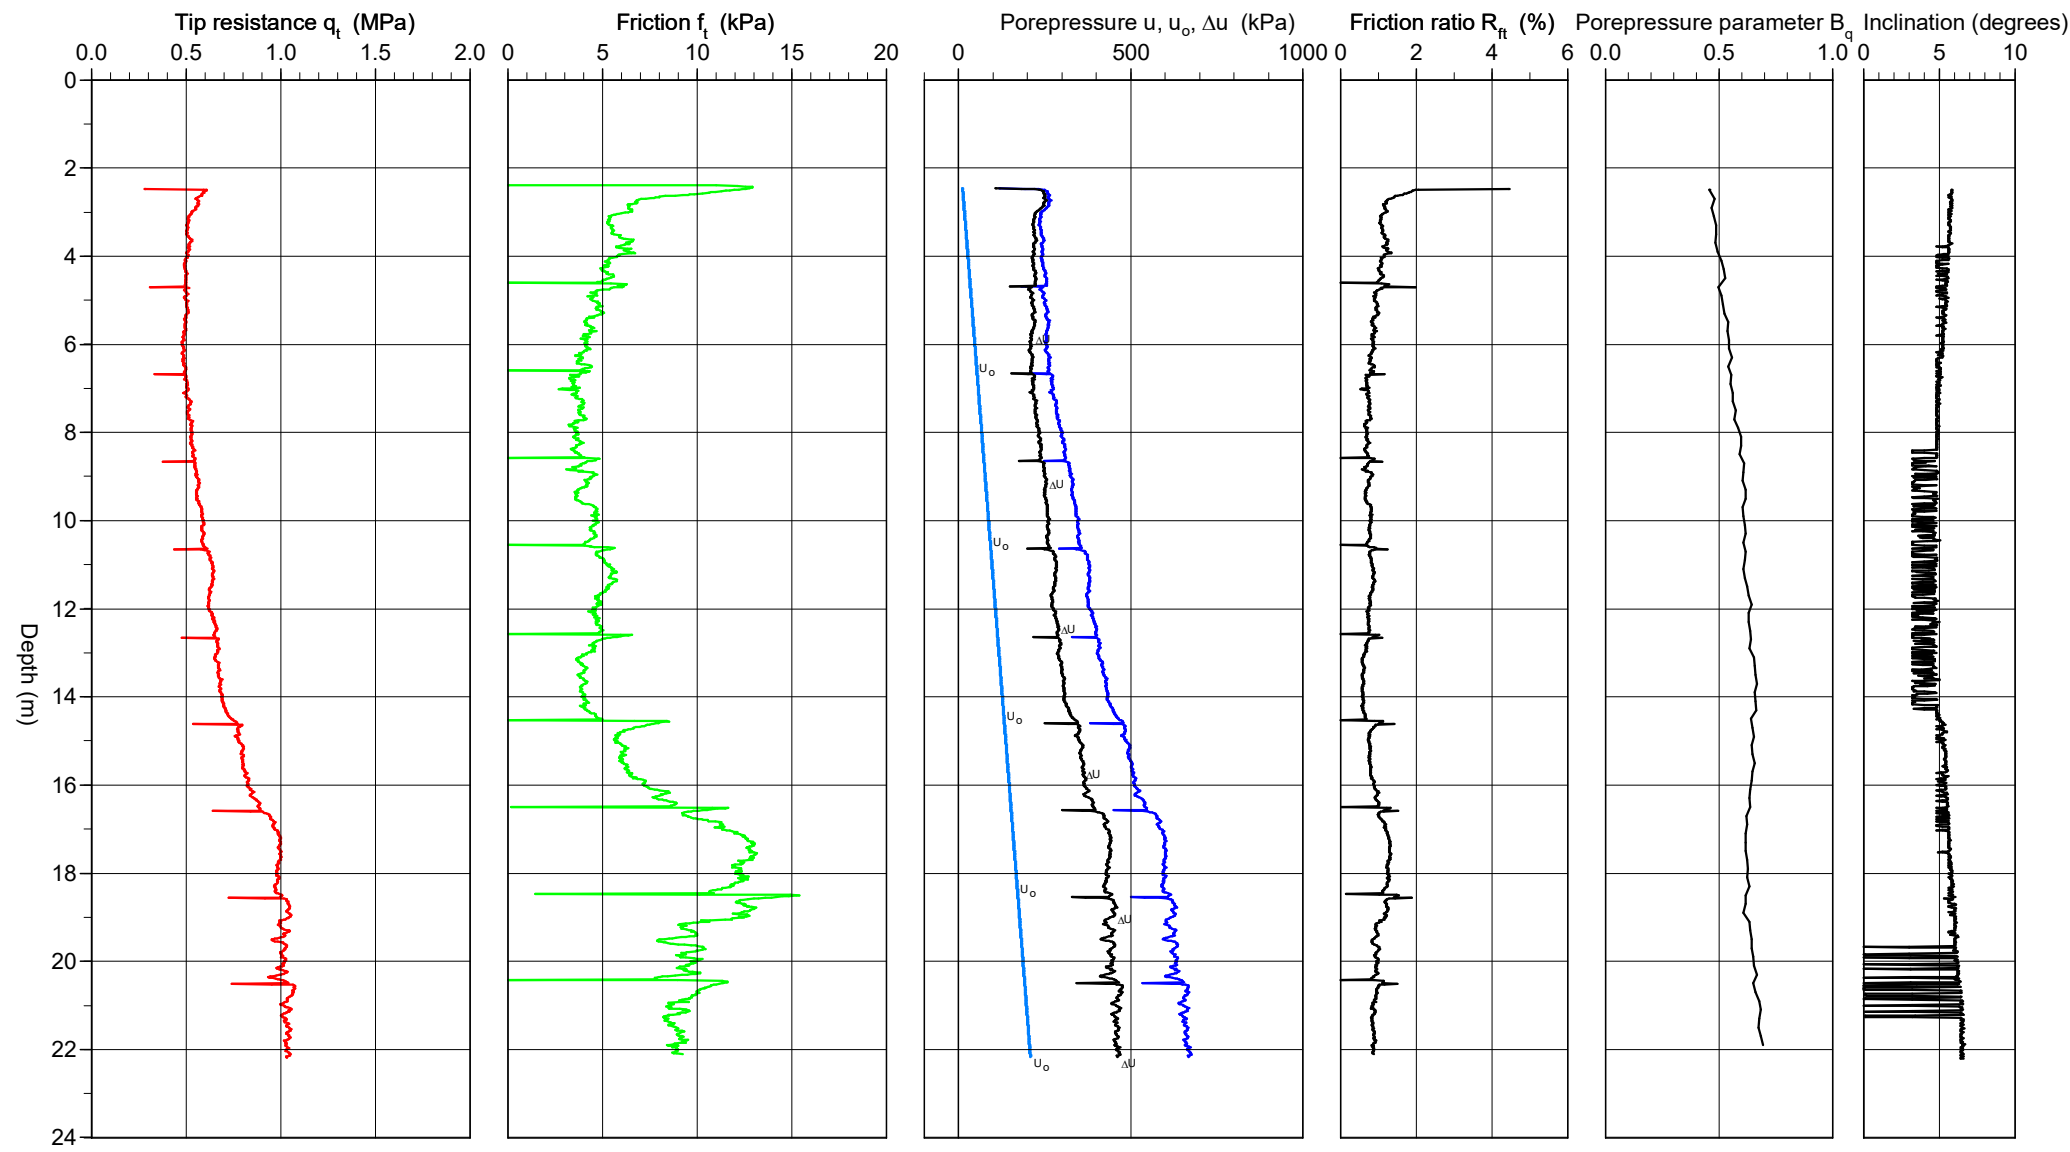

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S008
 Date 20220322


Reference My Predrilling depth 2.50 m Evaluator INPRAG
 Level at reference 3.01 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 1.41 m Equipment Envi Memocone
 Start depth 2.50 m Geometry Normal

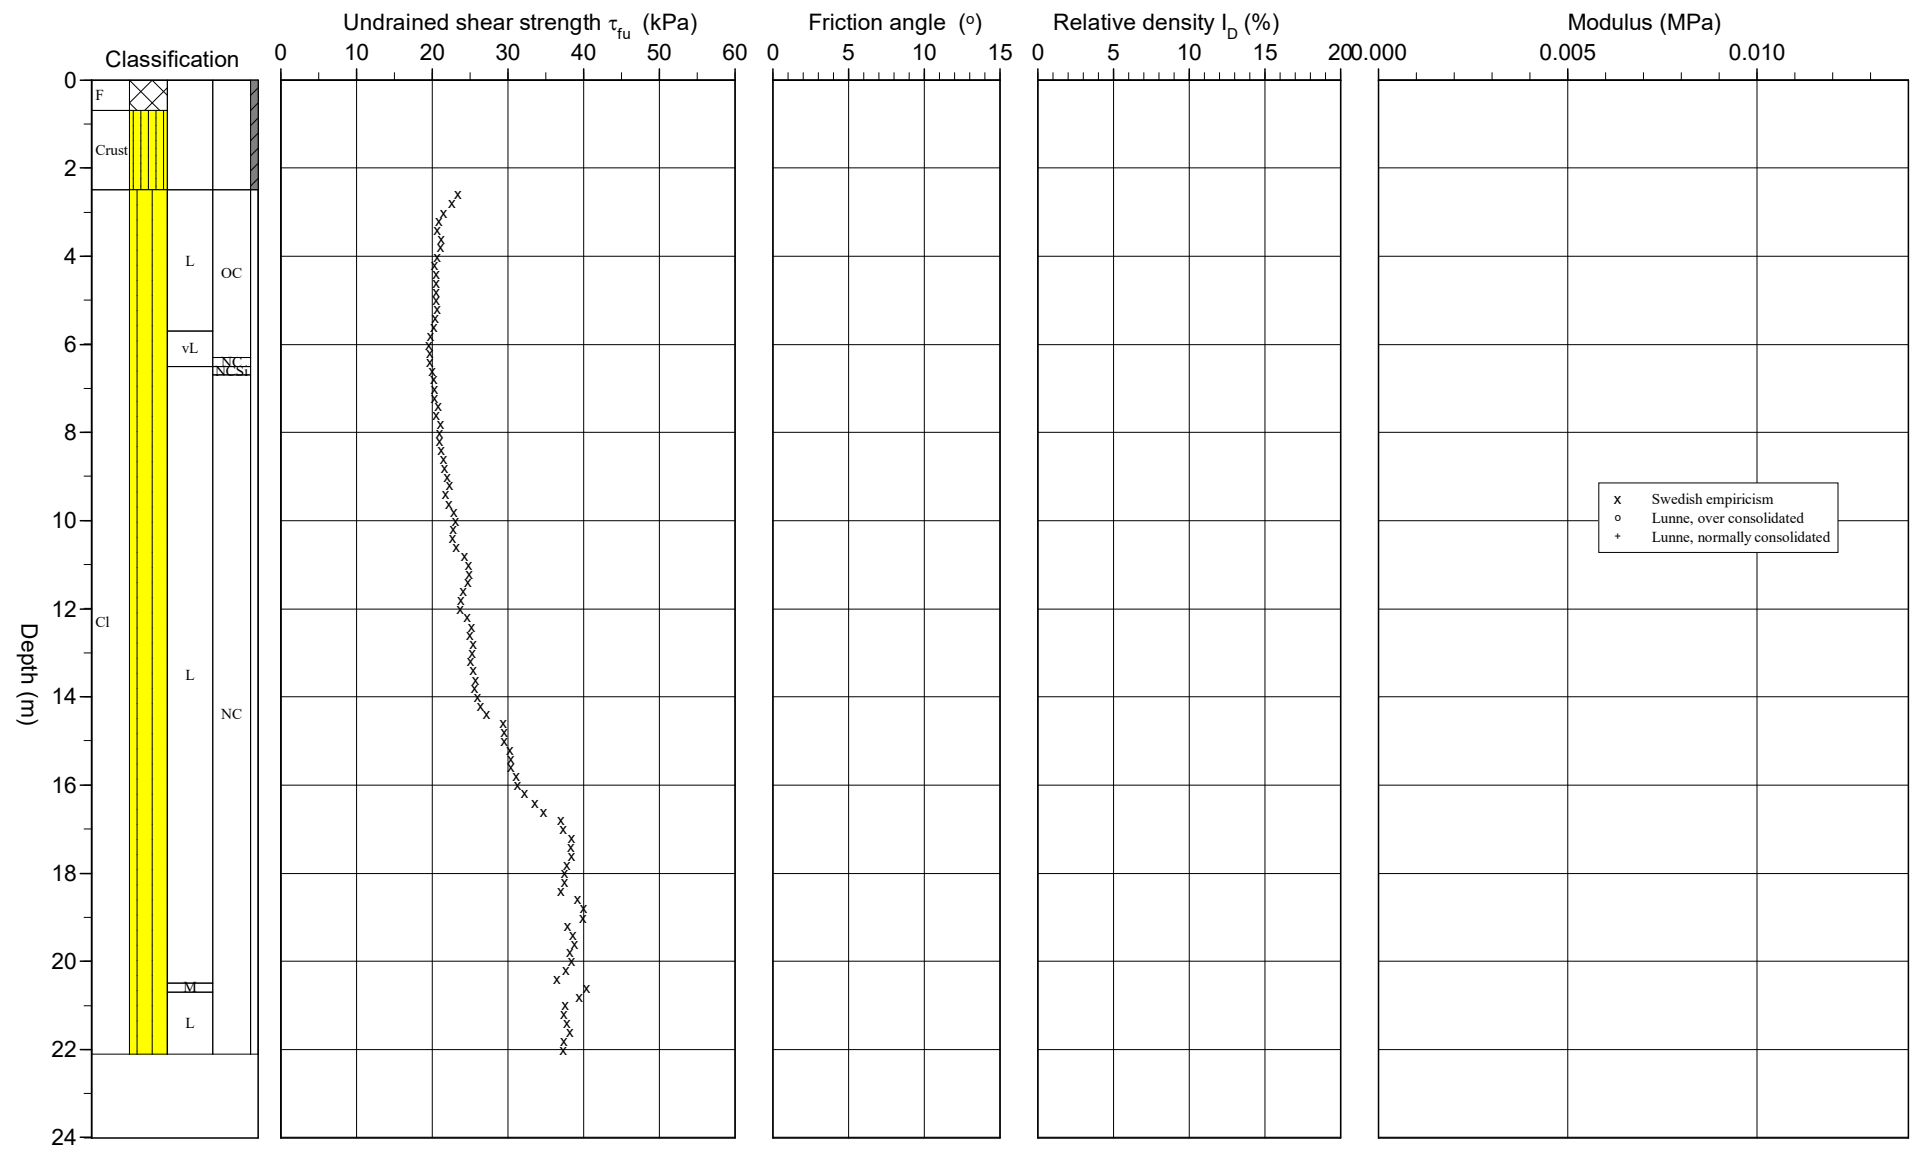

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	My	Predrilling depth	2.50 m	Evaluator	INPRAG
Ground water level	3.01 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	1.41 m	Equipment	Envi Memocone		
Start depth	2.50 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S008
Date	20220322

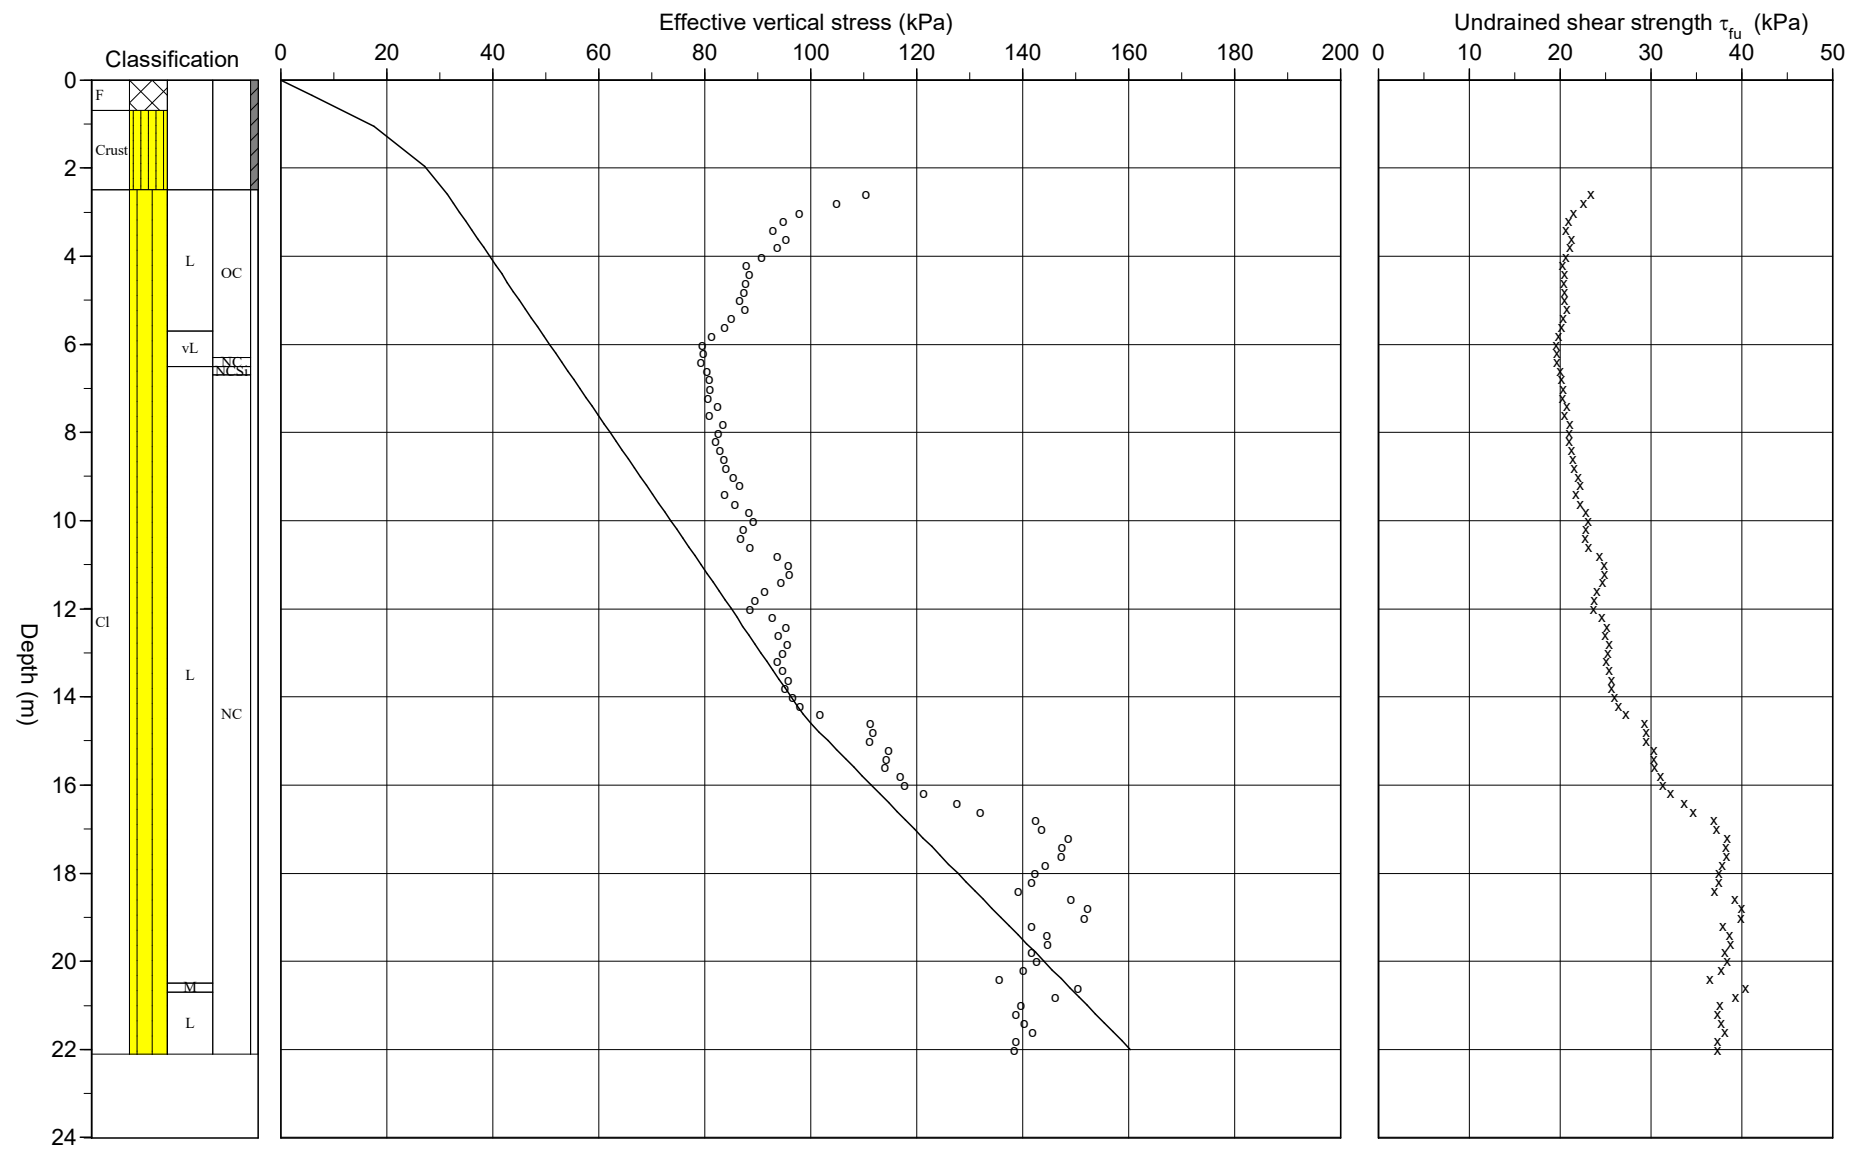

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S008 Date 20220322																																													
Predrilling depth 2.50 m Start depth 2.50 m Stop depth 22.29 m Ground water level 1.41 m Reference My Level at reference 3.01 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																														
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>-3.50</td> <td>-0.30</td> <td>0.05</td> </tr> <tr> <td>Diff</td> <td>-3.50</td> <td>-0.30</td> <td>0.05</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	-3.50	-0.30	0.05	Diff	-3.50	-0.30	0.05																												
	Porepressure	Friction	Tip resistance																																												
Before	0.00	0.00	0.00																																												
After	-3.50	-0.30	0.05																																												
Diff	-3.50	-0.30	0.05																																												
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																											
Porepressure		Friction		Tip resistance																																											
Range	Code	Range	Code	Range	Code																																										
<input type="checkbox"/> Use scale factors																																															
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>1.41</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	1.41	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td></td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th>Density</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> <th>(ton/m³)</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td></td> <td>F</td> </tr> <tr> <td>0.70</td> <td>2.50</td> <td>1.70</td> <td></td> <td>Crust</td> </tr> <tr> <td>2.50</td> <td>3.20</td> <td></td> <td>0.84</td> <td></td> </tr> <tr> <td>3.20</td> <td>4.00</td> <td></td> <td>0.82</td> <td></td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td></td> <td>0.82</td> <td></td> </tr> <tr> <td>5.00</td> <td>22.10</td> <td></td> <td>0.82</td> <td></td> </tr> </tbody> </table>	Depth (m)		Density	Liquid limit	Soil	From	To	(ton/m ³)	0.00	0.70	1.70		F	0.70	2.50	1.70		Crust	2.50	3.20		0.84		3.20	4.00		0.82		4.00	5.00		0.82		5.00	22.10		0.82	
Depth (m)	Porepressure (kPa)																																														
1.41	0.00																																														
Depth (m)																																															
Depth (m)		Density	Liquid limit	Soil																																											
From	To	(ton/m ³)																																													
0.00	0.70	1.70		F																																											
0.70	2.50	1.70		Crust																																											
2.50	3.20		0.84																																												
3.20	4.00		0.82																																												
4.00	5.00		0.82																																												
5.00	22.10		0.82																																												
Notes 																																															


C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S008										
				Date 20220322										
Depth (m)		Classification	ρ	w_L	τ_{fu}	ϕ	σ_{vo}	σ'_{vo}	σ'_c	OCR	I_D	E	M_{OC}	M_{NC}
From	To		t/m ³		kPa	°	kPa	kPa	kPa		%	MPa	MPa	MPa
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.41	Crust	1.70				17.6	17.6						
1.41	2.50	Crust	1.70				32.6	27.2						
2.50	2.70	OC	1.60	0.84	23.4		43.3	31.4	110.4	3.52				
2.70	2.90	OC	1.60	0.84	22.6		46.4	32.5	104.9	3.22				
2.90	3.10	OC	1.60	0.84	21.5		49.5	33.7	97.8	2.90				
3.10	3.30	OC	1.60	0.82	20.9		52.7	34.8	94.8	2.72				
3.30	3.50	OC	1.60	0.82	20.7		55.8	35.9	92.9	2.58				
3.50	3.70	OC	1.60	0.82	21.2		59.0	37.1	95.2	2.57				
3.70	3.90	OC	1.60	0.82	21.1		62.1	38.2	93.7	2.45				
3.90	4.10	OC	1.60	0.82	20.7		65.2	39.4	90.7	2.30				
4.10	4.30	OC	1.60	0.82	20.3		68.4	40.5	87.8	2.17				
4.30	4.50	OC	1.60	0.82	20.5		71.5	41.6	88.4	2.12				
4.50	4.70	OC	1.60	0.82	20.5		74.7	42.8	87.7	2.05				
4.70	4.90	OC	1.60	0.82	20.5		77.8	43.9	87.5	1.99				
4.90	5.10	OC	1.60	0.82	20.5		80.9	45.1	86.6	1.92				
5.10	5.30	OC	1.60	0.82	20.7		84.1	46.2	87.5	1.89				
5.30	5.50	OC	1.60	0.82	20.4		87.2	47.3	85.0	1.79				
5.50	5.70	OC	1.60	0.82	20.2		90.4	48.5	83.7	1.73				
5.70	5.90	OC	1.60	0.82	19.8		93.5	49.6	81.3	1.64				
5.90	6.10	OC	1.60	0.82	19.6		96.6	50.8	79.6	1.57				
6.10	6.30	OC	1.60	0.82	19.7		99.8	51.9	79.7	1.54				
6.30	6.50	NC	1.60	0.82	19.7		102.9	53.0	79.3	1.50				
6.50	6.70	NC	1.60	0.82	20.0		106.0	54.2	80.4	1.48				
6.70	6.90	NC	1.60	0.82	20.2		109.2	55.3	80.8	1.46				
6.90	7.10	NC	1.60	0.82	20.3		112.3	56.5	81.0	1.43				
7.10	7.30	NC	1.60	0.82	20.3		115.5	57.6	80.6	1.40				
7.30	7.50	NC	1.60	0.82	20.8		118.6	58.7	82.5	1.40				
7.50	7.70	NC	1.60	0.82	20.5		121.7	59.9	80.9	1.35				
7.70	7.90	NC	1.60	0.82	21.1		124.9	61.0	83.4	1.37				
7.90	8.10	NC	1.60	0.82	21.0		128.0	62.2	82.5	1.33				
8.10	8.30	NC	1.60	0.82	21.0		131.2	63.3	82.0	1.30				
8.30	8.50	NC	1.60	0.82	21.2		134.3	64.4	82.9	1.29				
8.50	8.70	NC	1.60	0.82	21.5		137.4	65.6	83.6	1.28				
8.70	8.90	NC	1.60	0.82	21.6		140.6	66.7	84.1	1.26				
8.90	9.10	NC	1.60	0.82	22.0		143.7	67.8	85.4	1.26				
9.10	9.30	NC	1.60	0.82	22.3		146.9	69.0	86.5	1.25				
9.30	9.50	NC	1.60	0.82	21.8		150.0	70.1	83.7	1.19				
9.50	9.70	NC	1.60	0.82	22.2		153.1	71.3	85.6	1.20				
9.70	9.90	NC	1.60	0.82	22.9		156.3	72.4	88.3	1.22				
9.90	10.10	NC	1.60	0.82	23.1		159.4	73.5	89.2	1.21				
10.10	10.30	NC	1.60	0.82	22.8		162.6	74.7	87.3	1.17				
10.30	10.50	NC	1.60	0.82	22.7		165.7	75.8	86.7	1.14				
10.50	10.70	NC	1.60	0.82	23.2		168.8	77.0	88.6	1.15				
10.70	10.90	NC	1.60	0.82	24.3		172.0	78.1	93.8	1.20				
10.90	11.10	NC	1.60	0.82	24.8		175.1	79.2	95.7	1.21				
11.10	11.30	NC	1.60	0.82	24.9		178.2	80.4	96.0	1.19				
11.30	11.50	NC	1.60	0.82	24.7		181.4	81.5	94.4	1.16				
11.50	11.70	NC	1.60	0.82	24.1		184.5	82.7	91.2	1.10				
11.70	11.90	NC	1.60	0.82	23.8		187.7	83.8	89.4	1.07				
11.90	12.10	NC	1.60	0.82	23.7		190.8	84.9	88.6	1.04				
12.10	12.30	NC	1.60	0.82	24.6		193.9	86.1	92.7	1.08				
12.30	12.50	NC	1.60	0.82	25.2		197.1	87.2	95.2	1.09				
12.50	12.70	NC	1.60	0.82	25.0		200.2	88.4	93.9	1.06				
12.70	12.90	NC	1.60	0.82	25.4		203.4	89.5	95.5	1.07				
12.90	13.10	NC	1.60	0.82	25.3		206.5	90.6	94.7	1.04				
13.10	13.30	NC	1.60	0.82	25.1		209.6	91.8	93.6	1.02				
13.30	13.50	NC	1.60	0.82	25.4		212.8	92.9	94.7	1.02				
13.50	13.70	NC	1.60	0.82	25.7		215.9	94.0	95.7	1.02				
13.70	13.90	NC	1.60	0.82	25.6		219.1	95.2	95.2	1.00				
13.90	14.10	NC	1.60	0.82	26.0		222.2	96.3	96.6	1.00				
14.10	14.30	NC	1.60	0.82	26.4		225.3	97.5	98.1	1.01				
14.30	14.50	NC	1.60	0.82	27.2		228.5	98.6	101.7	1.03				
14.50	14.70	NC	1.85	0.82	29.4		231.9	100.0	111.4	1.11				
14.70	14.90	NC	1.85	0.82	29.5		235.5	101.6	111.7	1.10				
14.90	15.10	NC	1.85	0.82	29.5		239.1	103.2	111.2	1.08				
15.10	15.30	NC	1.85	0.82	30.3		242.7	104.9	114.7	1.09				
15.30	15.50	NC	1.85	0.82	30.4		246.4	106.5	114.3	1.07				
15.50	15.70	NC	1.85	0.82	30.4		250.0	108.1	114.0	1.05				
15.70	15.90	NC	1.85	0.82	31.1		253.6	109.8	116.9	1.06				
15.90	16.10	NC	1.85	0.82	31.3		257.3	111.4	117.7	1.06				
16.10	16.30	NC	1.85	0.82	32.2		260.9	113.0	121.2	1.07				
16.30	16.50	NC	1.85	0.82	33.6		264.5	114.7	127.5	1.11				
16.50	16.70	NC	1.85	0.82	34.7		268.2	116.3	132.0	1.14				
16.70	16.90	NC	1.85	0.82	37.0		271.8	117.9	142.5	1.21				
16.90	17.10	NC	1.85	0.82	37.3		275.4	119.5	143.6	1.20				
17.10	17.30	NC	1.85	0.82	38.4		279.0	121.2	148.5	1.23				

C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S008										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
17.30	17.50	CIL	NC	1.85	0.82	38.3		282.7	122.8	147.5	1.20			
17.50	17.70	CIL	NC	1.85	0.82	38.4		286.3	124.4	147.3	1.18			
17.70	17.90	CIL	NC	1.85	0.82	37.8		289.9	126.1	144.3	1.14			
17.90	18.10	CIL	NC	1.85	0.82	37.5		293.6	127.7	142.3	1.11			
18.10	18.30	CIL	NC	1.85	0.82	37.5		297.2	129.3	141.7	1.10			
18.30	18.50	CIL	NC	1.85	0.82	37.0		300.8	131.0	139.2	1.06			
18.50	18.70	CIL	NC	1.85	0.82	39.2		304.5	132.6	149.1	1.12			
18.70	18.90	CIL	NC	1.85	0.82	40.0		308.1	134.2	152.2	1.13			
18.90	19.10	CIL	NC	1.85	0.82	39.9		311.7	135.8	151.5	1.12			
19.10	19.30	CIL	NC	1.85	0.82	37.9		315.3	137.5	141.7	1.03			
19.30	19.50	CIL	NC	1.85	0.82	38.6		319.0	139.1	144.6	1.04			
19.50	19.70	CIL	NC	1.85	0.82	38.8		322.6	140.7	144.8	1.03			
19.70	19.90	CIL	NC	1.85	0.82	38.2		326.2	142.4	141.7	1.00			
19.90	20.10	CIL	NC	1.85	0.82	38.4		329.9	144.0	142.6	1.00			
20.10	20.30	CIL	NC	1.85	0.82	37.7		333.5	145.6	140.2	1.00			
20.30	20.50	CIL	NC	1.85	0.82	36.5		337.1	147.3	135.6	1.00			
20.50	20.70	CIM	NC	1.85	0.82	40.4		340.8	148.9	150.4	1.01			
20.70	20.90	CIL	NC	1.85	0.82	39.4		344.4	150.5	146.2	1.00			
20.90	21.10	CIL	NC	1.85	0.82	37.6		348.0	152.1	139.7	1.00			
21.10	21.30	CIL	NC	1.85	0.82	37.4		351.6	153.8	138.7	1.00			
21.30	21.50	CIL	NC	1.85	0.82	37.8		355.3	155.4	140.2	1.00			
21.50	21.70	CIL	NC	1.85	0.82	38.2		358.9	157.0	141.8	1.00			
21.70	21.90	CIL	NC	1.85	0.82	37.4		362.5	158.7	138.7	1.00			
21.90	22.10	CIL	NC	1.85	0.82	37.3		366.2	160.3	138.5	1.00			


CPT-test performed according to EN ISO 22476-1

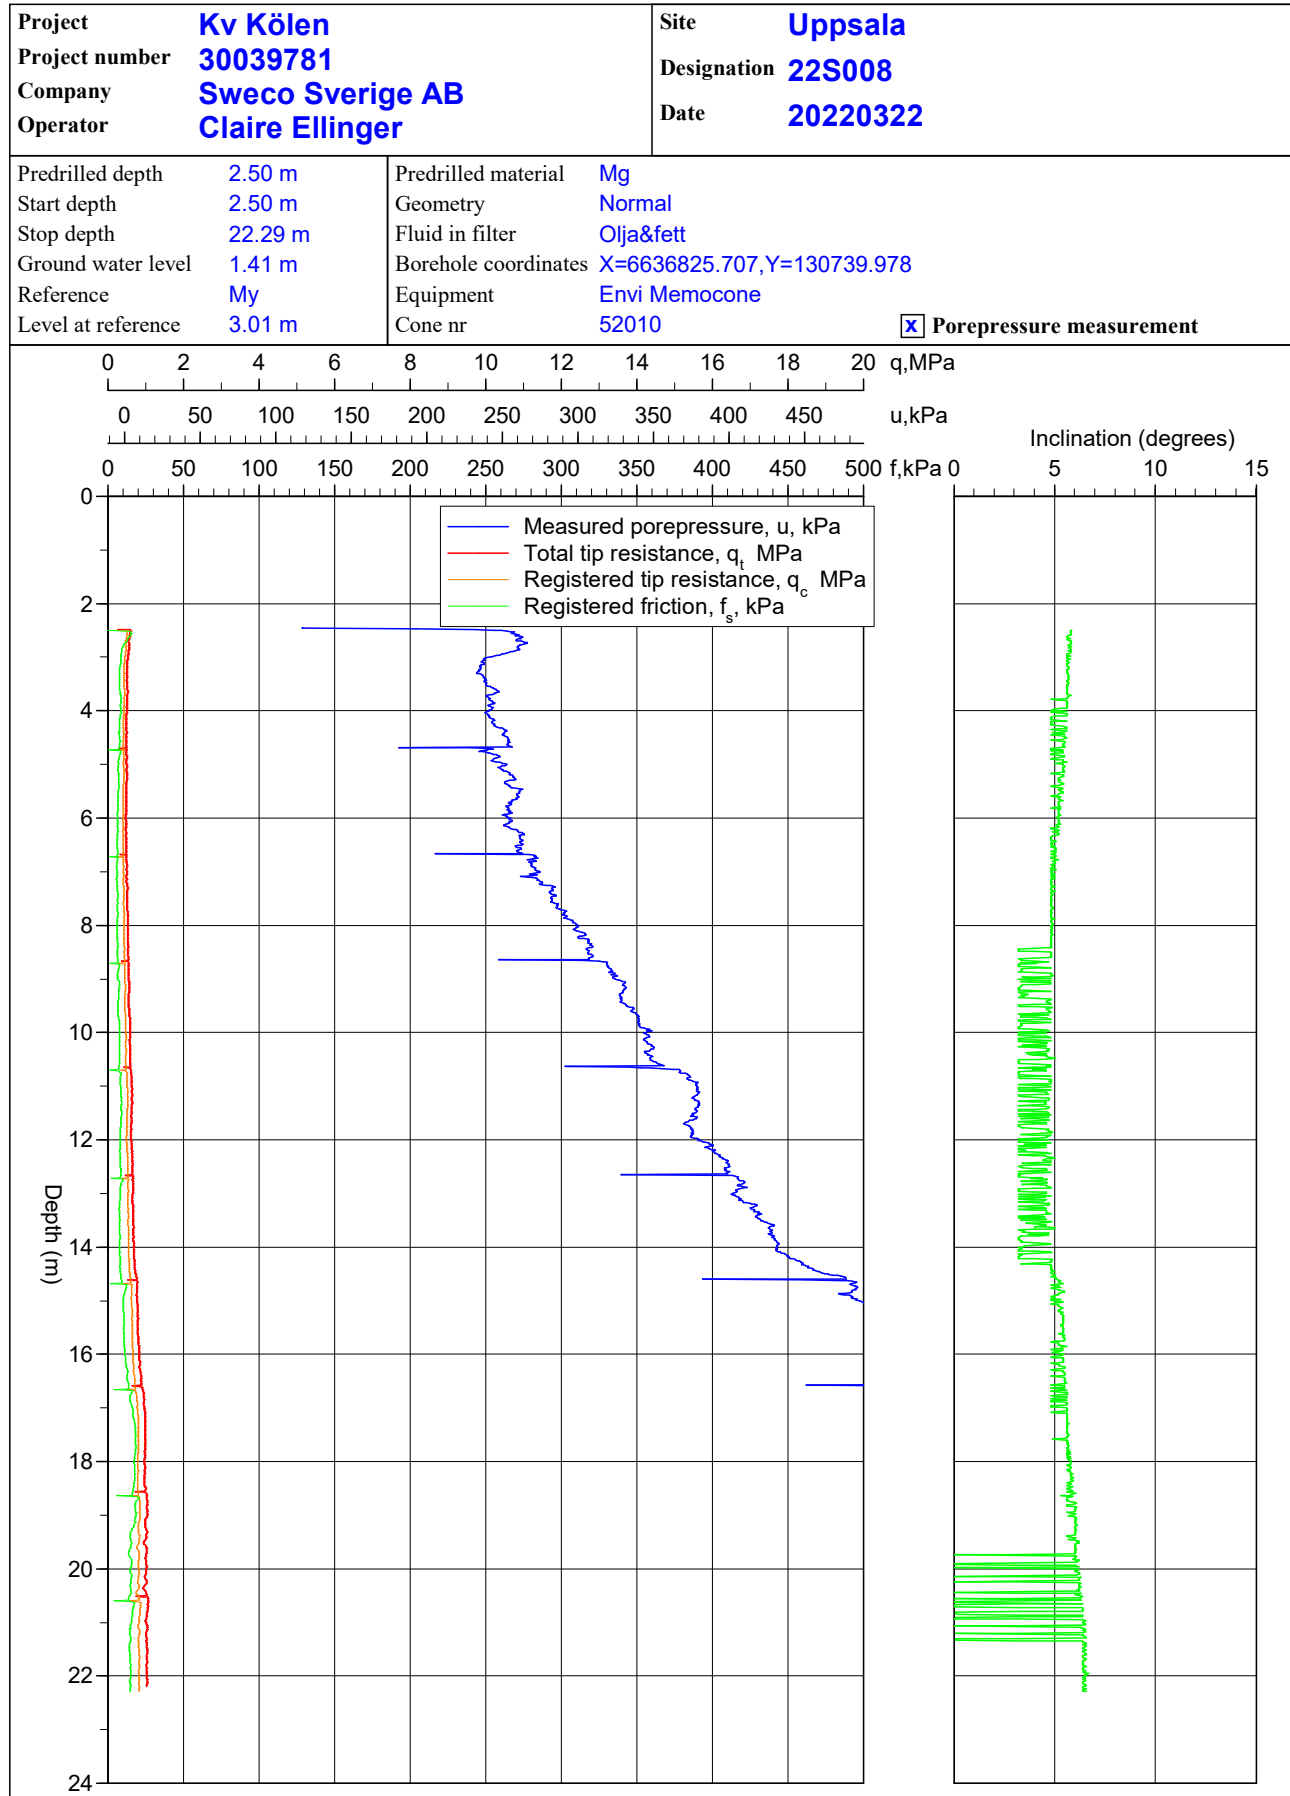

CPT-test performed according to EN ISO 22476-1

Predrilling depth	3.50 m	Reference	My	Fluid in filter	Olja&fett
Start depth	3.50 m	Level at reference	3.07 m	Coordinats	X=6636871.669,Y=130830.461
Stop depth	35.34 m	Predrilled material	Mg	Equipment	Envi Memocone
Ground water level	1.47 m	Geometry	Normal	Cone nr	52010


Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S009
Date	20220322

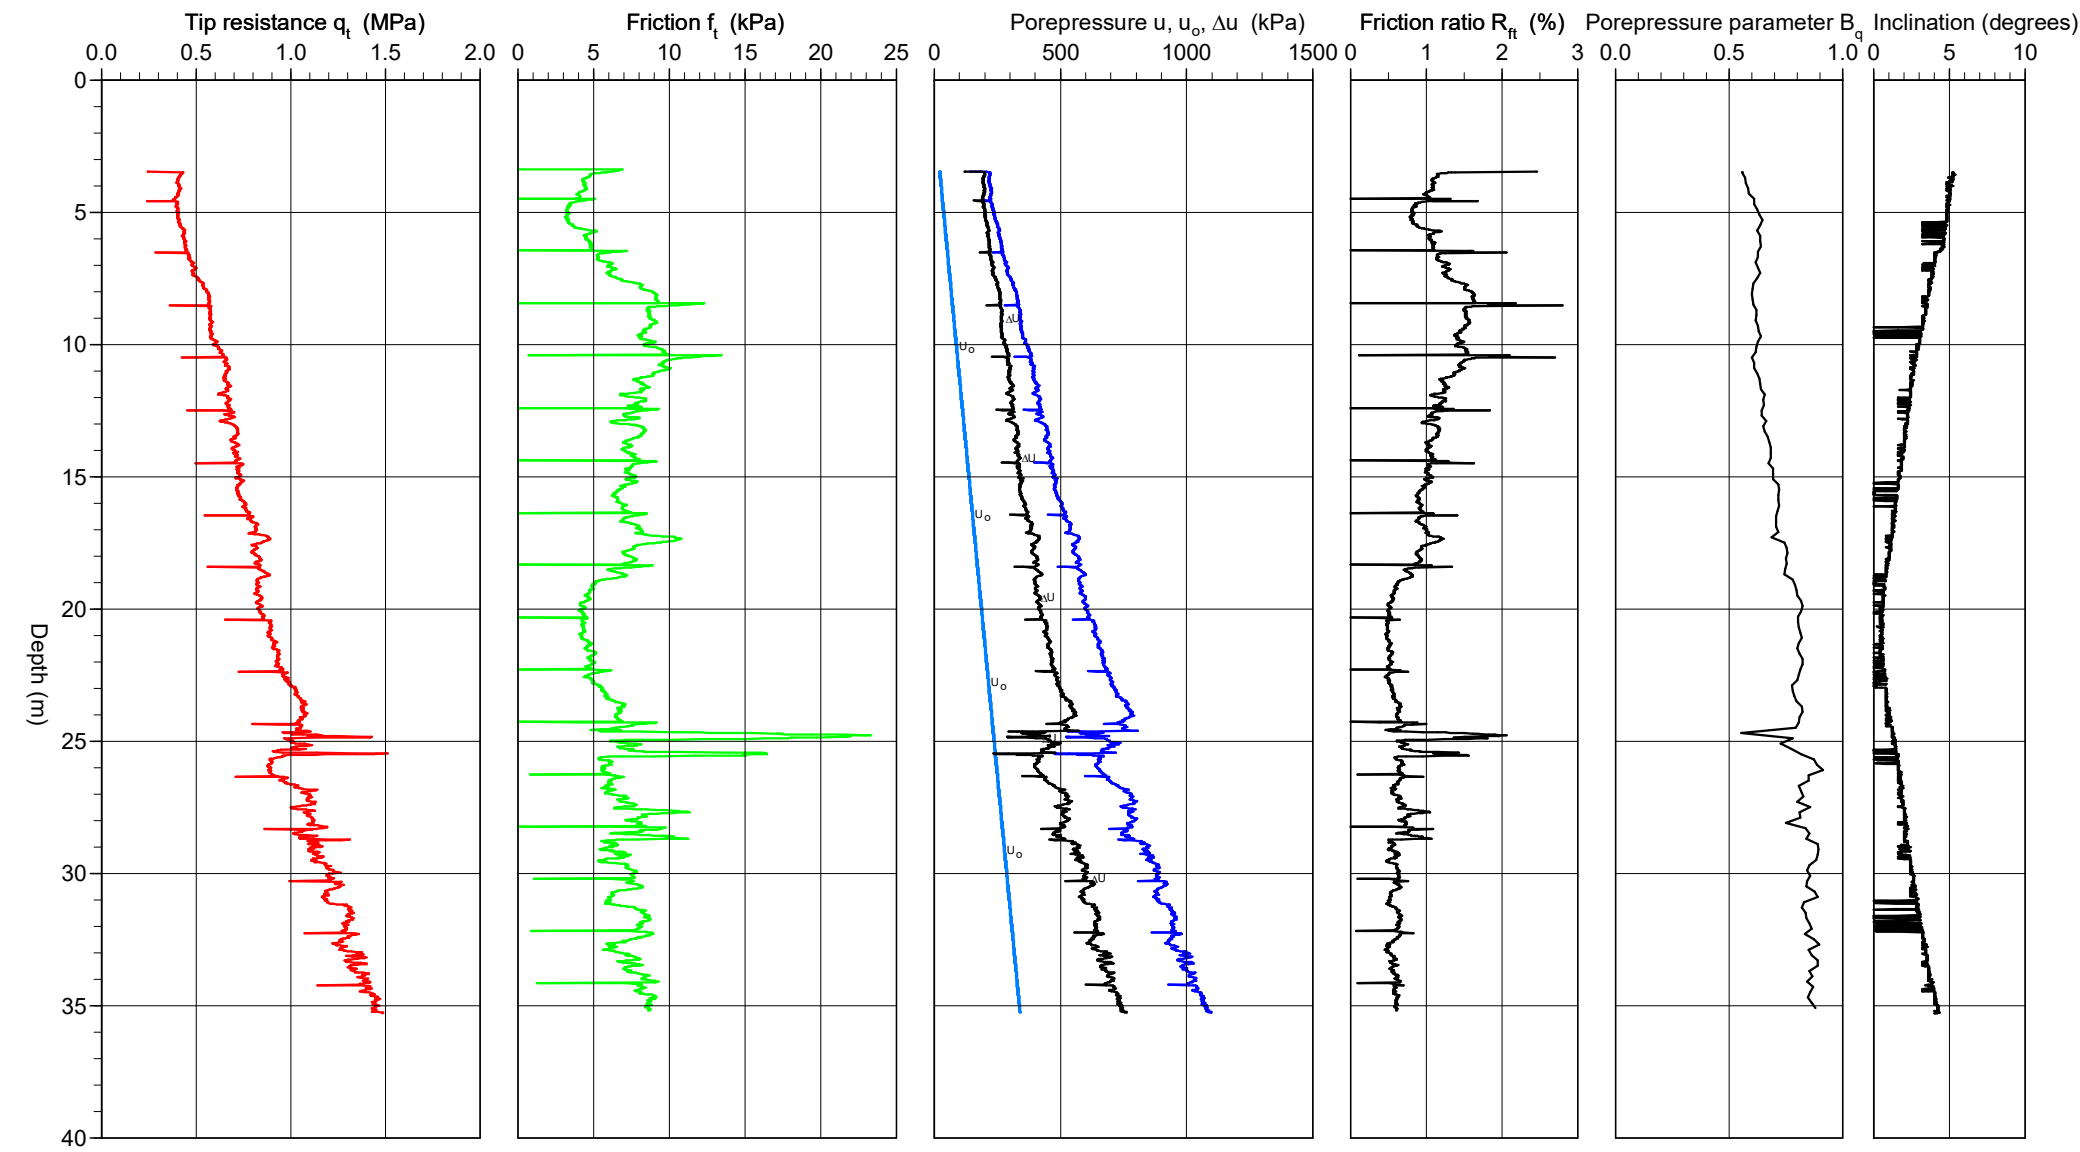

CPT test evaluated according to SGI Information 15 rev. 2007

Project Kv Kölen
 Project nr 30039781
 Site Uppsala
 Designation 22S009
 Date 20220322


Reference My Predrilling depth 3.50 m Evaluator INPRAG
 Level at reference 3.07 m Predrilled material Mg Evaluation date 2022-04-12
 Ground water level 1.47 m Equipment Envi Memocone
 Start depth 3.50 m Geometry Normal

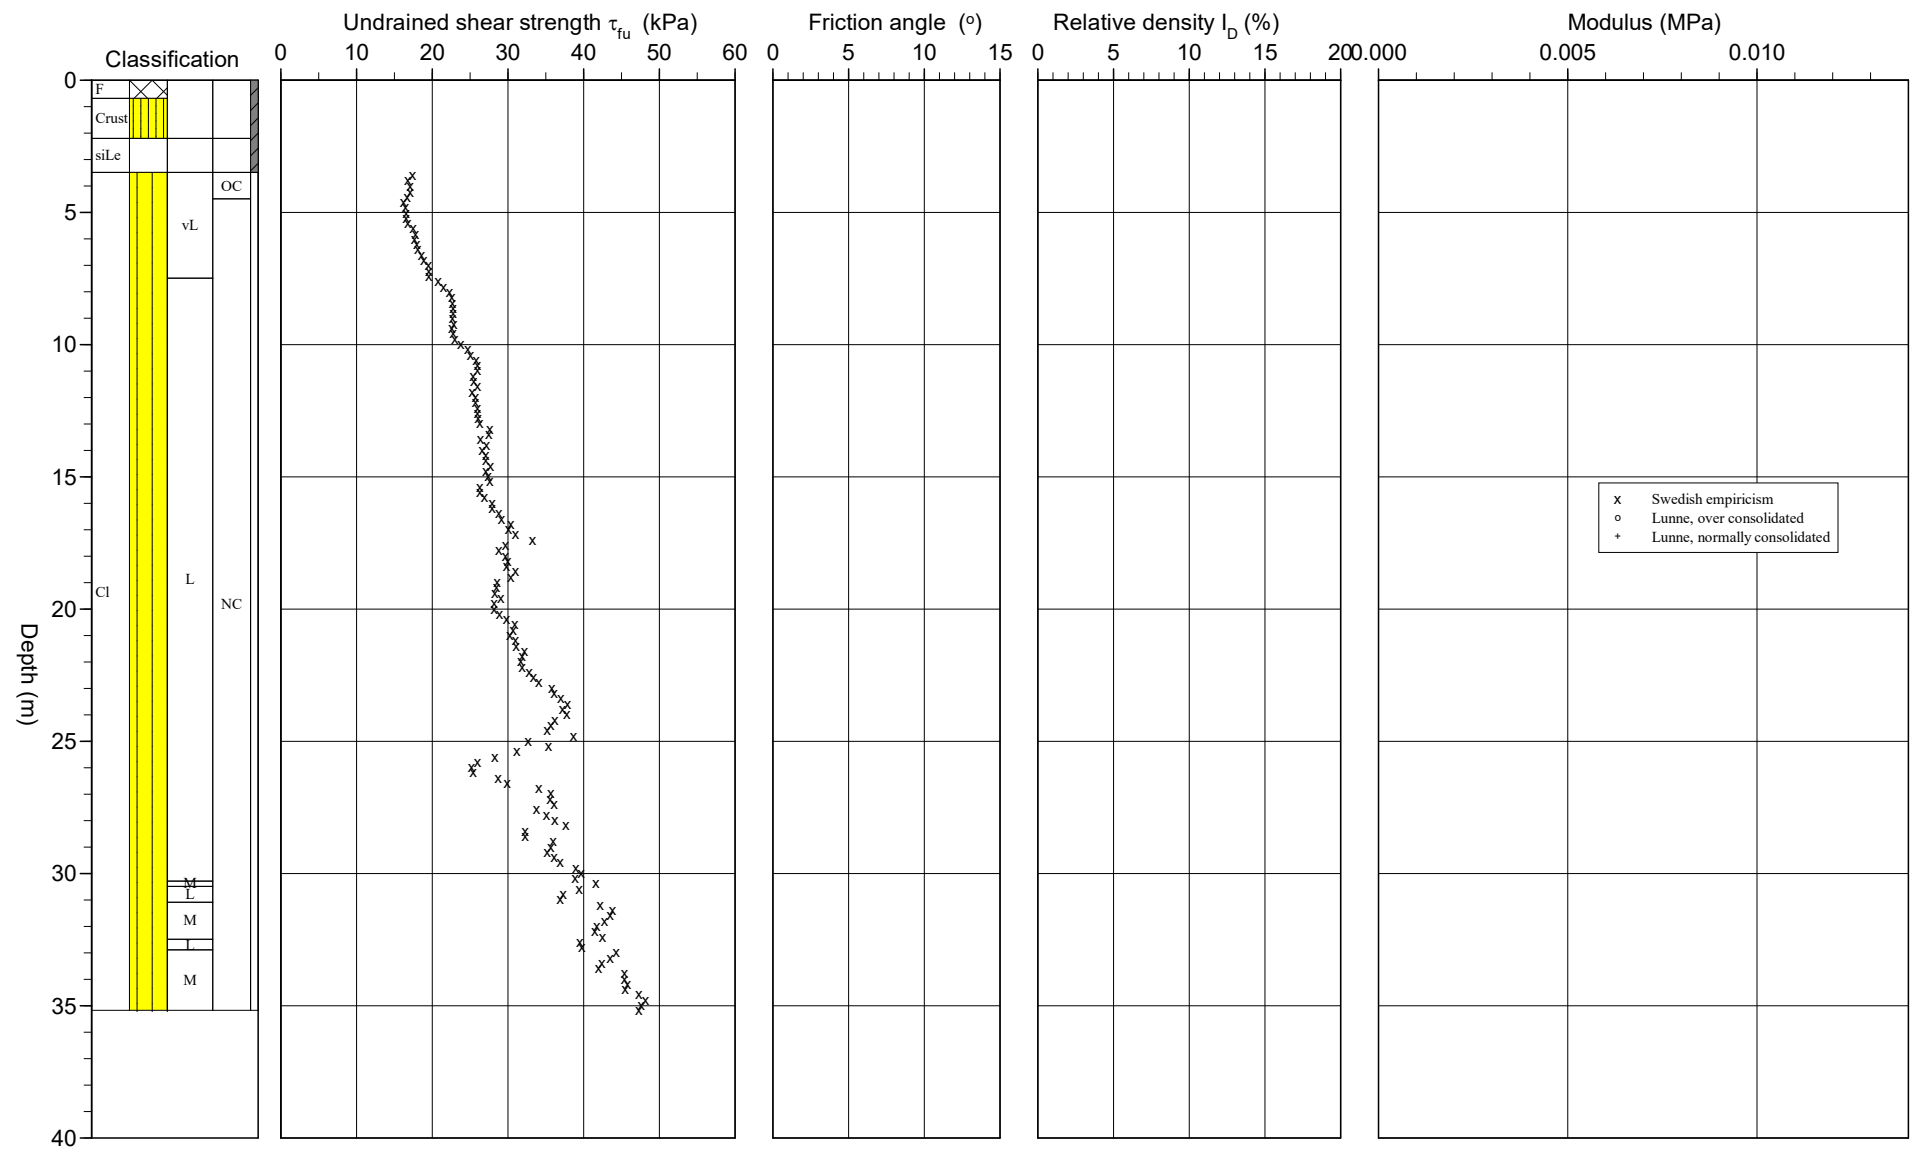

CPT test evaluated according to SGI Information 15 rev. 2007

Reference	My	Predrilling depth	3.50 m	Evaluator	INPRAG
Ground water level	3.07 m	Predrilled material	Mg	Evaluation date	2022-04-12
Grundvattenyta	1.47 m	Equipment	Envi Memocone		
Start depth	3.50 m	Geometry	Normal		

Project	Kv Kölen
Project nr	30039781
Site	Uppsala
Designation	22S009
Date	20220322

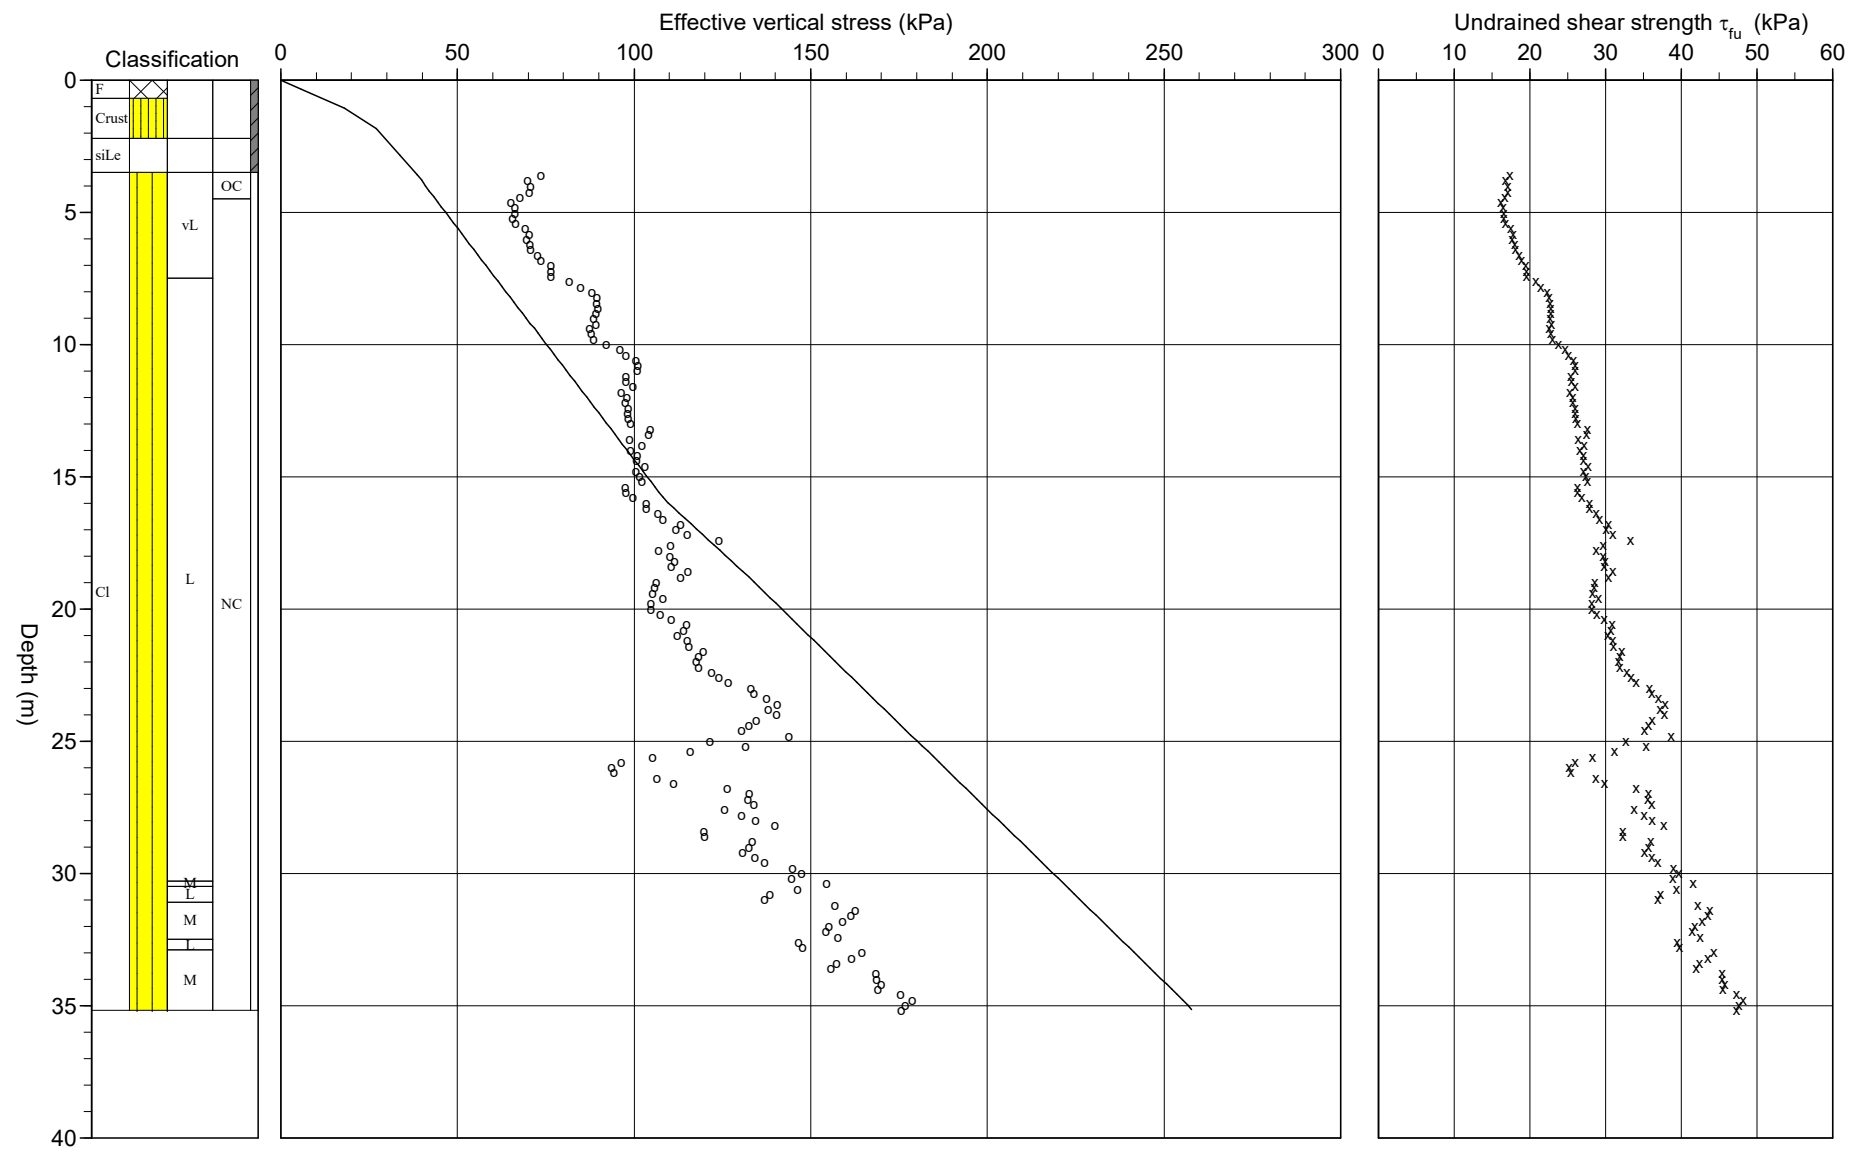

C P T - test

Project Kv Kölen 30039781		Site Uppsala Designation 22S009 Date 20220322																																					
Predrilling depth 3.50 m Start depth 3.50 m Stop depth 35.34 m Ground water level 1.47 m Reference My Level at reference 3.07 m	Predrilled material Mg Geometry Normal Fluid in filter Olja&fett Operator Claire Ellinger Equipment Envi Memocone <input checked="" type="checkbox"/> Porepressure measurement																																						
Calibration data Cone 52010 Internal friction O_c 0.0 kPa Date 2021-04-07 Internal friction O_f 0.0 kPa Areafactor a 0.690 Cross talk c_1 0.000 Areafactor b 0.006 Cross talk c_2 0.000		Cero values, kPa <table border="1"> <thead> <tr> <th></th> <th>Porepressure</th> <th>Friction</th> <th>Tip resistance</th> </tr> </thead> <tbody> <tr> <td>Before</td> <td>0.00</td> <td>0.00</td> <td>0.00</td> </tr> <tr> <td>After</td> <td>1.40</td> <td>0.20</td> <td>0.00</td> </tr> <tr> <td>Diff</td> <td>1.40</td> <td>0.20</td> <td>0.00</td> </tr> </tbody> </table>			Porepressure	Friction	Tip resistance	Before	0.00	0.00	0.00	After	1.40	0.20	0.00	Diff	1.40	0.20	0.00																				
	Porepressure	Friction	Tip resistance																																				
Before	0.00	0.00	0.00																																				
After	1.40	0.20	0.00																																				
Diff	1.40	0.20	0.00																																				
Scale factors <table border="1"> <thead> <tr> <th colspan="2">Porepressure</th> <th colspan="2">Friction</th> <th colspan="2">Tip resistance</th> </tr> <tr> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> <th>Range</th> <th>Code</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Porepressure		Friction		Tip resistance		Range	Code	Range	Code	Range	Code							Correction Porepressure (none) Friction (none) Tip resistance (none) Estimated sounding class																			
Porepressure		Friction		Tip resistance																																			
Range	Code	Range	Code	Range	Code																																		
<input type="checkbox"/> Use scale factors																																							
Porepressure observations <table border="1"> <thead> <tr> <th>Depth (m)</th> <th>Porepressure (kPa)</th> </tr> </thead> <tbody> <tr> <td>1.47</td> <td>0.00</td> </tr> </tbody> </table>		Depth (m)	Porepressure (kPa)	1.47	0.00	Boundaries <table border="1"> <thead> <tr> <th>Depth (m)</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>	Depth (m)		Classification <table border="1"> <thead> <tr> <th colspan="2">Depth (m)</th> <th>Density</th> <th rowspan="2">Liquid limit</th> <th rowspan="2">Soil</th> </tr> <tr> <th>From</th> <th>To</th> <th>(ton/m³)</th> </tr> </thead> <tbody> <tr> <td>0.00</td> <td>0.70</td> <td>1.70</td> <td rowspan="5">0.84</td> <td rowspan="5">F Crust siLe</td> </tr> <tr> <td>0.70</td> <td>2.20</td> <td>1.70</td> </tr> <tr> <td>2.20</td> <td>3.50</td> <td>1.70</td> </tr> <tr> <td>3.50</td> <td>4.00</td> <td> </td> </tr> <tr> <td>4.00</td> <td>5.00</td> <td> </td> </tr> <tr> <td>5.00</td> <td>35.20</td> <td> </td> <td>0.82</td> <td> </td> </tr> </tbody> </table>	Depth (m)		Density	Liquid limit	Soil	From	To	(ton/m ³)	0.00	0.70	1.70	0.84	F Crust siLe	0.70	2.20	1.70	2.20	3.50	1.70	3.50	4.00		4.00	5.00		5.00	35.20		0.82	
Depth (m)	Porepressure (kPa)																																						
1.47	0.00																																						
Depth (m)																																							
Depth (m)		Density	Liquid limit	Soil																																			
From	To	(ton/m ³)																																					
0.00	0.70	1.70	0.84	F Crust siLe																																			
0.70	2.20	1.70																																					
2.20	3.50	1.70																																					
3.50	4.00																																						
4.00	5.00																																						
5.00	35.20		0.82																																				
Notes 																																							

C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S009										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
0.00	0.70	F	1.70				5.8	5.8						
0.70	1.47	Crust	1.70				18.1	18.1						
1.47	2.20	Crust	1.70				30.6	27.0						
2.20	3.50	siLe	1.70	0.84			47.5	33.7						
3.50	3.70	CI vL	OC	1.60	0.82	17.4	59.9	38.6	73.7	1.91				
3.70	3.90	CI vL	OC	1.60	0.82	16.8	63.1	39.8	69.8	1.75				
3.90	4.10	CI vL	OC	1.60	0.82	17.1	66.2	40.9	70.7	1.73				
4.10	4.30	CI vL	OC	1.60	0.82	17.1	69.4	42.1	70.3	1.67				
4.30	4.50	CI vL	OC	1.60	0.82	16.7	72.5	43.2	67.8	1.57				
4.50	4.70	CI vL	NC	1.60	0.82	16.2	75.6	44.3	65.1	1.47				
4.70	4.90	CI vL	NC	1.60	0.82	16.5	78.8	45.5	66.1	1.45				
4.90	5.10	CI vL	NC	1.60	0.82	16.6	81.9	46.6	66.1	1.42				
5.10	5.30	CI vL	NC	1.60	0.82	16.6	85.1	47.8	65.6	1.37				
5.30	5.50	CI vL	NC	1.60	0.82	16.8	88.2	48.9	66.4	1.36				
5.50	5.70	CI vL	NC	1.60	0.82	17.5	91.3	50.0	69.2	1.38				
5.70	5.90	CI vL	NC	1.60	0.82	17.8	94.5	51.2	70.2	1.37				
5.90	6.10	CI vL	NC	1.60	0.82	17.7	97.6	52.3	69.7	1.33				
6.10	6.30	CI vL	NC	1.60	0.82	18.0	100.7	53.5	70.6	1.32				
6.30	6.50	CI vL	NC	1.60	0.82	18.1	103.9	54.6	70.7	1.29				
6.50	6.70	CI vL	NC	1.60	0.82	18.6	107.0	55.7	72.7	1.30				
6.70	6.90	CI vL	NC	1.60	0.82	18.9	110.2	56.9	73.8	1.30				
6.90	7.10	CI vL	NC	1.60	0.82	19.5	113.3	58.0	76.6	1.32				
7.10	7.30	CI vL	NC	1.60	0.82	19.6	116.4	59.2	76.5	1.29				
7.30	7.50	CI vL	NC	1.60	0.82	19.6	119.6	60.3	76.4	1.27				
7.50	7.70	CI L	NC	1.60	0.82	20.8	122.7	61.4	81.5	1.33				
7.70	7.90	CI L	NC	1.60	0.82	21.5	125.9	62.6	84.9	1.36				
7.90	8.10	CI L	NC	1.60	0.82	22.3	129.0	63.7	88.2	1.38				
8.10	8.30	CI L	NC	1.60	0.82	22.6	132.1	64.9	89.5	1.38				
8.30	8.50	CI L	NC	1.60	0.82	22.7	135.3	66.0	89.4	1.35				
8.50	8.70	CI L	NC	1.60	0.82	22.8	138.4	67.1	89.7	1.34				
8.70	8.90	CI L	NC	1.60	0.82	22.8	141.6	68.3	89.1	1.31				
8.90	9.10	CI L	NC	1.60	0.82	22.7	144.7	69.4	88.5	1.27				
9.10	9.30	CI L	NC	1.60	0.82	22.9	147.8	70.5	89.2	1.26				
9.30	9.50	CI L	NC	1.60	0.82	22.6	151.0	71.7	87.4	1.22				
9.50	9.70	CI L	NC	1.60	0.82	22.8	154.1	72.8	87.9	1.21				
9.70	9.90	CI L	NC	1.60	0.82	23.0	157.3	74.0	88.4	1.20				
9.90	10.10	CI L	NC	1.60	0.82	23.8	160.4	75.1	92.0	1.23				
10.10	10.30	CI L	NC	1.60	0.82	24.7	163.5	76.2	96.0	1.26				
10.30	10.50	CI L	NC	1.60	0.82	25.1	166.7	77.4	97.7	1.26				
10.50	10.70	CI L	NC	1.60	0.82	25.8	169.8	78.5	100.5	1.28				
10.70	10.90	CI L	NC	1.60	0.82	26.0	173.0	79.7	101.2	1.27				
10.90	11.10	CI L	NC	1.60	0.82	26.0	176.1	80.8	100.9	1.25				
11.10	11.30	CI L	NC	1.60	0.82	25.4	179.2	81.9	97.7	1.19				
11.30	11.50	CI L	NC	1.60	0.82	25.5	182.4	83.1	97.7	1.18				
11.50	11.70	CI L	NC	1.60	0.82	26.0	185.5	84.2	99.7	1.18				
11.70	11.90	CI L	NC	1.60	0.82	25.3	188.6	85.4	96.4	1.13				
11.90	12.10	CI L	NC	1.60	0.82	25.7	191.8	86.5	97.9	1.13				
12.10	12.30	CI L	NC	1.60	0.82	25.7	194.9	87.6	97.6	1.11				
12.30	12.50	CI L	NC	1.60	0.82	26.0	198.1	88.8	98.4	1.11				
12.50	12.70	CI L	NC	1.60	0.82	26.0	201.2	89.9	98.2	1.09				
12.70	12.90	CI L	NC	1.60	0.82	26.1	204.3	91.1	98.4	1.08				
12.90	13.10	CI L	NC	1.60	0.82	26.3	207.5	92.2	99.0	1.07				
13.10	13.30	CI L	NC	1.60	0.82	27.6	210.6	93.3	104.7	1.12				
13.30	13.50	CI L	NC	1.60	0.82	27.5	213.8	94.5	104.1	1.10				
13.50	13.70	CI L	NC	1.60	0.82	26.4	216.9	95.6	98.9	1.03				
13.70	13.90	CI L	NC	1.60	0.82	27.2	220.0	96.7	102.2	1.06				
13.90	14.10	CI L	NC	1.60	0.82	26.6	223.2	97.9	99.0	1.01				
14.10	14.30	CI L	NC	1.60	0.82	27.1	226.3	99.0	100.9	1.02				
14.30	14.50	CI L	NC	1.60	0.82	27.1	229.5	100.2	100.7	1.01				
14.50	14.70	CI L	NC	1.60	0.82	27.7	232.6	101.3	103.0	1.02				
14.70	14.90	CI L	NC	1.60	0.82	27.1	235.7	102.4	100.5	1.00				
14.90	15.10	CI L	NC	1.60	0.82	27.4	238.9	103.6	101.6	1.00				
15.10	15.30	CI L	NC	1.60	0.82	27.6	242.0	104.7	102.3	1.00				
15.30	15.50	CI L	NC	1.60	0.82	26.3	245.2	105.9	97.5	1.00				
15.50	15.70	CI L	NC	1.60	0.82	26.3	248.3	107.0	97.8	1.00				
15.70	15.90	CI L	NC	1.60	0.82	26.9	251.4	108.1	99.7	1.00				
15.90	16.10	CI L	NC	1.85	0.82	27.9	254.8	109.5	103.6	1.00				
16.10	16.30	CI L	NC	1.85	0.82	27.9	258.4	111.2	103.6	1.00				
16.30	16.50	CI L	NC	1.85	0.82	28.8	262.1	112.8	106.8	1.00				
16.50	16.70	CI L	NC	1.85	0.82	29.2	265.7	114.4	108.3	1.00				
16.70	16.90	CI L	NC	1.85	0.82	30.4	269.3	116.0	113.1	1.00				
16.90	17.10	CI L	NC	1.85	0.82	30.1	273.0	117.7	111.9	1.00				
17.10	17.30	CI L	NC	1.85	0.82	31.0	276.6	119.3	115.1	1.00				
17.30	17.50	CI L	NC	1.85	0.82	33.3	280.2	120.9	124.1	1.03				
17.50	17.70	CI L	NC	1.85	0.82	29.7	283.9	122.6	110.4	1.00				
17.70	17.90	CI L	NC	1.85	0.82	28.8	287.5	124.2	106.9	1.00				
17.90	18.10	CI L	NC	1.85	0.82	29.7	291.1	125.8	110.2	1.00				


C P T - test

Project Kv Kölen 30039781							Site Uppsala Designation 22S009 Date 20220322							
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
18.10	18.30	CIL	NC	1.85	0.82	30.0	294.7	127.5	111.5	1.00				
18.30	18.50	CIL	NC	1.85	0.82	29.8	298.4	129.1	110.7	1.00				
18.50	18.70	CIL	NC	1.85	0.82	31.0	302.0	130.7	115.2	1.00				
18.70	18.90	CIL	NC	1.85	0.82	30.4	305.6	132.3	113.0	1.00				
18.90	19.10	CIL	NC	1.80	0.82	28.6	309.2	133.9	106.2	1.00				
19.10	19.30	CIL	NC	1.80	0.82	28.5	312.7	135.5	105.8	1.00				
19.30	19.50	CIL	NC	1.80	0.82	28.3	316.3	137.0	105.2	1.00				
19.50	19.70	CIL	NC	1.80	0.82	29.1	319.8	138.5	108.1	1.00				
19.70	19.90	CIL	NC	1.80	0.82	28.2	323.3	140.0	104.7	1.00				
19.90	20.10	CIL	NC	1.80	0.82	28.2	326.9	141.6	104.8	1.00				
20.10	20.30	CIL	NC	1.80	0.82	28.9	330.4	143.1	107.4	1.00				
20.30	20.50	CIL	NC	1.80	0.82	29.8	333.9	144.6	110.6	1.00				
20.50	20.70	CIL	NC	1.80	0.82	30.9	337.5	146.2	114.8	1.00				
20.70	20.90	CIL	NC	1.80	0.82	30.7	341.0	147.7	114.0	1.00				
20.90	21.10	CIL	NC	1.80	0.82	30.3	344.5	149.2	112.4	1.00				
21.10	21.30	CIL	NC	1.80	0.82	31.0	348.1	150.8	115.1	1.00				
21.30	21.50	CIL	NC	1.80	0.82	31.1	351.6	152.3	115.5	1.00				
21.50	21.70	CIL	NC	1.80	0.82	32.2	355.1	153.8	119.6	1.00				
21.70	21.90	CIL	NC	1.80	0.82	31.9	358.7	155.4	118.3	1.00				
21.90	22.10	CIL	NC	1.80	0.82	31.7	362.2	156.9	117.6	1.00				
22.10	22.30	CIL	NC	1.80	0.82	31.9	365.7	158.4	118.3	1.00				
22.30	22.50	CIL	NC	1.80	0.82	32.8	369.2	160.0	121.9	1.00				
22.50	22.70	CIL	NC	1.80	0.82	33.4	372.8	161.5	124.1	1.00				
22.70	22.90	CIL	NC	1.80	0.82	34.1	376.3	163.0	126.7	1.00				
22.90	23.10	CIL	NC	1.80	0.82	35.8	379.8	164.6	133.0	1.00				
23.10	23.30	CIL	NC	1.80	0.82	36.1	383.4	166.1	133.9	1.00				
23.30	23.50	CIL	NC	1.80	0.82	37.0	386.9	167.6	137.5	1.00				
23.50	23.70	CIL	NC	1.80	0.82	37.9	390.4	169.1	140.6	1.00				
23.70	23.90	CIL	NC	1.80	0.82	37.2	394.0	170.7	138.1	1.00				
23.90	24.10	CIL	NC	1.80	0.82	37.8	397.5	172.2	140.3	1.00				
24.10	24.30	CIL	NC	1.80	0.82	36.2	401.0	173.7	134.5	1.00				
24.30	24.50	CIL	NC	1.80	0.82	35.7	404.6	175.3	132.4	1.00				
24.50	24.70	CIL	NC	1.80	0.82	35.2	408.1	176.8	130.5	1.00				
24.70	24.90	CIL	NC	1.85	0.82	38.7	411.7	178.4	143.7	1.00				
24.90	25.10	CIL	NC	1.80	0.82	32.7	415.3	180.0	121.5	1.00				
25.10	25.30	CIL	NC	1.85	0.82	35.4	418.8	181.5	131.5	1.00				
25.30	25.50	CIL	NC	1.80	0.82	31.2	422.4	183.1	116.0	1.00				
25.50	25.70	CIL	NC	1.80	0.82	28.3	426.0	184.7	105.2	1.00				
25.70	25.90	CIL	NC	1.80	0.82	26.0	429.5	186.2	96.5	1.00				
25.90	26.10	CIL	NC	1.80	0.82	25.2	433.0	187.7	93.6	1.00				
26.10	26.30	CIL	NC	1.80	0.82	25.4	436.5	189.3	94.3	1.00				
26.30	26.50	CIL	NC	1.80	0.82	28.7	440.1	190.8	106.4	1.00				
26.50	26.70	CIL	NC	1.80	0.82	29.9	443.6	192.3	111.1	1.00				
26.70	26.90	CIL	NC	1.80	0.82	34.1	447.1	193.8	126.5	1.00				
26.90	27.10	CIL	NC	1.80	0.82	35.7	450.7	195.4	132.6	1.00				
27.10	27.30	CIL	NC	1.80	0.82	35.6	454.2	196.9	132.2	1.00				
27.30	27.50	CIL	NC	1.80	0.82	36.1	457.7	198.4	133.9	1.00				
27.50	27.70	CIL	NC	1.80	0.82	33.8	461.3	200.0	125.5	1.00				
27.70	27.90	CIL	NC	1.80	0.82	35.1	464.8	201.5	130.4	1.00				
27.90	28.10	CIL	NC	1.80	0.82	36.2	468.3	203.0	134.4	1.00				
28.10	28.30	CIL	NC	1.85	0.82	37.7	471.9	204.6	139.8	1.00				
28.30	28.50	CIL	NC	1.80	0.82	32.3	475.5	206.2	119.9	1.00				
28.50	28.70	CIL	NC	1.80	0.82	32.3	479.0	207.7	120.0	1.00				
28.70	28.90	CIL	NC	1.80	0.82	36.0	482.6	209.3	133.6	1.00				
28.90	29.10	CIL	NC	1.80	0.82	35.7	486.1	210.8	132.5	1.00				
29.10	29.30	CIL	NC	1.80	0.82	35.2	489.6	212.3	130.6	1.00				
29.30	29.50	CIL	NC	1.80	0.82	36.1	493.1	213.9	134.2	1.00				
29.50	29.70	CIL	NC	1.80	0.82	36.9	496.7	215.4	136.9	1.00				
29.70	29.90	CIL	NC	1.80	0.82	39.0	500.2	216.9	144.8	1.00				
29.90	30.10	CIL	NC	1.80	0.82	39.7	503.7	218.5	147.4	1.00				
30.10	30.30	CIL	NC	1.80	0.82	38.9	507.3	220.0	144.6	1.00				
30.30	30.50	CI M	NC	1.80	0.82	41.6	510.8	221.5	154.5	1.00				
30.50	30.70	CIL	NC	1.80	0.82	39.4	514.3	223.0	146.4	1.00				
30.70	30.90	CIL	NC	1.80	0.82	37.3	517.9	224.6	138.4	1.00				
30.90	31.10	CIL	NC	1.80	0.82	36.9	521.4	226.1	137.0	1.00				
31.10	31.30	CI M	NC	1.80	0.82	42.2	524.9	227.6	156.8	1.00				
31.30	31.50	CI M	NC	1.80	0.82	43.8	528.5	229.2	162.7	1.00				
31.50	31.70	CI M	NC	1.80	0.82	43.5	532.0	230.7	161.3	1.00				
31.70	31.90	CI M	NC	1.80	0.82	42.8	535.5	232.2	158.9	1.00				
31.90	32.10	CI M	NC	1.80	0.82	41.8	539.1	233.8	155.1	1.00				
32.10	32.30	CI M	NC	1.80	0.82	41.5	542.6	235.3	154.3	1.00				
32.30	32.50	CI M	NC	1.80	0.82	42.5	546.1	236.8	157.7	1.00				
32.50	32.70	CIL	NC	1.80	0.82	39.5	549.7	238.4	146.7	1.00				
32.70	32.90	CIL	NC	1.80	0.82	39.8	553.2	239.9	147.7	1.00				
32.90	33.10	CI M	NC	1.80	0.82	44.3	556.7	241.4	164.6	1.00				
33.10	33.30	CI M	NC	1.80	0.82	43.5	560.2	243.0	161.5	1.00				
33.30	33.50	CI M	NC	1.80	0.82	42.4	563.8	244.5	157.4	1.00				

C P T - test

Project				Site										
Kv Kölen 30039781				Uppsala										
				Designation 22S009										
				Date 20220322										
Depth (m)		Classification	ρ t/m ³	w_L	τ_{fu} kPa	ϕ °	σ_{vo} kPa	σ'_{vo} kPa	σ'_c kPa	OCR	I_D %	E MPa	M_{OC} MPa	M_{NC} MPa
From	To													
33.50	33.70	CI M	NC 1.80	0.82	42.0		567.3	246.0	155.8	1.00				
33.70	33.90	CI M	NC 1.80	0.82	45.4		570.8	247.6	168.5	1.00				
33.90	34.10	CI M	NC 1.80	0.82	45.4		574.4	249.1	168.7	1.00				
34.10	34.30	CI M	NC 1.80	0.82	45.8		577.9	250.6	169.9	1.00				
34.30	34.50	CI M	NC 1.80	0.82	45.5		581.4	252.1	169.0	1.00				
34.50	34.70	CI M	NC 1.80	0.82	47.3		585.0	253.7	175.6	1.00				
34.70	34.90	CI M	NC 1.80	0.82	48.2		588.5	255.2	178.8	1.00				
34.90	35.10	CI M	NC 1.80	0.82	47.6		592.0	256.7	176.8	1.00				
35.10	35.20	CI M	NC 1.80	0.82	47.3		594.7	257.9	175.7	1.00				

CPT-test performed according to EN ISO 22476-1

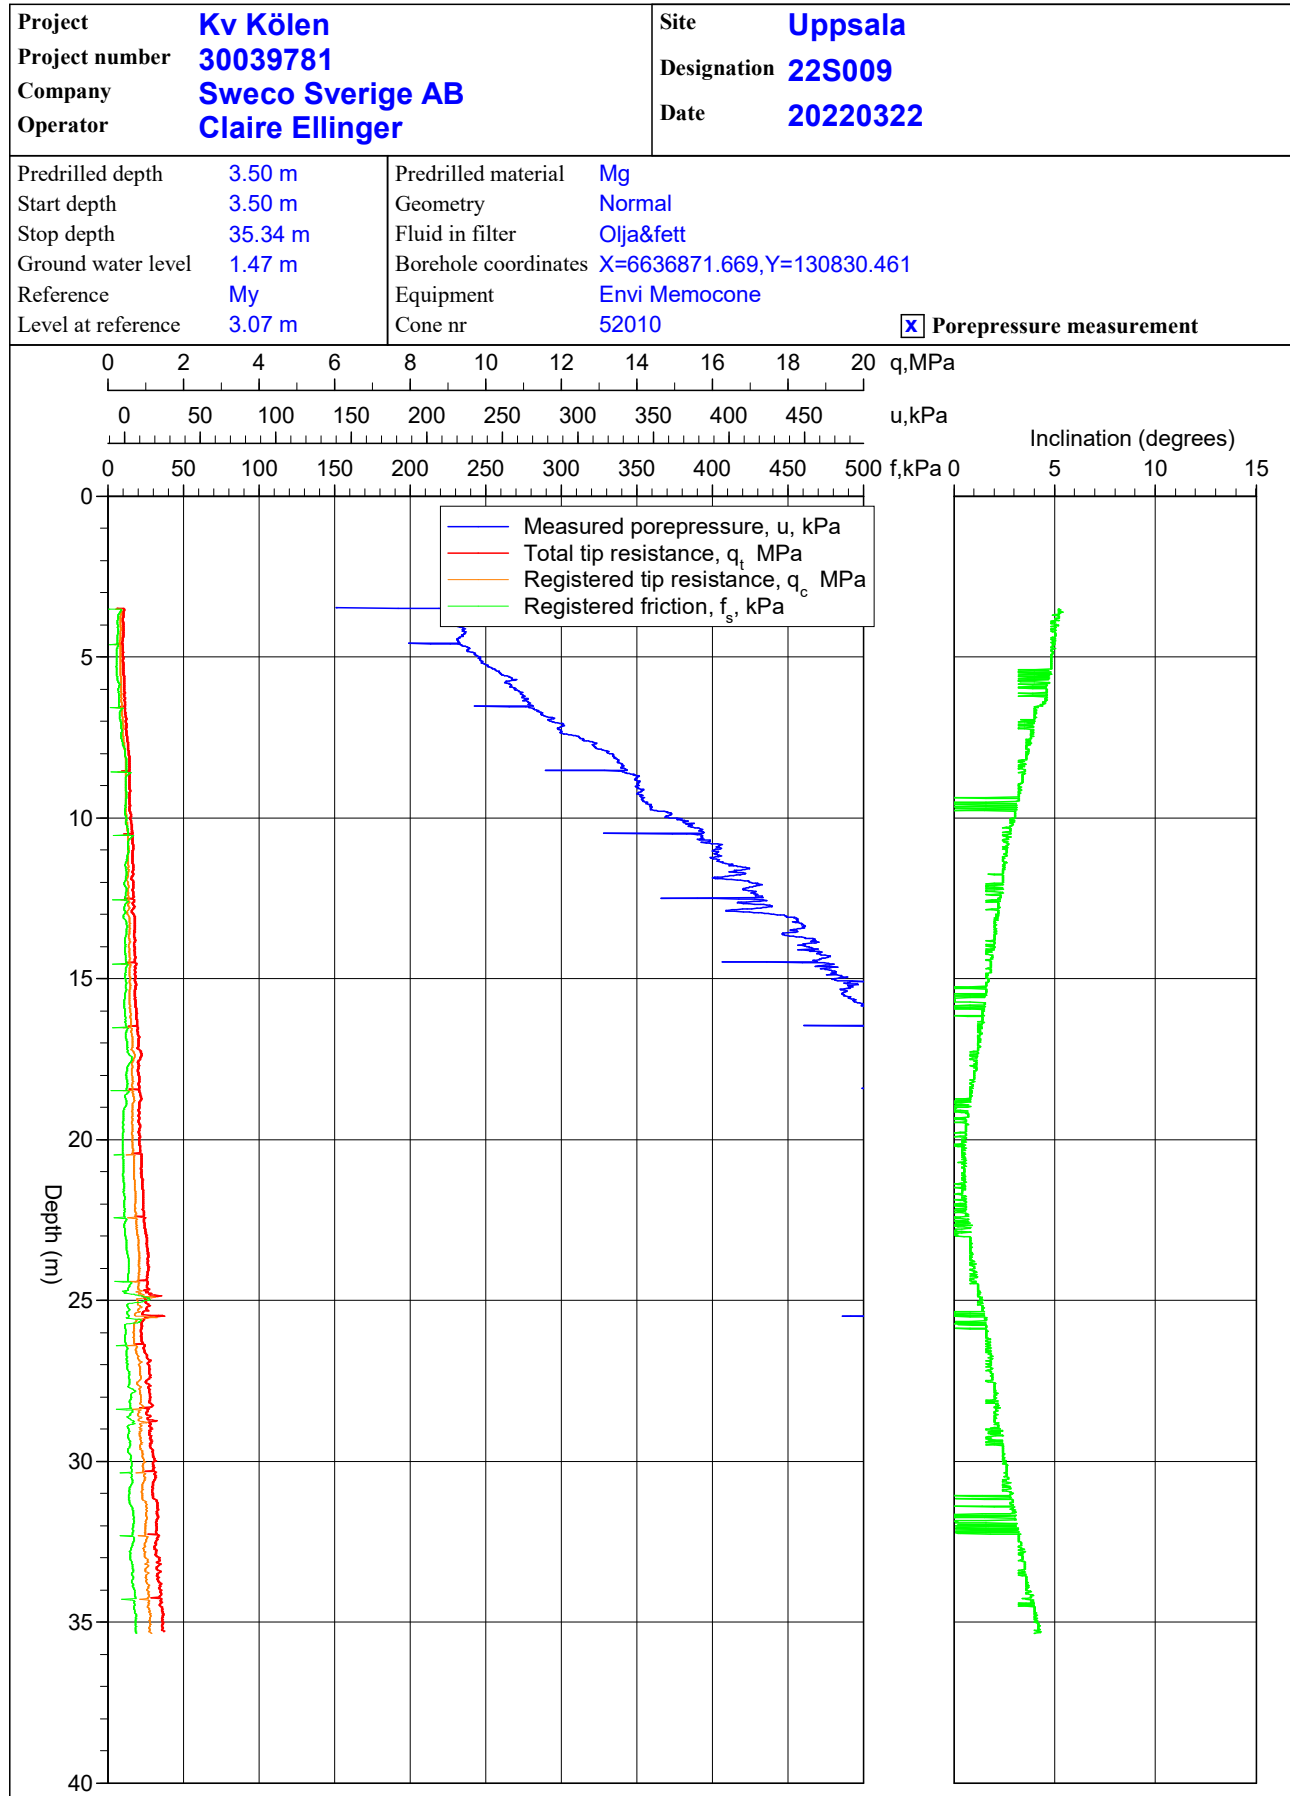



Calibration certificate, G1

Date: Friday 15 October 2021
Owner: Sweco, Norrtälje
Calibration place:
Operator: Anders Malmström

G1 master ID: 30120
Rig serial number: N/A
Rig man year: N/A
Rig type: GS8

Calibrated parameters	Applied value	Reading	Unit	Error %
Feed Force (main)	0	0	Kg	-
	250	258	Kg	3.10 %
	500	504	Kg	0.79 %
	750	744	Kg	0.8 %
	1000	998	Kg	0.2 %
	2000	2020	Kg	0.99 %

Parameter	Applied value	Reading	Unit	Error %
DEPTH	2000	2000	Millimeters	0 %
ROTATION UNIT 1	20	20	Halfturns	0 %
ROTATION UNIT 2	20	20	Halfturns	0 %
ROTATION PRESSURE	44	44	Bar	0 %
HAMMER PRESSURE	100	100	Bar	0 %
FLUSH PRESSURE	4	4	Bar	0 %
FLUSHING VOLUME	12	12	l/min	0 %
FLUSH PRESSURE	4	4	Bar	0 %



Geoscand AB
 Traversgatan 3
 S-441 38 Alingsås
 SWEDEN

15 oktober 2021



TECKENFÖRKLARING PLAN

22SXX ID-NR FÖR BORRHÅL
+3,5 MARKHÖJD VID BORRHÅL

- SONDERING
- ENKEL SONDERING UTAN REDOVISNING AV SONDERINGSMÖTSTÅND, TEX STICKSONDERING
 - DYNAMISK SONDERING, TEX SLAGSONDERING
 - STATISK SONDERING, TEX TRYCKSONDERING
 - CPT-SONDERING

- TILLÄGG FÖR DJUPBESTÄMNING
- SONDERING AVSLUTAD UTAN ATT STOPP ERHÅLLITS
 - SONDERING TILL FÖRMODAD FAST BOTTEN
 - SONDERING MINST 3 M I FÖRMODAT BERG
 - SONDERING MINDRE ÄN 3 M I FÖRMODAT BERG
 - SONDERING TILL FÖRMODAT BERG

- PROVTAGNING
- STÖRD PROVTAGNING AV JORD

- HYDROGEOLOGISKA UNDERSÖKNINGAR
- GRUNDVATTENRÖR
 - VATTENNIVÅ BESTÄMD I TEX PROVTAGNINGSHÅL

KOORDINATSYSTEM
SWEREF99 1800
HÖJD: RH2000

HÄNVISNINGAR FÖR BETECKNINGAR
FÖR MER DETALJERAD FÖRKLARING HÄNVISAS TILL
SGF/BGS BETECKNINGSSYSTEM PÅ www.sgf.net
(Publikationer → SGF/BGS BETECKNINGSSYSTEM)

BET	ANT	ÄNDRINGEN AVSER	SIGN	DATUM
-----	-----	-----------------	------	-------

UPPSALA KOMMUN


SWECO SVERIGE AB
Sankt Larsgatan 16
58224 Linköping
Org.nr. 556767-9849
www.sweco.se



UPPDRAG NR 30039781	RITAD AV P GAOTURE	HANDLÄGGARE P GAOTURE
DATUM 2022-04-20	GRANSKAD AV L MALMROS	

KV KÖLEN UPPSALA
GEOTEKNISK UNDERSÖKNING

PLAN	NUMMER	BET
SKALA 1:1000 A1	G-10.1-001	



TECKENFÖRKLARING PLAN

22SXX ID-NR FÖR BORRHÅL
 -3.8 MARKHÖJD VID BORRHÅL

SONDERING

- ENKEL SONDERING UTAN REDDOVISNING AV SONDERINGSMOTSTÅND, TEX STICKSONDERING
- DYNAMISK SONDERING, TEX SLAGSONDERING
- STATISK SONDERING, TEX TRYCKSONDERING
- CPT-SONDERING

TILLÄGG FÖR DJUPBESTÄMNING

- SONDERING AVSLUTAD UTAN ATT STOPP ERHÅLLITS
- SONDERING TILL FÖRMODAD FAST BOTTEN
- SONDERING MINST 3 M I FÖRMODAT BERG
- SONDERING MINDRE ÄN 3 M I FÖRMODAT BERG
- SONDERING TILL FÖRMODAT BERG

PROVTAGNING

- STÖRD PROVTAGNING AV JORD

HYDROGEOLOGISKA UNDERSÖKNINGAR


- GRUNDVATTENRÖR
- VATTENNIVÅ BESTÄMD I TEX PROVTAGNINGSHÅL

KOORDINATSSYSTEM

SWEREF99 1800
 HÖJD: RH2000

HÄNVISNINGAR FÖR BETECKNINGAR

FÖR MER DETALJERAD FÖRKLARING HANVISAS TILL SGF/BGS BETECKNINGSSYSTEM PÅ www.sgf.net (Publikationer → SGF/BGS BETECKNINGSSYSTEM)

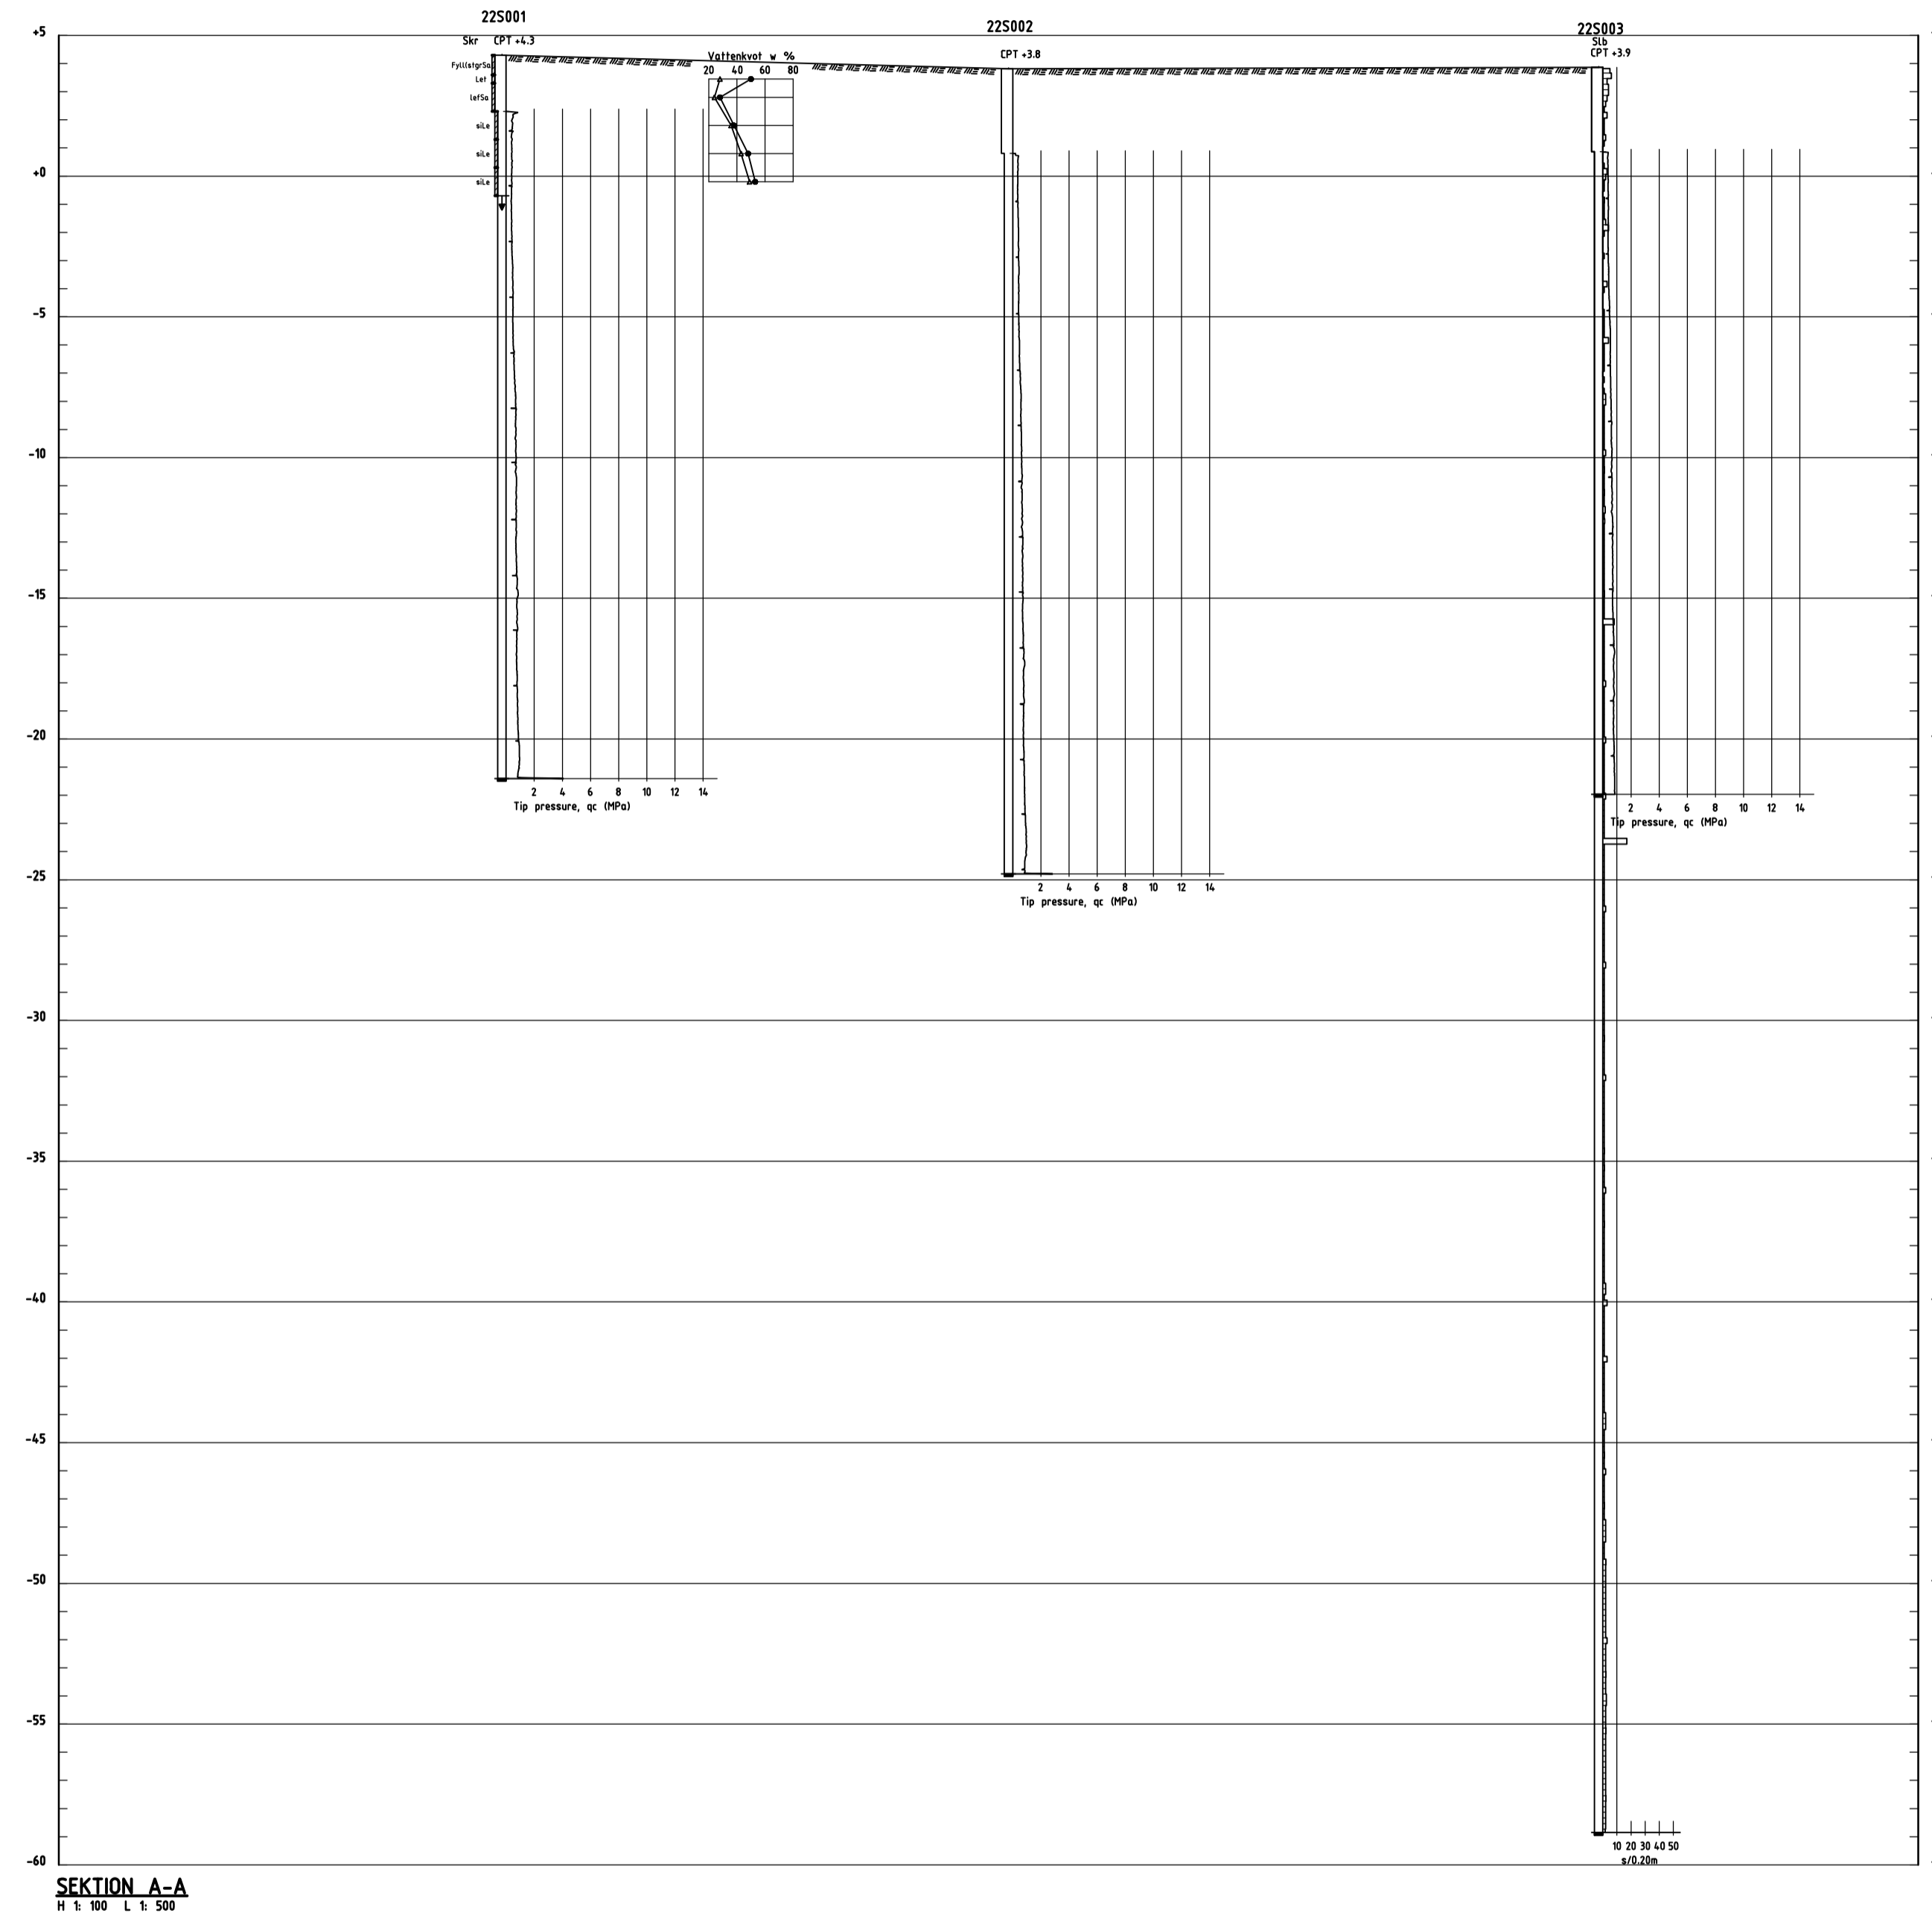

SEKTION A-A
 H 1:100 L 1:500

BET	ANT	ÄNDRINGEN AVSER	SIGN	DATUM

UPPSALA KOMMUN

SWECO SVERIGE AB
 Sankt Larsgatan 16
 58224 Linköping
 Org.nr: 556787-0849
 www.sweco.se




UPPDRAG NR 30039781	RITAD AV P GAOTURE	HANDLÄGGARE P GAOTURE
DATUM 2022-04-20	GRANSKAD AV L MALMROS	

KV KÖLEN UPPSALA
 GEOTEKNISK UNDERSÖKNING

Sektion A-A

SKALA 1:200 A1	NUMMER G-10.2-001	BET
--------------------------	-----------------------------	-----

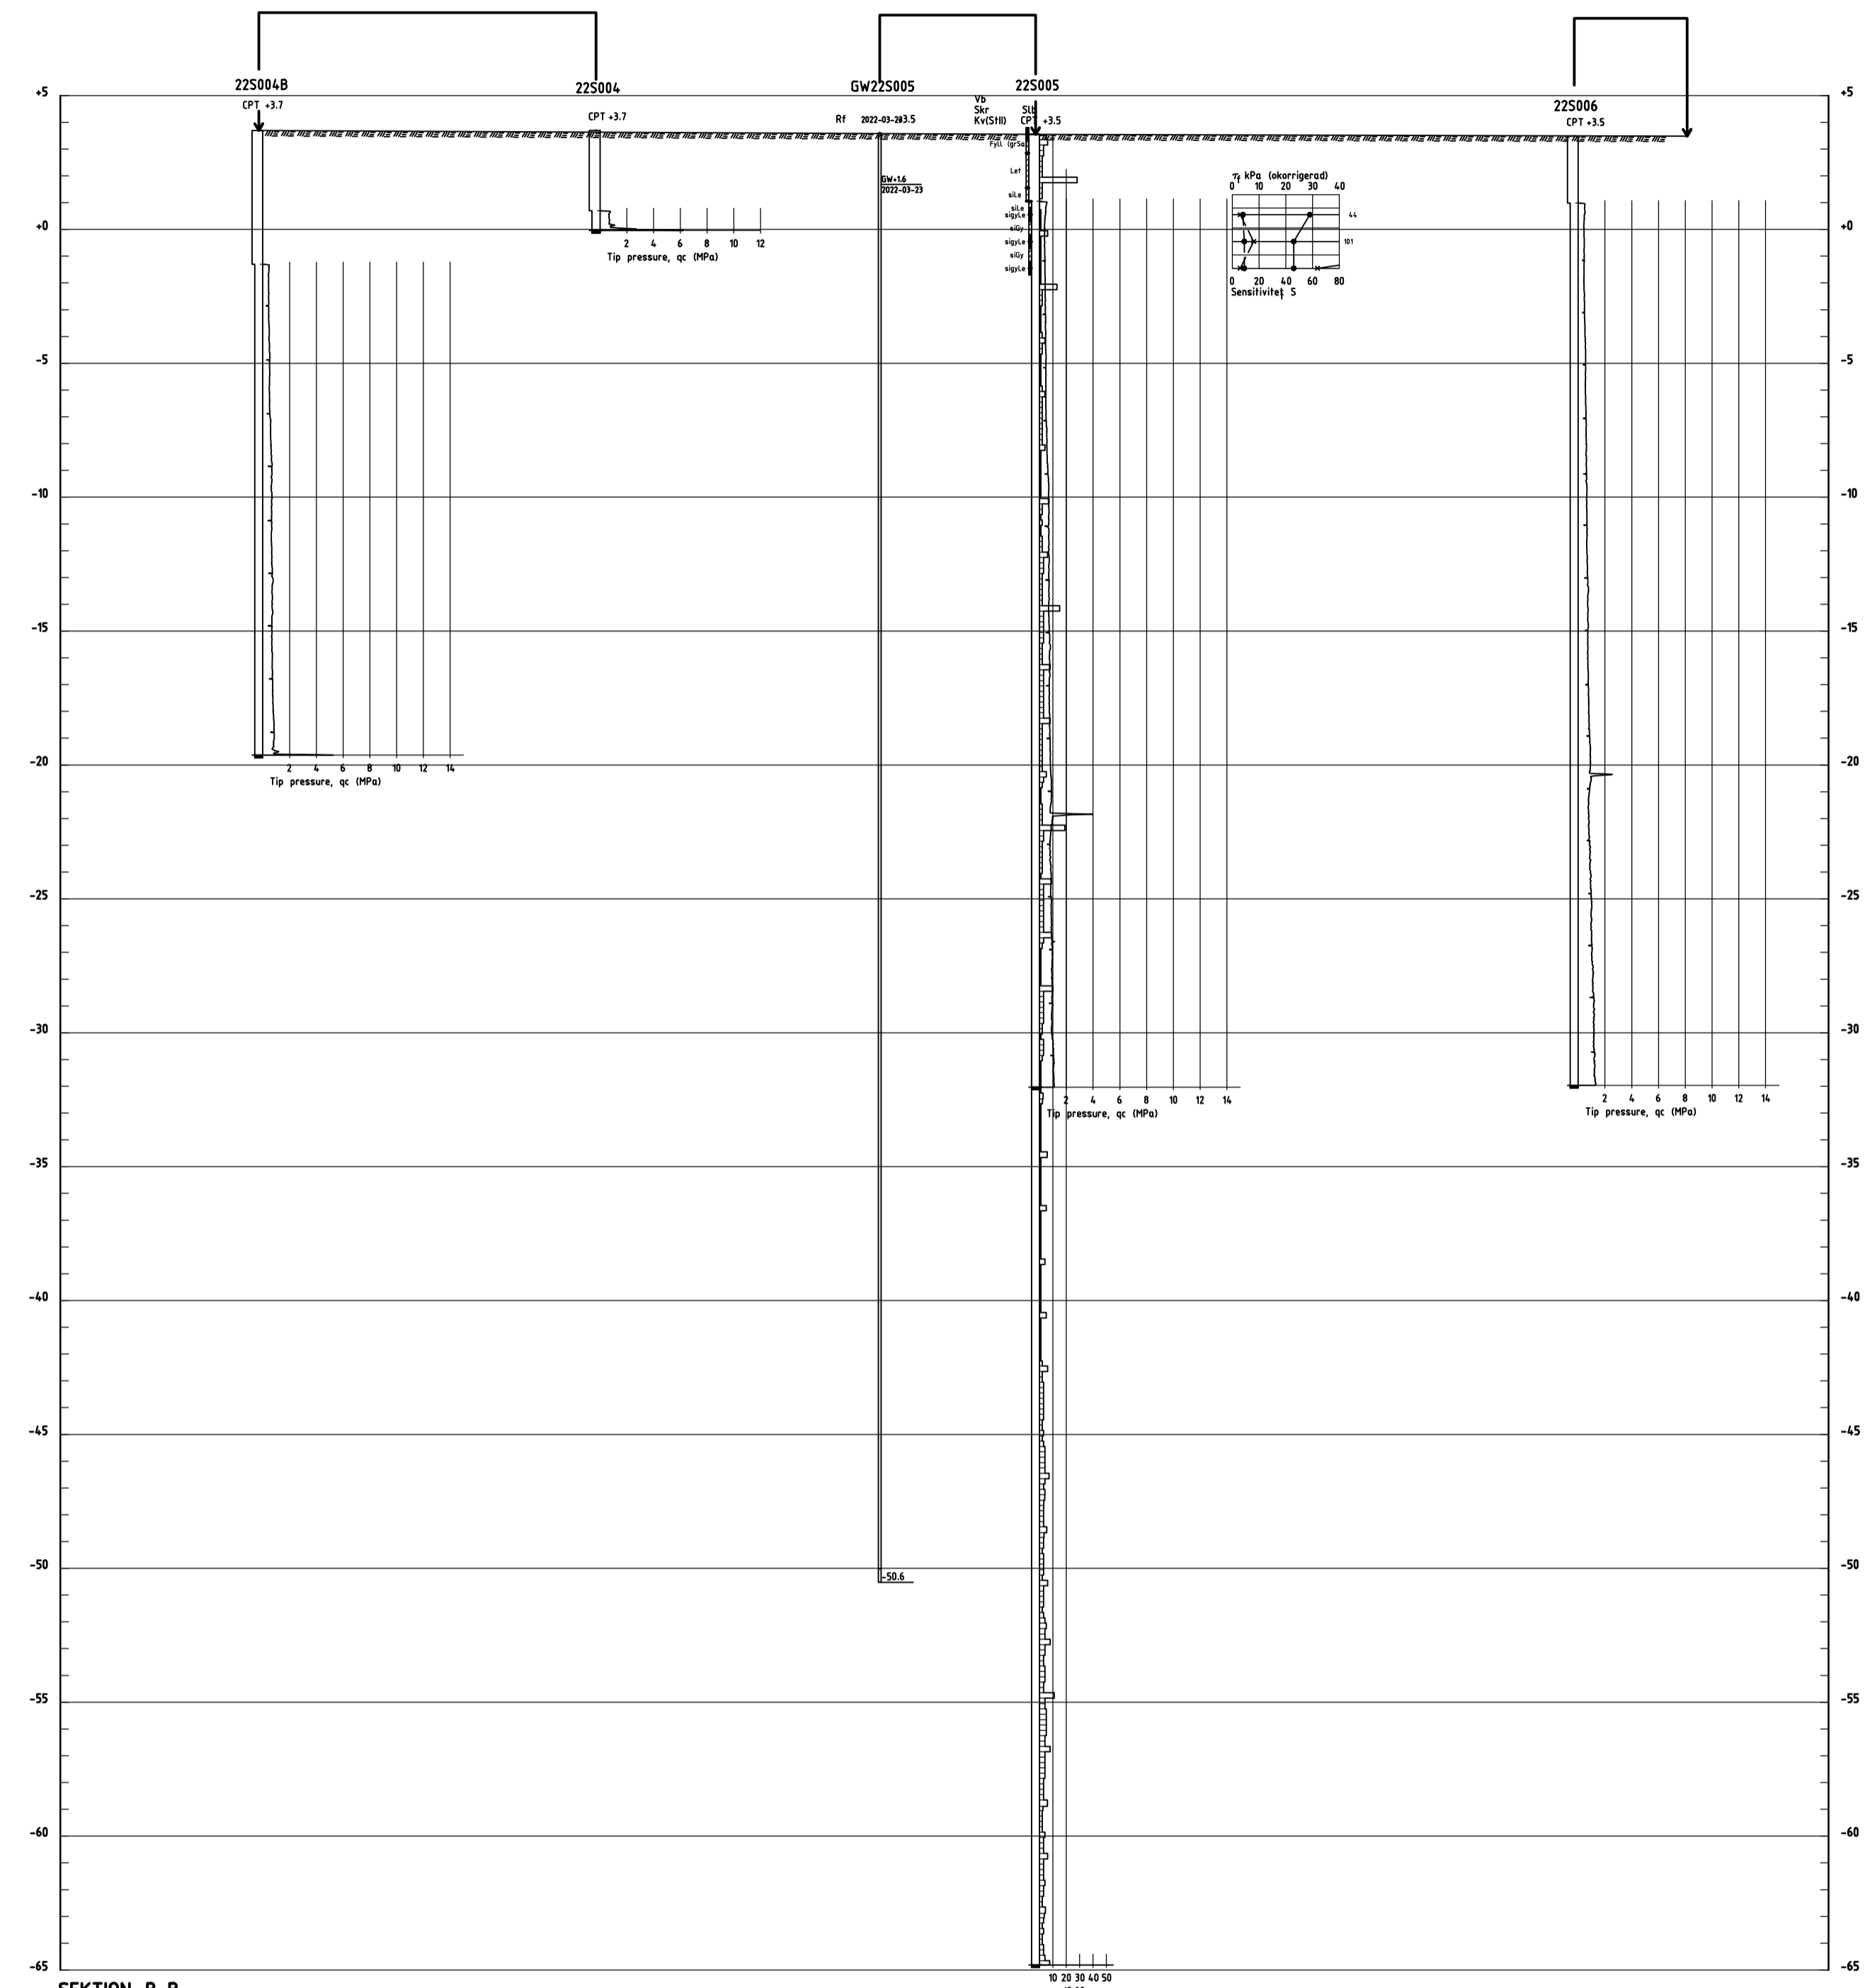

SEKTION B-B
H 1: 100 L 1: 500

TECKENFÖRKLARING PLAN

22SXX ID-NR FÖR BORRHÅL
-3.5 MARKHÖJD VID BORRHÅL

- SONDERING**
- ENKEL SONDERING UTAN REDDOVISNING AV SONDERINGSMOTSTÅND, TEX STICKSONDERING
 - DYNAMISK SONDERING, TEX SLAGSONDERING
 - STATISK SONDERING, TEX TRYCKSONDERING
 - CPT-SONDERING

- TILLÄGG FÖR DJUPBESTÄMNING**
- SONDERING AVSLUTAD UTAN ATT STOPP ERHÅLLITS
 - SONDERING TILL FÖRMODAD FAST BOTTEN
 - SONDERING MINST 3 M I FÖRMODAT BERG
 - SONDERING MINDRE ÄN 3 M I FÖRMODAT BERG
 - SONDERING TILL FÖRMODAT BERG

- PROVTAGNING**
- STÖRD PROVTAGNING AV JORD

- HYDROGEOLOGISKA UNDERSÖKNINGAR**
- GRUNDVATTENRÖR
 - VATTENNIVÅ BESTÄMD I TEX PROVTAGNINGSHÅL

KOORDINATSSYSTEM
SWEREF99 1800
HÖJD: RH2000

HÄNVISNINGAR FÖR BETECKNINGAR
FÖR MER DETALJERAD FÖRKLARING HANVISAS TILL SGF/BGS BETECKNINGSSYSTEM PÅ www.sgf.net (Publikationer → SGF/BGS BETECKNINGSSYSTEM)

BET	ANT	ÄNDRINGEN AVISER	SIGN	DATUM

UPPSALA KOMMUN


SWECO SVERIGE AB
Sankt Larsgatan 16
58224 Linköping
Org.nr: 556787-0849
www.sweco.se



UPPDRAG NR 30039781	RITAD AV P GAOTURE	HANDLÄGGARE P GAOTURE
DATUM 2022-04-20	GRANSKAD AV L MALMROS	

KV KÖLEN UPPSALA
GEOTEKNISK UNDERSÖKNING

Sektion B-B	SKALA 1:200 A1	NUMMER G-10.2-002	BET
-------------	-------------------	-----------------------------	-----

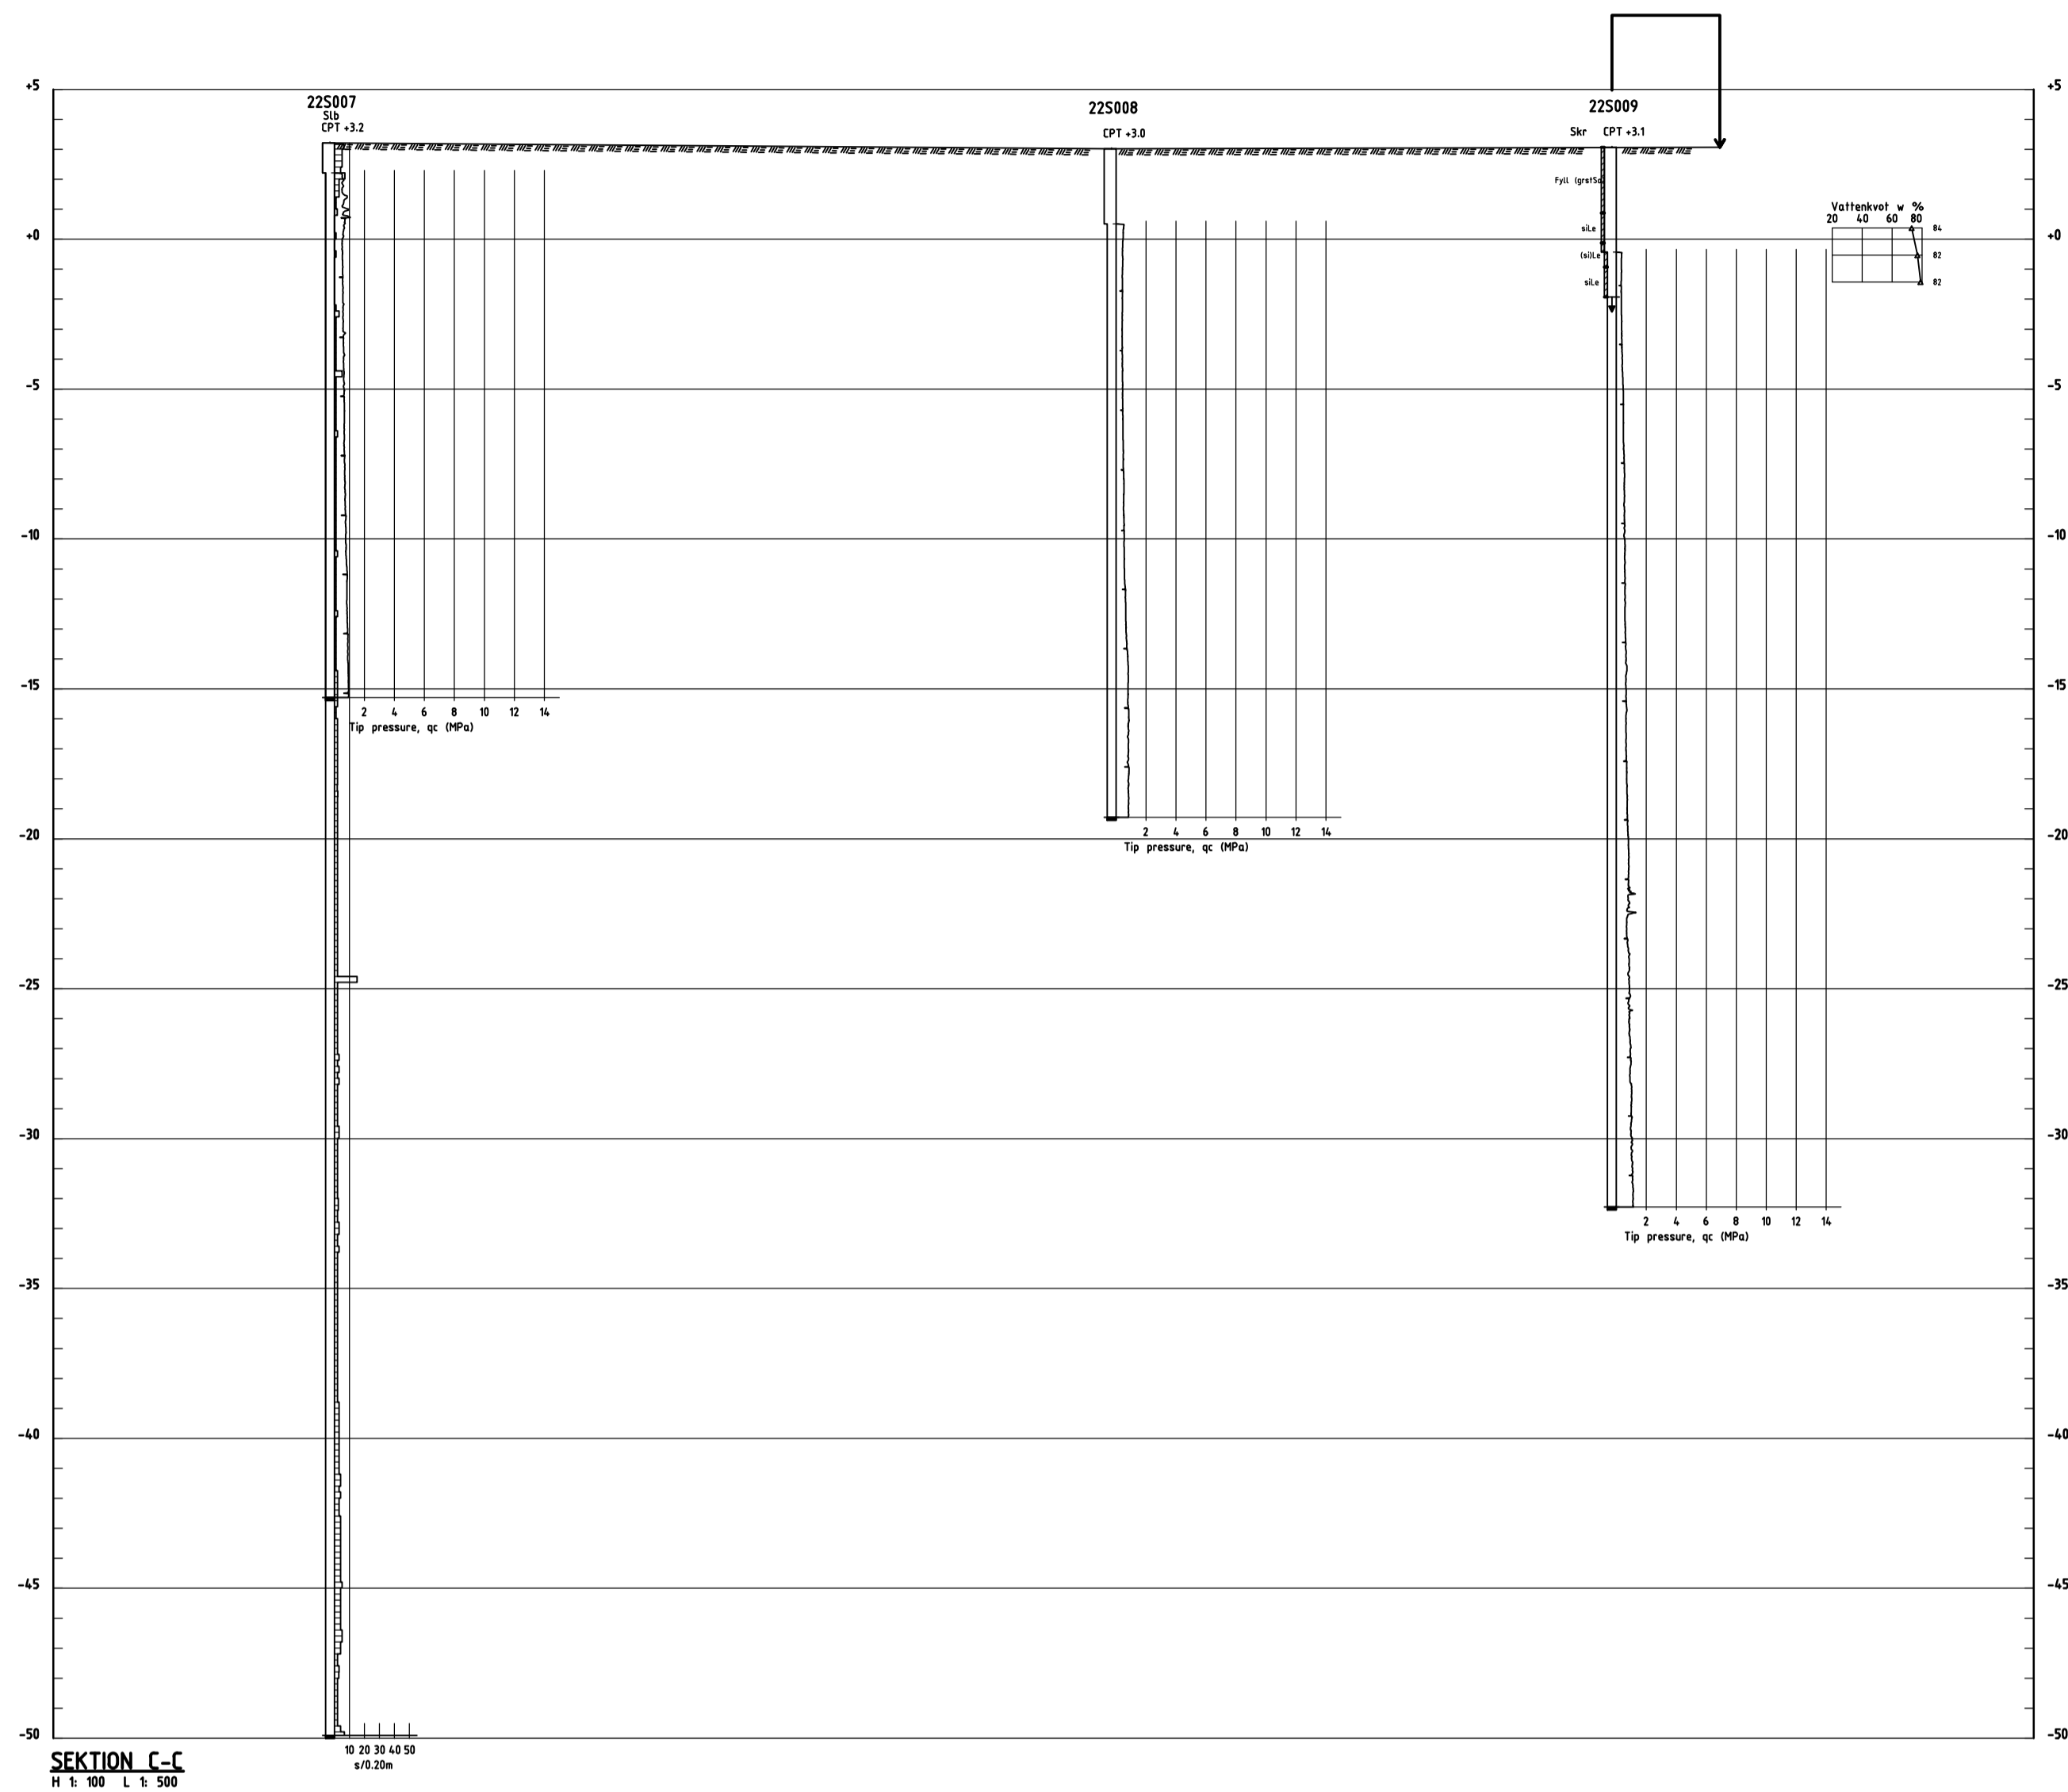

TECKENFÖRKLARING PLAN

22SXX ID-NR FÖR BORRHÅL
-3.5 MARKHÖJD VID BORRHÅL

SONDERING

- ENKEL SONDERING UTAN REDDOVISNING AV SONDERINGSMOTSTÅND, TEX STICKSONDERING
- DYNAMISK SONDERING, TEX SLAGSONDERING
- STATISK SONDERING, TEX TRYCKSONDERING
- CPT-SONDERING

TILLÄGG FÖR DJUPBESTÄMNING

- SONDERING AVSLUTAD UTAN ATT STOPP ERHÅLLITS
- SONDERING TILL FÖRMODAD FAST BOTTEN
- SONDERING MINST 3 M I FÖRMODAT BERG
- SONDERING MINDRE ÄN 3 M I FÖRMODAT BERG
- SONDERING TILL FÖRMODAT BERG

PROVTAGNING

- STÖRD PROVTAGNING AV JORD

HYDROGEOLOGISKA UNDERSÖKNINGAR

- GRUNDVATTENRÖR
- VATTENNIVÅ BESTÄMD I TEX PROVTAGNINGSHÅL

KOORDINATSSYSTEM

SWEREF99 1800
HÖJD: RH2000

HÄNVISNINGAR FÖR BETECKNINGAR

FÖR MER DETALJERAD FÖRKLARING HANVISAS TILL SGF/BGS BETECKNINGSSYSTEM PÅ www.sgf.net (Publikationer → SGF/BGS BETECKNINGSSYSTEM)

BET	ANT	ÄNDRINGEN AVISER	SIGN	DATUM

UPPSALA KOMMUN

SWECO SVERIGE AB
Sankt Larsgatan 16
58224 Linköping
Org.nr: 556787-0849
www.sweco.se



UPPDRAG NR 30039781	RITAD AV P GAOTURE	HANDLÄGGARE P GAOTURE
DATUM 2022-04-20	GRANSKAD AV L MALMROS	

**KV KÖLEN UPPSALA
GEOTEKNISK UNDERSÖKNING**

Sektion C-C

SKALA 1:200 A1	NUMMER G-10.2-003	BET
-------------------	----------------------	-----